



DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT
GOVERNMENT CENTER
14949 62nd STREET NORTH P.O. BOX 6 STILLWATER, MN 55082-0006
Office: 651-430-6655 TDD: 651-430-6246 FAX: 651-430-6730

SSTS MAINTENANCE REPORT

System Location
Address 13846 G3RD STREET PL N. Telephone Number
City STILLWATER State MN ZIP 55082 Property ID No./GEO Code
Owner SC ANIS PETERS Pumping Date 6-4-2017
Contractor
Maintainer SCHLOMKA PUMPING License No. 3302 Telephone Number 651.437.7284

What was done to the system?
[X] Tank(s) Pumped
[ ] Sludge and scum measured.
Do tanks need to be pumped?
[ ] Yes [ ] No (If no provide measurements below)

Report Liquid Capacity in Gallons
Tank 1: 1 [X] Pumped Tank 2: [ ] Pumped
Tank 3: [ ] Pumped Tank 4: [ ] Pumped
Total Gallons Pumped: 1000


Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

Empty box for visual inspection notes.

\*Tank Measurements Use Only If Tank(s) Were NOT Pumped

Tank Length in. X Tank Width in. X Tank Depth in. = Tank Volume (cubic inches)
Tank Radius in. X Tank Radius in. X 3.14 = Tank Volume (cubic inches)
Tank Volume (cu. in.) / 231.01 = Liquid Capacity Gallons / Tank Depth in. = Gallons/Inch
Sludge Level in. X Gallons Per Inch = Sludge Volume Gallons
Scum Level in. X Gallons Per Inch = Scum Volume Gallons
Sludge Volume + Scum Volume = Total Sludge and Scum Volume Gallons
Total Sludge and Scum Volume / Liquid Capacity = Percent Sludge and Scum in Tank %

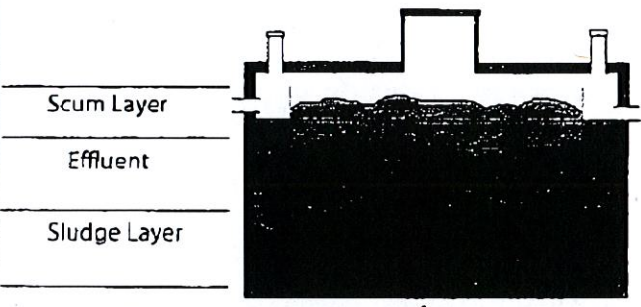

Tank Depth measured from invert of outlet pipe to bottom of tank

\*Tanks must be pumped if either of the following conditions exist:
1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Signature [Signature]

Date 8-17-17

