### **Inspect Minnesota & Midwest Soil Testing**

P.O. Box 10853 White Bear Lake, MN 55110 651-492-7550/Brian@Midwestsoiltesting.com

Brian Humpal MPCA Licensed Advanced Inspector

### SUBSURFACE SEWAGE TREATMENT SYSTEM (SSTS) COMPLIANCE REPORT

**Inspection Address:** 740 Midwest Trail N, Lake Elmo, MN 55042

### **REPORT SUMMARY**

I have performed an "MPCA Compliance Inspection" on this system, have reviewed the history of the system with the owner, LuAnn Olson, and have reviewed the original design/permit records on file at Washington County. This older system (installed in 1991) consists of a pre-cast septic tank and a rock trench drainfield.

Predicated on my inspection of the system, my review of the history of the system with the owner, and my review of the original design/permit records, it is my opinion that this system presently meets MPCA minimum compliance inspection requirements.

Inspect Minnesota and Midwest Soil Testing have been hired to perform a compliance inspection of this SSTS for compliance with local ordinances pursuant to Minn. Stat. § 115.55 (2013). This compliance inspection covers only the criteria required by Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011). A compliance inspection is an indication of the current compliance status of the system and does not guarantee the performance or longevity of this system beyond the date of inspection, as it is impossible to determine the future performance of any system. Inspect Minnesota and Midwest Soil Testing disclaim any use of this compliance inspection beyond determining SSTS compliance pursuant to Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011).

Please contact me should you have any questions.

Christopher Uebe

Brian Humpal



# **Compliance Inspection Form**

### **Existing Subsurface Sewage Treatment Systems** (SSTS)

Doc Type: Compliance and Enforcement

	Doc Type. Compliance and Emorcement	
<b>Instructions:</b> Inspection results based on Minnesota Pollution Control Agency (MPCA requirements and attached forms – additional local requirements may also apply.	For local tracking purposes:	
Submit completed form to Local Unit of Government (LUG) and system owner within 15 days		
System Status		
System status on date (mm/dd/yyyy):10/10/2018		
	mpliant – Notice of Noncompliance grade Requirements on page 3)	
Reason(s) for noncompliance (check all applicable)		
☐ Impact on Public Health (Compliance Component #1) – Imminent threat	to public health and safety	
☐ Other Compliance Conditions (Compliance Component #3) – Imminent to		
☐ Tank Integrity (Compliance Component #2) – Failing to protect groundw	ater	
☐ Other Compliance Conditions (Compliance Component #3) – Failing to p	rotect groundwater	
Soil Separation (Compliance Component #4) – Failing to protect ground		
☐ Operating permit/monitoring plan requirements (Compliance Component	#5) – Noncompliant	
Property Information Parcel ID# or Sec/Twp/Ra	nge:	
Property address: _740 Midwest Trail N, Lake Elmo, MN 55042 Reason	for inspection: Property Transfer	
Property owner: LuAnn Olson Owner's	s phone: 612-386-8401	
or		
· · · · · · · · · · · · · · · · · · ·	entative phone:	
	Regulatory authority phone: 651-430-6655	
Brief system description:  A pre-cast septic tank and a rock trench drainfield.		
Comments or recommendations:		
Certification		
I hereby certify that all the necessary information has been gathered to determine the determination of future system performance has been nor can be made due to unknown possible abuse of the system, inadequate maintenance, or future water usage.	,	
Inspector name: Brian Humpal/Christopher Uebe Certification	ation number: C5342/C9852	
Business name: Inspect Minnesota, Midwest Soil Testing Lice	ense number: _L2896	
Inspector signature: Brian Thumpal Affice Man Pl	none number:651-492-7550	
Necessary or Locally Required Attachments		
	r local ordinance	
	r local ordinance	
	ICCHSC	

Property address: 740 Midwest Trail N, Lake Elmo, MN 55042

Inspector initials/Date: 10/10/2018

1.	In	npact on Public Health – Co	mpliance compo	ent #1 of 5			
	Compliance criteria:			Verification method(s):			
	Sy	vstem discharge sewage to the ound surface.	☐ Yes ⊠ No	<ul><li>✓ Searched for surface outlet</li><li>✓ Searched for seeping in yard/backup in home</li></ul>			
		stem discharge sewage to drain tile surface waters.	☐ Yes ⊠ No	<ul> <li>☑ Excessive ponding in soil system/D-boxes</li> <li>☑ Homeowner testimony (See Comments/Explanation)</li> </ul>			
		vstem cause sewage backup into velling or establishment.	☐ Yes ⊠ No	☐ "Black soil" above soil dispersal system ☐ System requires "emergency" pumping ☐ Performed dye test			
		ny "yes" answer above indicate: n Imminent Threat to Public Hea		☐ Unable to verify (See Comments/Explanation) ☐ Other methods not listed (See Comments/Explanation)			
		omments/Explanation: one of the above found.					
2.	Ta	ank Integrity – Compliance con	nponent #2 of 5				
	C	ompliance criteria:		Verification method(s):			
		stem consists of a seepage pit,	☐ Yes ⊠ No	☑ Probed tank(s) bottom			
		sspool, drywell, or leaching pit.		☐ Examined construction records			
		epage pits meeting 7080.2550 may be mpliant if allowed in local ordinance.		<ul><li>Examined Tank Integrity Form (Attach)</li><li>Observed liquid level below operating depth</li></ul>			
		ewage tank(s) leak below their	☐ Yes ⊠ No	Examined empty (pumped) tanks(s)			
		esigned operating depth.		☐ Probed outside tank(s) for "black soil"			
	If yes, which sewage tank(s) leaks:			<ul> <li>☐ Unable to verify (See Comments/Explanation)</li> <li>☑ Other methods not listed (See Comments/Explanation)</li> </ul>			
	Any "yes" answer above indicates the system is Failing to Protect Groundwater.						
	Comments/Explanation:						
	Lowered underwater camera into tank - baffles and tank walls OK.						
3.	Ot	ther Compliance Conditions	S – Compliance	omponent #3 of 5			
	a.	•	·	ed, or appear to structurally unsound. ☐ Yes* ☒ No ☐ Unknown			
	<ul> <li>b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety. ☐ Yes* ☐ No ☐ Unknow *System is an imminent threat to public health and safety</li> <li>Explain:</li> </ul>						
	c. System is non-protective of ground water for other conditions as determined by inspector ☐ Yes* ☒ No *System is failing to protect groundwater						
		Explain:					

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12 Page 2 of 3

Property address: 740 Midwest Trail N, Lake Elmo, MN 55042

Inspector initials/Date: 10/10/2018

١.	Soil Separation – Compliance compor	nent #4 of	f 5			
	Date of installation: 1991	Unkn	own	V	erification method(s):	
	Shoreland/Wellhead protection/Food Beverage Lodging?	☐ Yes	⊠ No		oil observation does not expire. Pr	
	Compliance criteria:	u		u	observations by two independent parties are sufficient, unless site conditions have been altered or local	
	For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment:  Drainfield has at least a two-foot vertical separation distance from periodically	⊠ Yes	□ No		cquirements differ.  Conducted soil observation(s) (and the conducted soil observation (s) (but the conducted soil observation (Attach the conducted soil observation (soil observation that the conducted soil observation (soil observation (s) (soil observation (s)	ch boring logs) o drainfield) (Explanation)
	Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment:	☐ Yes	□No		comments/Explanation: eviewd design and permit records	).
	Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*					
	"Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules (7080. 2350 or 7080.2400 (Advanced Inspector License required)	☐ Yes	□No		ndicate depths of elevations  Bottom of distribution media	See Attached Boring Log(s)
	Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.				Periodically saturated soil/bedrock  System separation	
<b>5.</b>	Any "no" answer above indicates the system is Failing to Protect Groundwater.  D. Required compliance separation*  *May be reduced up to 15 percent if allowed by Local Ordinance.  Operating Permit and Nitrogen BMP* – Compliance component #5 of 5 Not applicable					
Is the system operated under an Operating Permit?						
	Is the system required to employ a Nitrogen BMP?					
	If the answer to both questions is "no", this section does not need to be completed.					
	Compliance criteria					
	Operating Permit number:     Have the Operating Permit requirements in the second	been met?			☐ Yes ☐ No	
	b. Is the required nitrogen BMP in place and properly functioning?					
	Any "no" answer indicates Noncompliance.					

Upgrade Requirements (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

TTY 651-282-5332 or 800-657-3864 • Available in alternative formats 651-296-6300 • 800-657-3864 www.pca.state.mn.us • wq-wwists4-31 • 1/24/12 Page 3 of 3


# Inspect Minnesota & Midwest Soil Testing Subsurface Sewage Treatment System Owner/Property Information

This information will be used for the purpose of conducting an MPCA Compliance Inspection.

Date of Inspection: October 10, 2018	Time: 12:00 PM			
Duan outry Address 740 Midwest Tail N. Lake Elma MN	7: 55042			
Property Address: 740 Midwest Tail N, Lake Elmo, MN	Zip: 55042			
Property Owner: LuAnn Olson	Phone: 612-386-8401			
Tank(s)       Tank(s)Material       Soil Treatment System         Septic 1       □Fiberglass       □Rock trench         □Aerobic       □Plastic       □Gravelless trench         □Lift       □Metal       □Chamber trench         □Holding       □Concrete       □Seepage bed         □Other:       □Block       □Mound         □Other       □At-grade	Other  Alternative system  Experimental system  Cesspool system  Other system			
Are the tank maintenance covers accessible? ⊠ Yes ☐ No *If r				
performed through the maintenance holes. Maintenance hole cove				
the ground surface to facilitate access and proper maintenance of the	he system.			
	Tank size (gals.): 1500			
How long has seller owned the property? 1995 Number of res	sidents in home? 2-4			
Number of bedrooms? 4 Are all floors drained by gr				
Garbage disposal? Y Whirlpool bath?	Y			
More than one system (laundry, etc.)? N				
Does this property have any footing drain tiles connected to the sep	otic system? N			
Are any buildings on this property such as garages or out-buildings	s connected to this system? N			
Are there any additional systems on this property serving other built	ldings? N			
Location of septic system on lot? West Side				
Location of water well on lot? Northwest Side	well a deep well? Y			
Have you ever experienced any problems with the system such as: tree roots, sewage back-ups,				
surfacing of sewage onto the ground, septic tank overflowing, etc.; or have any repairs been made to the system? N If yes, explain:				
Wilson 4l4 14 19 2017	Dild. C C			
When was the system last pumped? 2017 Name of pumper: Pinky's Sewer Service  How often pumped in previous years? Every 2-3 Is system on a monitoring plan? N				
Have you received notices from any government agency concerning this system? N				
Is your property located in a shoreland management area? N				
Do you have any additional information that should be given to the new owner? N				

I hereby certify that the above information is correct to the best of my knowledge. I also understand that if the system is considered "non-compliant/failing" per MPCA rules, that the inspector must by law submit a copy of this report to the local government unit within 15 days of the date of inspection completion. I also agree that unless otherwise noted in this report, that I/we are ultimately responsible for payment of all fees for all work performed relative to this inspection by Inspect Minnesota and Midwest Soil Testing.

Owner/Occupant: LuAnn Olson's Signature On File Date: 10/10/2018

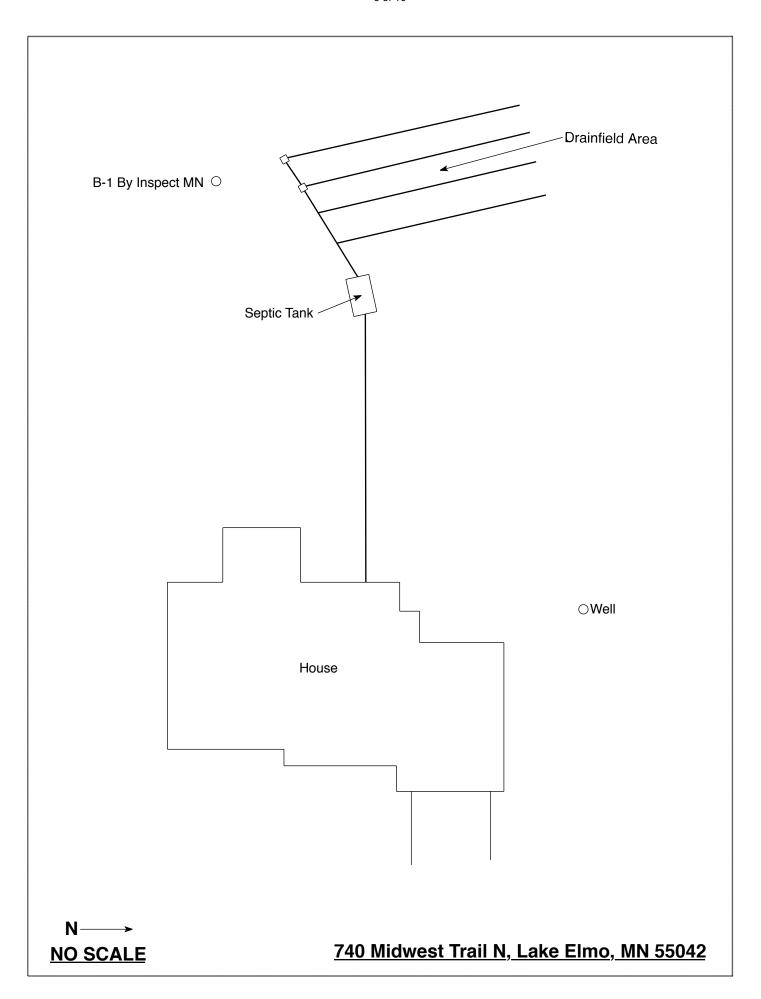

### **Log Of Soil Borings**

Location of Project: 740 Midwest Trail N, Lake Elmo, MN 55042					
Borings Made By: Inspect Minnesota		-	Date:	10/10/18	
Auger Used: Hand/Bucket			Classi	ification System:	USDA
Boring Number: 1				Boring Number:	
Surface Elevation of Boring  Same ground surface as last drainfield trench		Surface Elevation Boring			
Depth In Inches	Soils E	<u>ncountered</u>	Depth In Inches	Soils Er	<u>icountered</u>
0-8 8-18 18-38 38-52 52-71	10YR 4 10YR 3/4 Mediu ≈10% Ro 10YR 3/4 Mediu Gravel ≈15-20	/2 Silt Loam /3 Silt Loam Im Sand With Gravel ock Fragments Im Coarse Sand With Im Rock Fragments Medium Sand			
71"	Depth To End Of B	oring Or Redox		Depth To End Of Bo	oring Or Redox
Same	Elevation Of Boring	g Relative To System		Elevation Of Boring	Relative To System
-38"	<u> </u>				f Distribution Media
≥33" Of Separation			Of Separation		
	End Of Boring At:	71"		End Of Boring At:	
Redox Present At: None			Redox Present At:		
Standing Water Present At: None		Standing	Water Present At:		

Bottom Of Distribution Medium At: 38 Inches	

Lot 3 P. LOG OF SOIL BORINGS

BORING NO.	BORING NO. 2	BORING NO. 3	BORING NO. 4
OSPIN DOLL	DEPTH BOIL	DEPTH SOLL	DEPTH SOIL
Dark brown fine andly loan  Lightredate brown fine loany sand	O Dark brown Fire Eardy Icam	Derk brown Gre Barny Sand Light brown Lan fine to medium clenn Sond	Dork brown fine sondy loam.  Brown fine sandy I com Light brown fine to medium sand
BL' Light brown arechuration corse skind and gravel	42" Light-Ian	421	
64" Lighton Fine 16	fine to medium sand.  Light tan Fine to medium aleain pard	Light tan fine to medium alean sand	SH" Light tan fine to medium c.kan sond
medium clean fard	SO END	RW END	8'A' E ND

### **DISCLAIMER**

# Brian L. Humpal, Inc. dba. Inspect Minnesota, Midwest Soil Testing Relative to Subsurface Sewage Treatment System (SSTS) Compliance Inspections

- 1. This inspection/report is being performed for only the seller/owner of the property on which the SSTS is located. In such case that another party is paying for the inspection, the contract is between only said party and Brian L. Humpal, Inc.; there is no contract between Brian L. Humpal, Inc. and any other party unless otherwise noted.
- 3. Brian L. Humpal, Inc. has not been retained to warranty, guarantee, or certify the proper functioning of the SSTS for any period of time beyond the date of inspection or into the future. Because of the numerous factors (usage, maintenance, soil characteristics, previous failures, etc.) which may affect the proper operation of an SSTS, as well as the inability of Brian L. Humpal, Inc. to supervise or monitor the use or maintenance of the SSTS, the report shall not be construed as a warranty by Brian L. Humpal, Inc. that the SSTS will function properly for any particular party for any period of time.
- 4. Brian L. Humpal, Inc. is unable to verify the frequency and/or, quality of prior or future maintenance of the SSTS. Maintenance of the tank(s) must be performed through the tanks maintenance hole. The removal of solids from any location other than the maintenance hole is not a compliant method of maintenance. It is strongly recommended that maintenance covers be made accessible to the ground surface to facilitate proper maintenance.
- 5. Minimum Compliance Inspection requirements relative to this inspection and this report include <u>only</u> verification that the SSTS has tank(s) (septic tanks, lift tanks, dosing tanks, stilling tanks, etc.) which are watertight below the designed operating depth, the required separation between the bottom of the subsurface soil distribution medium and seasonally saturated soils, no back-ups of sewage into the dwelling, no discharge of sewage/effluent to the ground surface or surface waters, and no imminent safety hazards. Brian L. Humpal, Inc. does not inspect plumbing or pumps prior to the first SSTS component as these are plumbing components. The performance of exterior pumps and associated components are not inspected as they are considered to be maintenance items. Additionally, no indications relative to compliance with electrical code requirements have been made. It is recommended that any other applicable plumbing, electrical, housing, etc. inspections be performed by a qualified inspection business. Sewage back-up verification is limited to observing the floor drain area and/or the information supplied by the last occupants of the building prior to inspection. Brian L. Humpal, Inc. cannot guarantee that the information given to them by the last occupants of the building prior to inspection relative to back-ups is accurate.
- 4. Certification of this SSTS does not warranty future use beyond the date of the inspection. Any SSTS, old or new, can become hydraulically overloaded or discharge sewage/effluent to the ground surface as a result of more people moving into the house than were previously occupying the house, improper maintenance, heavy usage, leaking plumbing fixtures, groundwater infiltration, tree roots, freezing conditions, surface drainage problems, poor initial design, poor construction practices, or unsuitable materials used in constructing the system; the system can also simply stop working because of its age. An SSTS that has been properly designed and installed, properly maintained, and used in the manner for which the system was designed can be expected to provide service for twenty to twenty-five years on average. Some parts of the SSTS such as alarms, switches, pumps, filters, etc. will most likely have to be repaired or replaced over the lifetime of the system.
- 5. A Compliance Inspection is not meant to be a test or inspection for longevity of the system; a Compliance Inspection is strictly for the purpose of determining if the SSTS is protective of public health and safety, as well as the groundwater at the date and time the inspection was performed. This inspection is not intended to determine if the SSTS was originally designed or installed to past or present MPCA or other Local Government Unit code requirements. This inspection is not intended to determine if the SSTS was designed and/or installed to support the anticipated flow from the building as the use of the building may have changed since the design and construction of the SSTS due to the addition of bedrooms, occupants, etc. In addition, this inspection is not intended to determine the quality of the original SSTS design, the quality of the construction practices used while installing the SSTS, or the quality of the materials used in constructing the SSTS.
- 6. Brian L. Humpal, Inc. cannot guarantee the performance of SSTS products/components such as: gravelless pipe, chamber trenches, effluent filters, tanks, sewage pre-treatment components, piping, etc. Products such as gravelless pipe are no longer approved for installation in the State of Minnesota and may have a significantly reduced performance and/or life expectancy.
- 7. WINTER WORK: By accepting this report, it is understood that inspections conducted during winter months (approximately November 1<sup>st</sup> through April 1<sup>st</sup>) are more difficult to perform because of possible snow cover and/or ground frost. SSTS components such as tanks, maintenance covers, tank inspection pipes, subsurface distribution medium inspection pipes, and soil treatment areas are more difficult or impossible to locate due to snow cover and/or ground frost. In addition, soil borings are more difficult to perform due to snow cover and/or ground frost. Brian L. Humpal, Inc. will attempt to use the same level of standards when performing work during winter periods as when performing work during non-winter periods. However, the recipient of this report understands that because of the aforementioned considerations, the same level of standards may not be possible.
- 8. By accepting this report, the client understands that Brian L. Humpal, Inc. will not be responsible for any monetary damages exceeding the fee for the services provided.

# Subsurface Sewage Treatment Systems Non-transferable Business License

# Inspect Minnesota, Midwest Soil Testing

License # L2896

License Expires: 12/22/2018

Issued: 10/10/2017

es:

# Specialty Area(s):

Installer
Maintainer
Service Provider
Advanced Designer
Advanced Inspector

## Designated Certified Individual(s):

Cert #	Name	Certification Expir
C9633	Anthony P Scully	7/28/2018
	Installer, Designer (Conditional)	
C5342	Brian L Humpal	10/15/2020
	Installer, Maintainer, Serv Prov,	Adv Designer, Adv Inspector
C9852	Christopher R Uebe	3/4/2018
	Designer, Inspector	



520 Lafayette Road North St. Paul, Minnesota 55155-4194 Charles & Thompson

Charles K Thompson, Supervisor Certification & Training Unit