1 of 10

Inspect Minnesota & Midwest Soil Testing

P.O. Box 10853 White Bear L	Brian Humpal	
651-492-7550/Brian@Midwes	MPCA Licensed Advanced Inspector	
SUBSURFACE SEWAGE TR	(SSTS) COMPLIANCE REPORT	
Date: November 5, 2018	Time: 8:45 AM	Owner: Jeff & Jane Nicholls
Inspection Address: 8170 59 th S	t N, Lake Elmo, MN 550	42

REPORT SUMMARY

I have performed an "MPCA Compliance Inspection" on this system, have reviewed the history of the system with the owner, Jane Nicholls, and have reviewed the original design/permit records on file at the City of Lake Elmo. This very old system (installed in 1984) consists of a pre-cast septic tank and a rock trench drainfield. It should be noted that the average life expectancy of a septic system is approximately 30 years.

Predicated on my inspection of the system, my review of the history of the system with the owner, and my review of the original design/permit records, it is my opinion that this system <u>presently meets</u> MPCA minimum compliance inspection requirements.

Inspect Minnesota and Midwest Soil Testing have been hired to perform a compliance inspection of this SSTS for compliance with local ordinances pursuant to Minn. Stat. § 115.55 (2013). This compliance inspection covers only the criteria required by Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011). A compliance inspection is an indication of the current compliance status of the system and does not guarantee the performance or longevity of this system beyond the date of inspection, as it is impossible to determine the future performance of any system. Inspect Minnesota and Midwest Soil Testing disclaim any use of this compliance inspection beyond determining SSTS compliance pursuant to Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011).

Please contact me should you have any questions.

Christopher Uebe

Brian Humpal

Brian Humpal

Minnesota Pollution Control Agency

520 Lafayette Road North St. Paul, MN 55155-4194

Compliance Inspection Form

Existing Subsurface Sewage Treatment Systems

(SSTS)

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached forms – additional local requirements may also apply.	For local tracking purposes:		
Submit completed form to Local Unit of Government (LUG) and system owner within 15 days			
System Status			
System status on date (mm/dd/yyyy): <u>11/5/2018</u>			
_ · ·	npliant – Notice of Noncompliance rade Requirements on page 3)		
Reason(s) for noncompliance (check all applicable)			
Impact on Public Health (Compliance Component #1) – Imminent threat to	o public health and safety		
Other Compliance Conditions (Compliance Component #3) – Imminent thr	eat to public health and safety		
☐ Tank Integrity (Compliance Component #2) – Failing to protect groundwat	er		
Other Compliance Conditions (Compliance Component #3) – Failing to pro	otect groundwater		
Soil Separation (Compliance Component #4) – Failing to protect groundw	ater		
Operating permit/monitoring plan requirements (Compliance Component	#5) – Noncompliant		

Property Information

Parcel	ID# or	Sec/Tw/	p/Range:
I alcel	$1D\pi 01$		privalige.

		· · · · · · · · · · · · · · · · · · ·
Property address:	8170 59 th St N, Lake Elmo, MN 55042	Reason for inspection: Property Transfer
Property owner:	Jeff & Jane Nicholls	Owner's phone: _ 651-7070-7381
or		
Owner's represent	ative:	Representative phone:
Local regulatory at	uthority: Washington County	Regulatory authority phone: _651-430-6655
Brief system descr	iption: A pre-cast septic tank and a rock trencl	h drainfield.
0	ve ne e el estis ne c	

Comments or recommendations:

Certification

wq-wwists4-31 • 1/24/12

I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.

Inspector name: Brian Humpal/Christopher Uebe				Certification number:		C5342/C9852			
Business name:	Inspect	Minnesota, M	lidw	est Soil Testing			License number:	L	2896
Inspector signatur	re:	Brian ;	Hu	mpal After	_1/1	l	Phone number:	6	51-492-7550
Necessary or	Locall	y Require	ed A	Attachment	S				
🛛 Soil boring lo	ogs	🛛 Syst	em//	As-built drawing	J		Forms per local ordina	nce	
🛛 Other inform	ation (list): Report S	Sumr	nary, Property I	nform	nation, Dise	claimer, License		
www.pca.state.mn.	us •	651-296-6300	•	800-657-3864	•	TTY 651-2	82-5332 or 800-657-3864		Available in alternative formats

2 of 10

1. Impact on Public Health – Compliance component #1 of 5

Compliance criteria:		Verification method(s):
System discharge sewage to the ground surface.	🗌 Yes 🖾 No	Searched for surface outletSearched for seeping in yard/backup in home
System discharge sewage to drain tile or surface waters.	🗌 Yes 🖾 No	 Excessive ponding in soil system/D-boxes Homeowner testimony (See Comments/Explanation
System cause sewage backup into dwelling or establishment.	🗌 Yes 🖾 No	 "Black soil" above soil dispersal system System requires "emergency" pumping Performed dye test
Any "yes" answer above indicate an Imminent Threat to Public Hea		 Performed dye test Unable to verify (See Comments/Explanation) Other methods not listed (See Comments/Explanation)

2. Tank Integrity – Compliance component #2 of 5

Compliance criteria:	
System consists of a seepage pit, cesspool, drywell, or leaching pit.	🗌 Yes 🖾 No
Seepage pits meeting 7080.2550 may be compliant if allowed in local ordinance.	
Sewage tank(s) leak below their designed operating depth.	🗌 Yes 🖾 No
If yes, which sewage tank(s) leaks:	

Any "yes" answer above indicates the system is Failing to Protect Groundwater.

Comments/Explanation:

Comments/Explanation: None of the above found.

Lowered underwater camera into tank - baffles and tank walls OK.

Verification method(s):

- Probed tank(s) bottom
 Examined construction records
 Examined Tank Integrity Form (Attach)
- Observed liquid level below operating depth
- Examined empty (pumped) tanks(s)
- Probed outside tank(s) for "black soil"
- Unable to verify (See Comments/Explanation)
- Other methods not listed (See Comments/Explanation)

3. Other Compliance Conditions – Compliance component #3 of 5

a.	Maintenance hole covers are damaged, cracked, unsecured, or appear to structurally unsound.	🗌 Yes*	🛛 No	🗌 Unknown
----	---------------------------------------------------------------------------------------------	--------	------	-----------

b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety. \Box Yes* \boxtimes No \Box Unknown *System is an imminent threat to public health and safety

Explain:

c. System is non-protective of ground water for other conditions as determined by inspector ☐ Yes* ⊠ No *System is failing to protect groundwater

Explain:

4. Soil Separation – Compliance component #4 of 5

Date of installation: 1984	Unknowr	ı	Verification method(s):		
Shoreland/Wellhead protection/Food Beverage Lodging? Compliance criteria:	🗌 Yes 🛛	No	 observations by two independent parties are sufficient unless site conditions have been altered or local requirements differ. Conducted soil observation(s) (Attach boring logs) Two previous verifications (Attach boring logs) Not applicable (Holding tank(s), no drainfield) Unable to verify (See Comments/Explanation) Other (See Comments/Explanation)		
For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment: Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock. Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment:	⊠ Yes □				
Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*					
"Experimental", "Other", or "Performance"	□ Yes □	No	Indicate depths of elevations		
systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules (7080. 2350 or 7080.2400 (Advanced Inspector License required)			A. Bottom of distribution media	See Attached Boring Log(s)	
Drainfield meets the designed vertical			B. Periodically saturated soil/bedrock		
separation distance from periodically saturated soil or bedrock.			C. System separation		
			D. Required compliance separation*		
Any "no" answer above indicates t Failing to Protect Groundwater.	he system	is	*May be reduced up to 15 percent if Ordinance.	allowed by Local	

 Is the system operated under an Operating Permit?
 □ Yes ⊠ No
 If "yes", A below is required

 Is the system required to employ a Nitrogen BMP?
 □ Yes ⊠ No
 If "yes", B below is required

BMP=Best Management Practice(s) specified in the system design

If the answer to both questions is "no", this section does not need to be completed.

Compliance criteria

5.

a.	Operating Permit number:	□ Yes □ No
	Have the Operating Permit requirements been met?	
b.	Is the required nitrogen BMP in place and properly functioning?	🗌 Yes 🗌 No

Any "no" answer indicates Noncompliance.

Upgrade Requirements (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

Inspect Minnesota & Midwest Soil Testing Subsurface Sewage Treatment System Owner/Property Information


This information will be used for the purpose of conducting an MPCA Compliance Inspection.

Date of Inspection: November 5, 2018	Time: 8:45 AM						
	7. 55042						
Property Address: 8170 59 th St N, Lake Elmo, MN	Zip: 55042						
Property Owner: Jeff & Jane Nicholls	Phone: 651-707-7381						
Tank(s)Tank(s)MaterialSoil Treatment SystemSeptic 1FiberglassRock trenchAerobicPlasticGravelless trenchLiftMetalChamber trenchHoldingConcreteSeepage bedOther:BlockMoundOtherOtherAt-grade	Other Alternative system Experimental system Cesspool system Other system						
Are the tank maintenance covers accessible? \boxtimes Yes \square No *If t							
performed through the maintenance holes. Maintenance hole cover							
the ground surface to facilitate access and proper maintenance of t	he system.						
Year house built: 1984 Year septic installed: 1984	Fank size (gals.): 1250						
	sidents in home? 2-5						
Number of bedrooms? 4 Are all floors drained by gr	ravity? Lower Pumped						
Garbage disposal? Y Whirlpool bath?	Y						
More than one system (laundry, etc.)? N							
Does this property have any footing drain tiles connected to the se	ptic system? N						
Are any buildings on this property such as garages or out-buildings connected to this system? N							
Are there any additional systems on this property serving other but	ildings? N						
Location of septic system on lot? North Side							
Location of water well on lot? South Side Is the	well a deep well? Y						
Have you ever experienced any problems with the system such as:	tree roots, sewage back-ups,						
surfacing of sewage onto the ground, septic tank overflowing, etc.	; or have any repairs been made						
to the system? N If yes, explain:							
	per: Pinky's Sewer Service						
	on a monitoring plan? N						
Have you received notices from any government agency concerning	ng this system? N						
Is your property located in a shoreland management area? N	2.21						
Do you have any additional information that should be given to the	e new owner? N						

I hereby certify that the above information is correct to the best of my knowledge. I also understand that if the system is considered "non-compliant/failing" per MPCA rules, that the inspector must by law submit a copy of this report to the local government unit within 15 days of the date of inspection completion. I also agree that unless otherwise noted in this report, that I/we are ultimately responsible for payment of all fees for all work performed relative to this inspection by Inspect Minnesota and Midwest Soil Testing.

Owner/Occupant: Jane Nicholls's Signature On File

Date: 11/5/2018

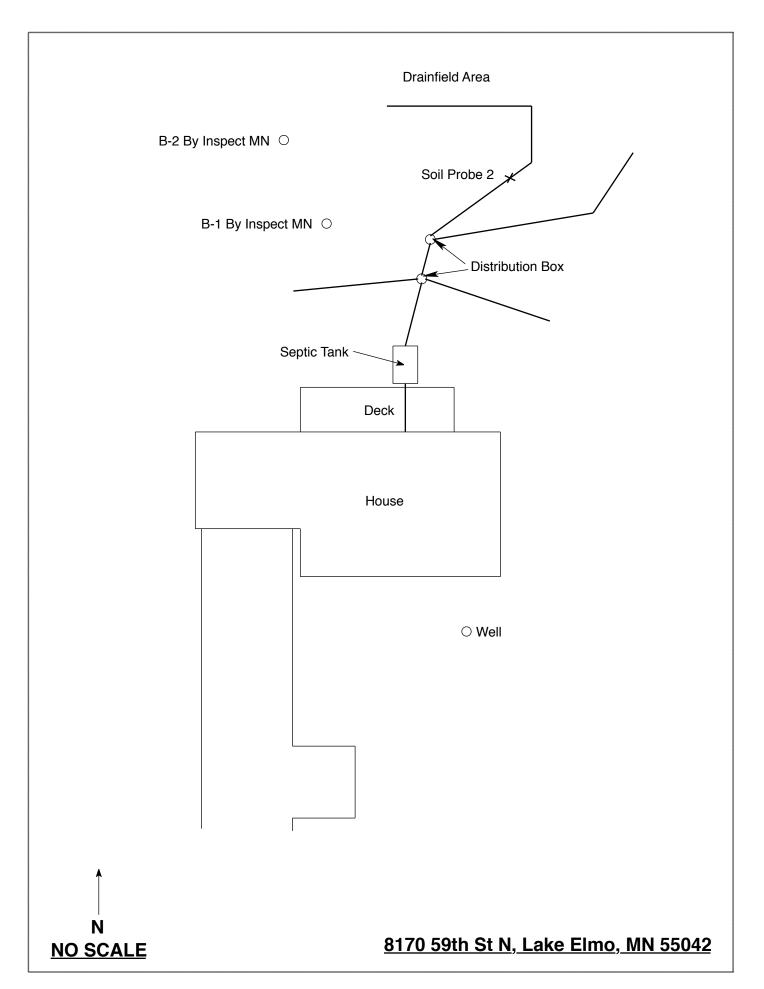

Log Of Soil Borings

Locat	ion of Project:	8170 59th St N, Lake	Elmo, MN	1550)42		
		Inspect Minnesota			Date:	11/5/18	
	Auger Used: Hand/Bucket			Classification System: USE			
Во	oring Number:	1		Bor	ring Number:	2	
Surface Elevation of Boring	-	und surface as last ribution box	Elevation Boring	Surface Same grour		nd surface as soil obe two	
Depth In Inches	<u>Soils E</u>	ncountered	Depth In Inches		<u>Soils En</u>	countered	
0-12 12-17 17-27 27-44 44-84	10YR 4/3 L 7.5YR 3 7.5YR 4/ 7.5YR 4/4 Loar	/2 Silt Loam .oamy Fine Sand /4 Clay Loam 4 Sandy Loam ny Sand With Gravel ock Fragments	0-13 13-32 32-50 50-74		10YR 4/3 7.5YR 4/4	2 Silt Loam Sandy Loam Loamy Sand	
84" De	epth To End Of B	oring Or Redox	74"	Dept	th To End Of Bo	oring Or Redox	
Same Ele	evation Of Borin	g Relative To System	Same	Elev	ation Of Boring	Relative To System	
	epth To Bottom (Separation	Of Distribution Media	-48" ≥26"		th To Bottom O Separation	f Distribution Media	
Er	nd Of Boring At:	84"		End	l Of Boring At:	74"	
	dox Present At:	None	Redox Present At: None				
Standing Wa	ater Present At:	None	Standing	y Wat	ter Present At:	None	

Bottom Of Distribution Medium At: 59 Inches Bottom Of Distribution Medium At: 48 Inches At Soil Probe 2

SL

SANDY

LOAM

TABLE

PROFILE

Soil borings are made in order to determine the type and structure of soils at various depths as well as the location of the water table, impervious strata or bedrock.

Borings are most easily made with a hand auger, however other expedients may be utilized - back hoe, post hole auger, etc.

Soils encountered at various depths should be listed as to appearance, texture and composition.

Depth at which water, bedrock or heavy clay layer is encountered should be recorded.

WATER (VICE: Sample of the soil water Soil PROFILE (Loby of myone indel les to set them) (NOTE: end depress of partouch million the LOG OF SOIL BORINGS

BORING NO. I		BORING NO. 2		BORING NO. 3		BORING NO. 4	
DEPTH IN FEET	SOIL DESCRIPTION	DEPTH IN FEET	SOIL DESCRIPTION	DEPTH IN FEET	SOIL DESCRIPTION	DEPTH IN FEET	SOIL DESCRIPTION
0	Black.	0	Glas G	0	Black,	0	altheod Fyrs
:1/2	top soul	1/2	Log sout	1/2	typ soul	1/2	-Dell'
 1/2	Sundy-	 1/2	Sundy	 1/2	Sundy day	 1/2	sandy day
2		2	· march rolans	2	Barkscher	2	Sandday
21/2	For and Charg	21/2	+ grand	21/2	clay kigh	21/2	lay Right
31/2	clay (ligh	1) 31/2	Day (ligh	JB1/2		31/2	
4] / ~	4		4		4	
41/2		41/2		41/2		41/2	
5		5		5		5	
51/2		51/2		51/2 6		51/2 6	
6		6		61/2		61/2	
61/2	10	61/2	a	7	(\mathcal{C})	7	$\left(\circ \right)$
71/2	- (n)	71/2		71/2	1 Contract	71/2	
8	-	8	-	8		8	
81/2	-	81/2	1	81/2		81/2	
9	-1	9		9		9	

DISCLAIMER

Brian L. Humpal, Inc. dba. Inspect Minnesota, Midwest Soil Testing

Relative to Subsurface Sewage Treatment System (SSTS) Compliance Inspections

- 1. This inspection/report is being performed for only the seller/owner of the property on which the SSTS is located. In such case that another party is paying for the inspection, the contract is between only said party and Brian L. Humpal, Inc.; there is no contract between Brian L. Humpal, Inc. and any other party unless otherwise noted.
- 3. Brian L. Humpal, Inc. has not been retained to warranty, guarantee, or certify the proper functioning of the SSTS for any period of time beyond the date of inspection or into the future. Because of the numerous factors (usage, maintenance, soil characteristics, previous failures, etc.) which may affect the proper operation of an SSTS, as well as the inability of Brian L. Humpal, Inc. to supervise or monitor the use or maintenance of the SSTS, the report shall not be construed as a warranty by Brian L. Humpal, Inc. that the SSTS will function properly for any particular party for any period of time.
- 4. Brian L. Humpal, Inc. is unable to verify the frequency and/or, quality of prior or future maintenance of the SSTS. Maintenance of the tank(s) must be performed through the tanks maintenance hole. The removal of solids from any location other than the maintenance hole is not a compliant method of maintenance. It is strongly recommended that maintenance covers be made accessible to the ground surface to facilitate proper maintenance.
- 5. Minimum Compliance Inspection requirements relative to this inspection and this report include <u>only</u> verification that the SSTS has tank(s) (septic tanks, lift tanks, dosing tanks, stilling tanks, etc.) which are watertight below the designed operating depth, the required separation between the bottom of the subsurface soil distribution medium and seasonally saturated soils, no back-ups of sewage into the dwelling, no discharge of sewage/effluent to the ground surface or surface waters, and no imminent safety hazards. Brian L. Humpal, Inc. does not inspect plumbing or pumps prior to the first SSTS component as these are plumbing components. The performance of exterior pumps and associated components are not inspected as they are considered to be maintenance items. Additionally, no indications relative to compliance with electrical code requirements have been made. It is recommended that any other applicable plumbing, electrical, housing, etc. inspections be performed by a qualified inspection business. Sewage back-up verification is limited to observing the floor drain area and/or the information supplied by the last occupants of the building prior to inspection. Brian L. Humpal, Inc. cannot guarantee that the information given to them by the last occupants of the building prior to inspection relative to back-ups is accurate.
- 4. Certification of this SSTS does not warranty future use beyond the date of the inspection. Any SSTS, old or new, can become hydraulically overloaded or discharge sewage/effluent to the ground surface as a result of more people moving into the house than were previously occupying the house, improper maintenance, heavy usage, leaking plumbing fixtures, groundwater infiltration, tree roots, freezing conditions, surface drainage problems, poor initial design, poor construction practices, or unsuitable materials used in constructing the system; the system can also simply stop working because of its age. An SSTS that has been properly designed and installed, properly maintained, and used in the manner for which the system was designed can be expected to provide service for twenty to twenty-five years on average. Some parts of the SSTS such as alarms, switches, pumps, filters, etc. will most likely have to be repaired or replaced over the lifetime of the system.
- 5. A Compliance Inspection is not meant to be a test or inspection for longevity of the system; a Compliance Inspection is strictly for the purpose of determining if the SSTS is protective of public health and safety, as well as the groundwater at the date and time the inspection was performed. This inspection is not intended to determine if the SSTS was originally designed or installed to past or present MPCA or other Local Government Unit code requirements. This inspection is not intended to determine if the SSTS was designed and/or installed to support the anticipated flow from the building as the use of the building may have changed since the design and construction of the SSTS due to the addition of bedrooms, occupants, etc. In addition, this inspection is not intended to determine the quality of the original SSTS design, the quality of the construction practices used while installing the SSTS, or the quality of the materials used in constructing the SSTS.
- 6. Brian L. Humpal, Inc. cannot guarantee the performance of SSTS products/components such as: gravelless pipe, chamber trenches, effluent filters, tanks, sewage pre-treatment components, piping, etc. Products such as gravelless pipe are no longer approved for installation in the State of Minnesota and may have a significantly reduced performance and/or life expectancy.
- 7. WINTER WORK: By accepting this report, it is understood that inspections conducted during winter months (approximately November 1st through April 1st) are more difficult to perform because of possible snow cover and/or ground frost. SSTS components such as tanks, maintenance covers, tank inspection pipes, subsurface distribution medium inspection pipes, and soil treatment areas are more difficult or impossible to locate due to snow cover and/or ground frost. In addition, soil borings are more difficult to perform due to snow cover and/or ground frost. Brian L. Humpal, Inc. will attempt to use the same level of standards when performing work during winter periods as when performing work during non-winter periods. However, the recipient of this report understands that because of the aforementioned considerations, the same level of standards may not be possible.
- 8. By accepting this report, the client understands that Brian L. Humpal, Inc. will not be responsible for any monetary damages exceeding the fee for the services provided.

10 of 10

Subsurface Sewage Treatment Systems Non-transferable Business License

Inspect Minnesota, Midwest Soil Testing

License # L2896

License Expires: 12/22/2018

Issued: 10/10/2017

Specialty Area(s):

Installer Maintainer Service Provider Advanced Designer Advanced Inspector

Designated Certified Individual(s):

Cert #	Name	Certification Expires:
C9633	Anthony P Scully	7/28/2018
	Installer, Designer (Conditional)
C5342	Brian L Humpal	10/15/2020
	Installer, Maintainer, Serv Prov	, Adv Designer, Adv Inspector
C9852	Christopher R Uebe	3/4/2018
	Designer, Inspector	

MINNESOTA POLLUTION CONTROL AGENCY

520 Lafayette Road North St. Paul, Minnesota 55155-4194

Charles K Thompson, Supervisor Certification & Training Unit