

SSTS MAINTENANCE REPORT


System Location			
Address 9340 north shore tr		Telephone Number (651) 464-5832	
City Forest Lake	State mn	ZIP 55025	Property ID No./GEO Code
Owner Jo Anne House		Pumping Date Nov 13, 2018	
Contractor			
Maintainer Row Sewer Service	MPCA License No. L3309		Telephone Number (651) 464-5505

What was done to the system?
<input checked="" type="checkbox"/> Tank(s) Pumped <input type="checkbox"/> Sludge and scum measured. Do tanks need to be pumped? <input type="checkbox"/> Yes <input type="checkbox"/> No (If no provide measurements below)

Report Liquid Capacity in Gallons
Tank 1: <u>1,250</u> <input checked="" type="checkbox"/> Pumped Tank 2: <u>1,000</u> <input type="checkbox"/> Pumped Tank 3: _____ <input type="checkbox"/> Pumped Tank 4: _____ <input type="checkbox"/> Pumped Total Gallons Pumped: <u>1,250</u>


Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

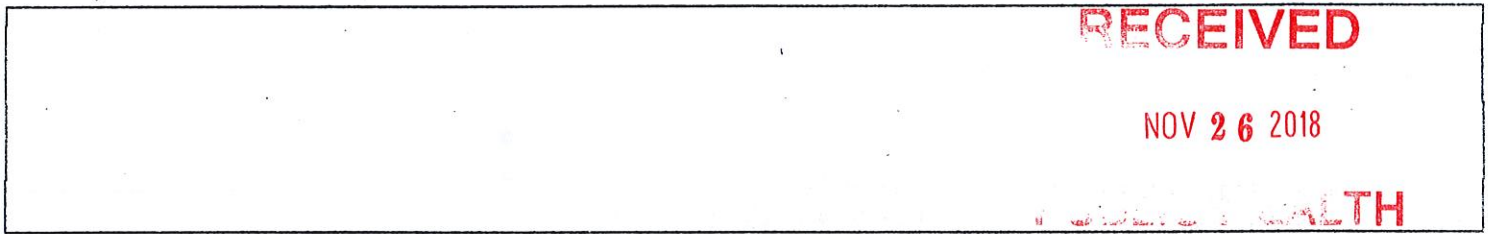

***Tank Measurements Use Only If Tank(s) Were NOT Pumped**

Tank Length _____ in. Tank Width _____ in. Tank Depth _____ in. = Tank Volume (cubic inches) _____
 Tank Radius _____ in. Tank Radius _____ in. 3.14 = Tank Volume (cubic inches) _____
 Tank Volume (cu. in.) _____ / 231.01 = Liquid Capacity _____ Gallons / Tank Depth _____ in. = Gallons/Inch _____
 Sludge Level _____ in. Gallons Per Inch _____ = Sludge Volume _____ Gallons
 Scum Level _____ in. Gallons Per Inch _____ = Scum Volume _____ Gallons
 Sludge Volume _____ + Scum Volume _____ = Total Sludge and Scum Volume _____ Gallons
 Total Sludge and Scum Volume _____ / Liquid Capacity _____ = Percent Sludge and Scum in Tank _____ %

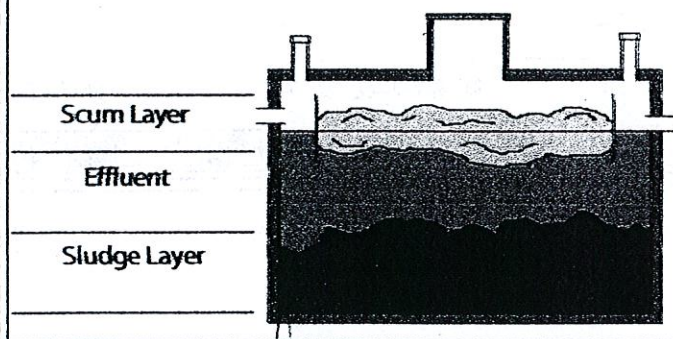

*Tanks must be pumped if either of the following conditions exist:
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Tank Depth measured from invert of outlet pipe to bottom of tank

Signature [Handwritten Signature] Date Nov 13, 2018 Reset Form

SSTS MAINTENANCE REPORT

System Location			
Address	9340 north shore tr	Telephone Number	(651) 464-5832
City	Forest Lake	State mn ZIP	55025 Property ID No./GEO Code
Owner	Jo Anne House	Pumping Date	Nov 13, 2018
Contractor			
Maintainer	Row Sewer Service	MPCA License No.	L3309 Telephone Number (651) 464-5505

What was done to the system?
<input checked="" type="checkbox"/> Tank(s) Pumped <input type="checkbox"/> Sludge and scum measured. Do tanks need to be pumped? <input type="checkbox"/> Yes <input type="checkbox"/> No (if no provide measurements below)

Report Liquid Capacity in Gallons
Tank 1: <u>1,250</u> <input checked="" type="checkbox"/> Pumped Tank 2: <u>1,000</u> <input type="checkbox"/> Pumped Tank 3: _____ <input type="checkbox"/> Pumped Tank 4: _____ <input type="checkbox"/> Pumped Total Gallons Pumped: <u>1,250</u>

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

Tank Measurements Use Only If Tank(s) Were NOT Pumped

Tank Length _____ in. Tank Width _____ in. Tank Depth _____ in. = Tank Volume (cubic inches) _____

Tank Radius _____ in. Tank Radius _____ in. 3.14 = Tank Volume (cubic inches) _____


Tank Volume (cu. in.) _____ / 231.01 = Liquid Capacity _____ Gallons / Tank Depth _____ in. = Gallons/Inch _____

Sludge Level _____ in. Gallons Per Inch _____ = Sludge Volume _____ Gallons

Scum Level _____ in. Gallons Per Inch _____ = Scum Volume _____ Gallons

Sludge Volume _____ + Scum Volume _____ = Total Sludge and Scum Volume _____ Gallons

Total Sludge and Scum Volume _____ / Liquid Capacity _____ = Percent Sludge and Scum in Tank _____ %

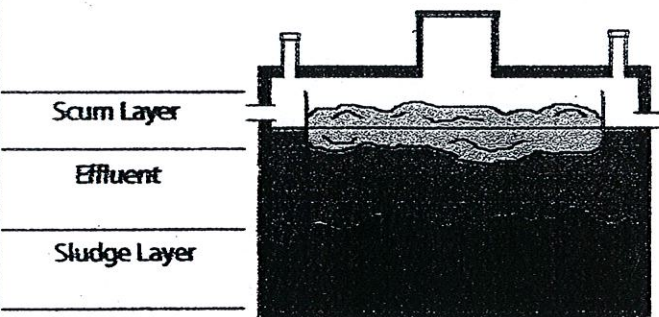

Tank Depth measured from invert of outlet pipe to bottom of tank

*Tanks must be pumped if either of the following conditions exist:
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Signature [Signature] Date Nov 13, 2018 Reset Form