


## SSTS MAINTENANCE REPORT



System Location	
Address <b>483 Juliep Ave. N</b>	Telephone Number
City <b>Lake Elmo</b> State <b>MN</b> ZIP <b>55042</b>	Property ID No./GEO Code
Owner <b>Craig Rossow</b>	Pumping Date <b>10/12/15</b>
Contractor	
Maintainer <b>MEYER SEWER</b>	MPCA License No. <b>915</b> Telephone Number <b>651-459-016</b>

**What was done to the system?**

Tank(s) Pumped **2**

Sludge and scum measured.  
Do tanks need to be pumped?

Yes  No (If no provide measurements below)

**Report Liquid Capacity in Gallons**

Tank 1: **1500**  Pumped Tank 2: **1000**  Pumped

Tank 3: \_\_\_\_\_  Pumped Tank 4: \_\_\_\_\_  Pumped

Total Gallons Pumped: **2500**

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

RECEIVED

JAN 06 2016

PUBLIC HEALTH

**\*Tank Measurements-Use Only If Tank(s) Were NOT Pumped**

Tank Length \_\_\_\_\_ in.  Tank Width \_\_\_\_\_ in.  Tank Depth \_\_\_\_\_ in. = Tank Volume (cubic inches) \_\_\_\_\_

Tank Radius \_\_\_\_\_ in.  Tank Radius \_\_\_\_\_ in.  **3.14** = Tank Volume (cubic inches) \_\_\_\_\_


Tank Volume (cu. in.) \_\_\_\_\_ / **231.01** = Liquid Capacity \_\_\_\_\_ Gallons / Tank Depth \_\_\_\_\_ in. = Gallons/Inch \_\_\_\_\_

Sludge Level \_\_\_\_\_ in.  Gallons Per Inch \_\_\_\_\_ = Sludge Volume \_\_\_\_\_ Gallons

Scum Level \_\_\_\_\_ in.  Gallons Per Inch \_\_\_\_\_ = Scum Volume \_\_\_\_\_ Gallons

Sludge Volume \_\_\_\_\_ + Scum Volume \_\_\_\_\_ = Total Sludge and Scum Volume \_\_\_\_\_ Gallons

Total Sludge and Scum Volume \_\_\_\_\_ / Liquid Capacity \_\_\_\_\_ = Percent Sludge and Scum in Tank \_\_\_\_\_ %

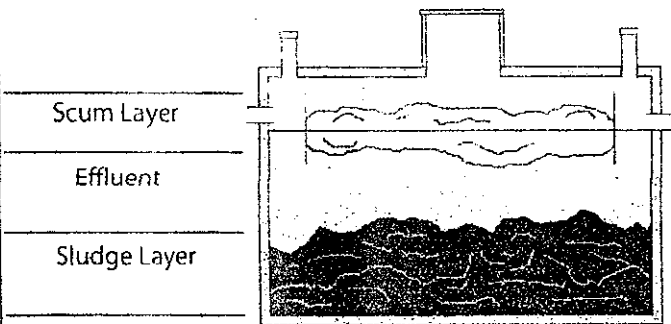

Tank Depth measured from invert of outlet pipe to bottom of tank

\*Tanks must be pumped if either of the following conditions exist:  
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or  
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

*[Handwritten Signature]*

**10/12/15**