

## SSTS MAINTENANCE REPORT

<b>System Location</b>		
Address	8320 Lake Jane Trail N	Telephone Number
City	Lake Elmo	State MN ZIP 55042 Property ID No./GEO Code
Owner	Pat Jennings	Pumping Date 10/9/15
<b>Contractor</b>		
Maintainer	MEYER SEWER	MPCA License No. 915 Telephone Number 651-459-016

<b>What was done to the system?</b>
<input checked="" type="checkbox"/> Tank(s) Pumped / <input type="checkbox"/> Sludge and scum measured. Do tanks need to be pumped? <input type="checkbox"/> Yes <input type="checkbox"/> No (If no provide measurements below)

<b>Report Liquid Capacity in Gallons</b>			
Tank 1:	1500	<input checked="" type="checkbox"/> Pumped	Tank 2: _____ <input type="checkbox"/> Pumped
Tank 3:	_____	<input type="checkbox"/> Pumped	Tank 4: _____ <input type="checkbox"/> Pumped
Total Gallons Pumped:		1500	

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

RECEIVED

JAN 06 / 2016

PUBLIC HEALTH

**\*Tank Measurements-Use Only If Tank(s) Were NOT Pumped**

Tank Length \_\_\_\_\_ in.  Tank Width \_\_\_\_\_ in.  Tank Depth \_\_\_\_\_ in. = Tank Volume (cubic inches) \_\_\_\_\_

Tank Radius \_\_\_\_\_ in.  Tank Radius \_\_\_\_\_ in.  3.14 = Tank Volume (cubic inches) \_\_\_\_\_


Tank Volume (cu. in.) \_\_\_\_\_ / 231.01 = Liquid Capacity \_\_\_\_\_ Gallons / Tank Depth \_\_\_\_\_ in. = Gallons/Inch \_\_\_\_\_

Sludge Level \_\_\_\_\_ in.  Gallons Per Inch \_\_\_\_\_ = Sludge Volume \_\_\_\_\_ Gallons

Scum Level \_\_\_\_\_ in.  Gallons Per Inch \_\_\_\_\_ = Scum Volume \_\_\_\_\_ Gallons

Sludge Volume \_\_\_\_\_ + Scum Volume \_\_\_\_\_ = Total Sludge and Scum Volume \_\_\_\_\_ Gallons

Total Sludge and Scum Volume \_\_\_\_\_ / Liquid Capacity \_\_\_\_\_ = Percent Sludge and Scum in Tank \_\_\_\_\_ %

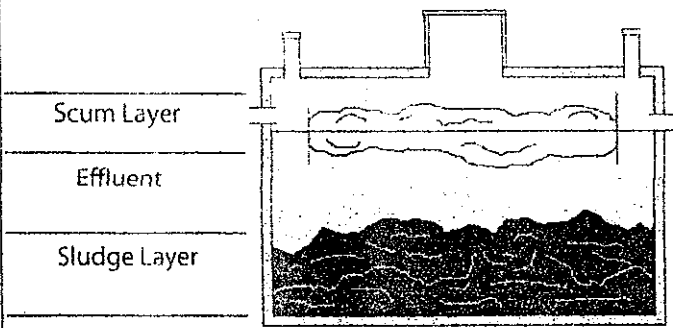

Tank Depth measured from invert of outlet pipe to bottom of tank

\*Tanks must be pumped if either of the following conditions exist:  
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or  
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.