

SSTS MAINTENANCE REPORT



System Location		
Address	14858 97th St. N	Telephone Number
City	Stillwater	State MN ZIP 55082 Property ID No./GEO Code
Owner	Ted NESSE	Pumping Date 10/23/15
Contractor		
Maintainer	MEYER SEWER	MPCA License No. 915 Telephone Number 651-459-016

What was done to the system?

Tank(s) Pumped /

Sludge and scum measured.

Do tanks need to be pumped?

Yes No (If no provide measurements below)

Report Liquid Capacity in Gallons

Tank 1: 1500 Pumped Tank 2: Pumped

Tank 3: Pumped Tank 4: Pumped

Total Gallons Pumped: 1500

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection

RECEIVED

JAN 07 2016

PUBLIC HEALTH

***Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length _____ in. Tank Width _____ in. Tank Depth _____ in. = Tank Volume (cubic inches) _____

Tank Radius _____ in. Tank Radius _____ in. 3.14 = Tank Volume (cubic inches) _____


Tank Volume (cu. in.) _____ / 231.01 = Liquid Capacity _____ Gallons / Tank Depth _____ in. = Gallons/Inch _____

Sludge Level _____ in. Gallons Per Inch _____ = Sludge Volume _____ Gallons

Scum Level _____ in. Gallons Per Inch _____ = Scum Volume _____ Gallons

Sludge Volume _____ + Scum Volume _____ = Total Sludge and Scum Volume _____ Gallons

Total Sludge and Scum Volume _____ / Liquid Capacity _____ = Percent Sludge and Scum in Tank _____ %

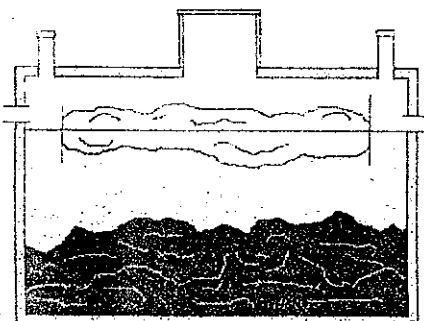

Tank Depth measured from invert of outlet pipe to bottom of tank

*Tanks must be pumped if either of the following conditions exist:
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Handwritten signature

10/23/15