

## SSTS MAINTENANCE REPORT

System Location		
Address	<u>11695 Lockridge Ave N</u>	Telephone Number
City	<u>St. Wuster</u>	State <u>MA</u> ZIP <u>65082</u> Property ID No./GEO Code
Owner	<u>Sarah Gordon</u>	Pumping Date <u>10/23/15</u>
Contractor		
Maintainer	<u>MEYER SEWER</u>	MPCA License No. <u>915</u> Telephone Number <u>651-459-0116</u>

**What was done to the system?**

Tank(s) Pumped

Sludge and scum measured.

Do tanks need to be pumped?

Yes  No (If no provide measurements below)

**Report Liquid Capacity in Gallons**

Tank 1: 1200  Pumped Tank 2:           Pumped

Tank 3:           Pumped Tank 4:           Pumped

Total Gallons Pumped: 1200

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspector

RECEIVED

JAN 07 2016

PUBLIC HEALTH

**\*Tank Measurements-Use Only If Tank(s) Were NOT Pumped**

Tank Length          in.  Tank Width          in.  Tank Depth          in. = Tank Volume (cubic inches)         

Tank Radius          in.  Tank Radius          in.  3.14 = Tank Volume (cubic inches)         


Tank Volume (cu. in.)          / 231.01 = Liquid Capacity          Gallons / Tank Depth          in. = Gallons/Inch         

Sludge Level          in.  Gallons Per Inch          = Sludge Volume          Gallons

Scum Level          in.  Gallons Per Inch          = Scum Volume          Gallons

Sludge Volume          + Scum Volume          = Total Sludge and Scum Volume          Gallons

Total Sludge and Scum Volume          / Liquid Capacity          = Percent Sludge and Scum in Tank          %

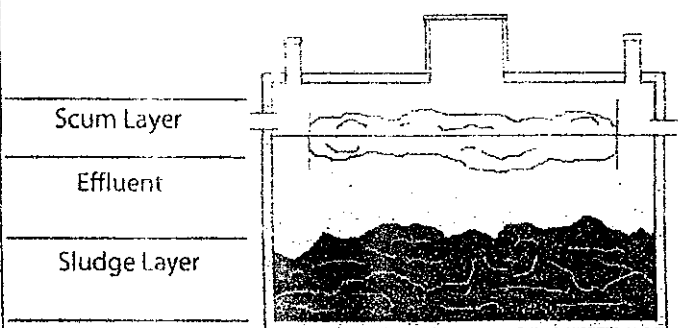

\*Tanks must be pumped if either of the following conditions exist:

1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Tank Depth measured from invert of outlet pipe to bottom of tank