

SSTS MAINTENANCE REPORT ✓


System Location			
Address	6555 Warner Rd	Telephone Number	
City	Pine Springs	State	MN ZIP 55115
Owner	Jerry Carpenter	Pumping Date	9/28/15
Contractor			
Maintainer	MEYER SEWER	MPCA License No.	915
		Telephone Number	651-459-0162

What was done to the system?
<input checked="" type="checkbox"/> Tank(s) Pumped
<input type="checkbox"/> Sludge and scum measured.
Do tanks need to be pumped?
<input type="checkbox"/> Yes <input type="checkbox"/> No (If no provide measurements below)

Report Liquid Capacity in Gallons			
Tank 1:	10000	<input checked="" type="checkbox"/> Pumped	Tank 2: <input type="checkbox"/> Pumped
Tank 3:		<input type="checkbox"/> Pumped	Tank 4: <input type="checkbox"/> Pumped
Total Gallons Pumped:	10000		

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

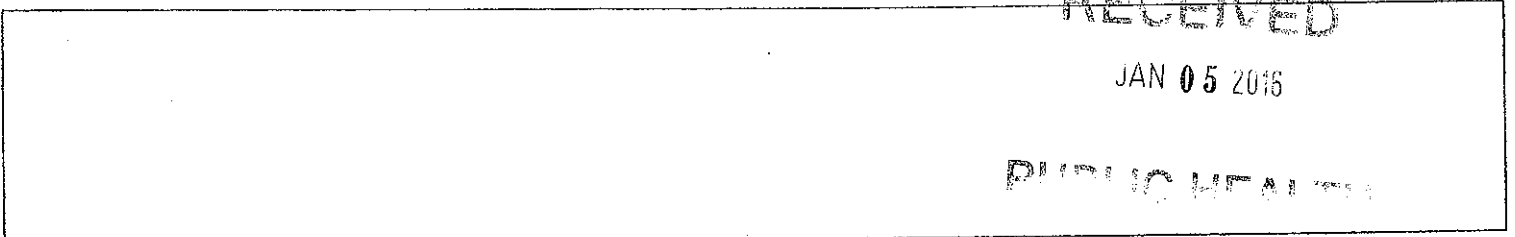

***Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length _____ in. Tank Width _____ in. Tank Depth _____ in. = Tank Volume (cubic inches) _____

Tank Radius _____ in. Tank Radius _____ in. 3.14 = Tank Volume (cubic inches) _____


Tank Volume (cu. in.) _____ / 231.01 = Liquid Capacity _____ Gallons / Tank Depth _____ in. = Gallons/Inch _____

Sludge Level _____ in. Gallons Per Inch _____ = Sludge Volume _____ Gallons

Scum Level _____ in. Gallons Per Inch _____ = Scum Volume _____ Gallons

Sludge Volume _____ + Scum Volume _____ = Total Sludge and Scum Volume _____ Gallons

Total Sludge and Scum Volume _____ / Liquid Capacity _____ = Percent Sludge and Scum in Tank _____ %

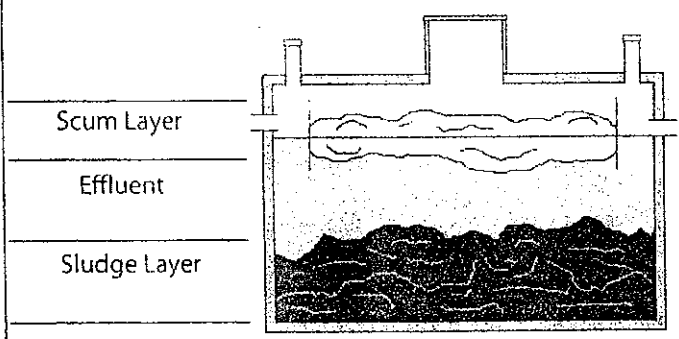

Tank Depth measured from invert of outlet pipe to bottom of tank

- *Tanks must be pumped if either of the following conditions exist:
1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.