

## SSTS MAINTENANCE REPORT

<b>System Location</b>		
Address <u>13148 20th St. N</u>	Telephone Number	
City <u>Stillwater</u>	State <u>MN</u> ZIP <u>55082</u>	Property ID No./GEO Code
Owner <u>Judy Hansen</u>	Pumping Date <u>12/14/15</u>	
<b>Contractor</b>		
Maintainer <u>MEYER SEWER</u>	MPCA License No. <u>915</u>	Telephone Number <u>651-457-0162</u>

**What was done to the system?**

Tank(s) Pumped 1

Sludge and scum measured.

Do tanks need to be pumped?

Yes  No (If no provide measurements below)

**Report Liquid Capacity in Gallons**

Tank 1: 1000 Pumped Tank 2:  Pumped

Tank 3:  Pumped Tank 4:  Pumped

Total Gallons Pumped: 1000

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection

**\*Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length      in.  Tank Width      in.  Tank Depth      in. = Tank Volume (cubic inches)     

Tank Radius      in.  Tank Radius      in.  3.14 = Tank Volume (cubic inches)     


Tank Volume: (cu. in.)      / 231.01 = Liquid Capacity      Gallons / Tank Depth      in. = Gallons/Inch     

Sludge Level      in.  Gallons Per Inch      = Sludge Volume      Gallons

Scum Level      in.  Gallons Per Inch      = Scum Volume      Gallons

Sludge Volume      + Scum Volume      = Total Sludge and Scum Volume      Gallons

Total Sludge and Scum Volume      / Liquid Capacity      = Percent Sludge and Scum in Tank      %

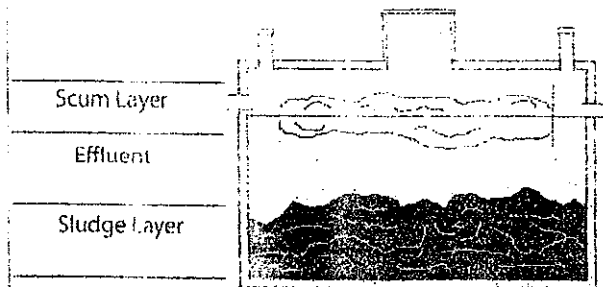

Tank Depth measured from invert of outlet pipe to bottom of tank

Tanks must be pumped if either of the following conditions exist:

1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.