

## SSTS MAINTENANCE REPORT

System Location	
Address <u>2811 Norcrest Ave N</u>	Telephone Number
City <u>Stillwater</u>	State <u>MN</u> ZIP <u>55082</u> Property ID No./GEO Code
Owner <u>Tom Hornberger</u>	Pumping Date <u>10/27/15</u>
Contractor	
Maintainer <u>MEYER SEWER</u>	MPCA License No. <u>915</u> Telephone Number <u>651-459-016</u>

**What was done to the system?**

Tank(s) Pumped

Sludge and scum measured.

Do tanks need to be pumped?

Yes  No (If no provide measurements below)

**Report Liquid Capacity in Gallons**

Tank 1: 1200  Pumped Tank 2:  Pumped

Tank 3:  Pumped Tank 4:  Pumped

Total Gallons Pumped: 1200

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection

JAN 07 2016

PUBLIC HEALTH

**\*Tank Measurements-Use Only If Tank(s) Were NOT Pumped**

Tank Length        in.  Tank Width        in.  Tank Depth        in. = Tank Volume (cubic inches)       

Tank Radius        in.  Tank Radius        in.  3.14 = Tank Volume (cubic inches)       


Tank Volume (cu. in.)        / 231.01 = Liquid Capacity        Gallons / Tank Depth        in. = Gallons/inch       

Sludge Level        in.  Gallons Per Inch        = Sludge Volume        Gallons

Scum Level        in.  Gallons Per Inch        = Scum Volume        Gallons

Sludge Volume        + Scum Volume        = Total Sludge and Scum Volume        Gallons

Total Sludge and Scum Volume        / Liquid Capacity        = Percent Sludge and Scum in Tank        %

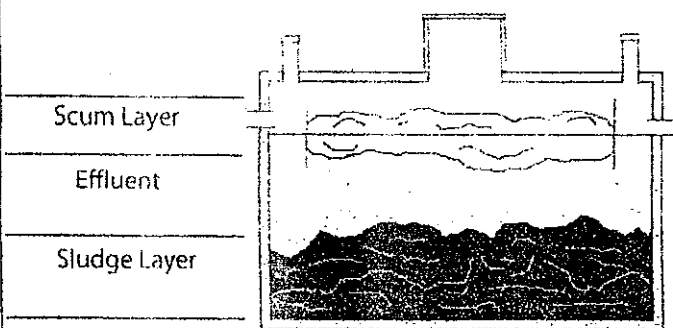

Tank Depth measured from invert of outlet pipe to bottom of tank

\*Tanks must be pumped if either of the following conditions exist:  
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or  
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.