

## SSTS MAINTENANCE REPORT


| System Location |                         |                  |   |
|-----------------|-------------------------|------------------|---|
| Address         | <u>64 Glen Eden Rd</u>  | Telephone Number |   |
| City            | <u>Deerwood</u>         | State            | <u>MN</u> ZIP <u>55110</u> Property ID No./GEO Code |
| Owner           | <u>Doreen Mikkelsen</u> | Pumping Date     | <u>9/29/15</u>                                      |
| Contractor      |                         |                  |   |
| Maintainer      | <u>MEYER SEWER</u>      | MPCA License No. | <u>915</u> Telephone Number <u>651-459-0162</u>     |

| What was done to the system?   |
|--|
| <input checked="" type="checkbox"/> Tank(s) Pumped<br><input type="checkbox"/> Sludge and scum measured.<br>Do tanks need to be pumped?<br><input type="checkbox"/> Yes <input type="checkbox"/> No (If no provide measurements below) |

| Report Liquid Capacity in Gallons   |
|---|
| Tank 1: <u>1000</u> <input checked="" type="checkbox"/> Pumped Tank 2: <u>1000</u> <input checked="" type="checkbox"/> Pumped<br>Tank 3: _____ <input type="checkbox"/> Pumped Tank 4: _____ <input type="checkbox"/> Pumped<br>Total Gallons Pumped: <u>2000</u> |

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

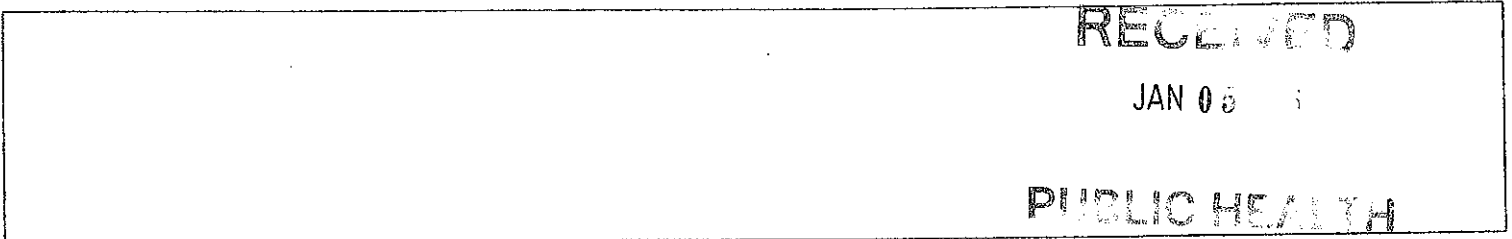

**\*Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length \_\_\_\_\_ in.  Tank Width \_\_\_\_\_ in.  Tank Depth \_\_\_\_\_ in. = Tank Volume (cubic inches) \_\_\_\_\_

Tank Radius \_\_\_\_\_ in.  Tank Radius \_\_\_\_\_ in.  3.14 = Tank Volume (cubic inches) \_\_\_\_\_


Tank Volume (cu. in.) \_\_\_\_\_ / 231.01 = Liquid Capacity \_\_\_\_\_ Gallons / Tank Depth \_\_\_\_\_ in. = Gallons/Inch \_\_\_\_\_

Sludge Level \_\_\_\_\_ in.  Gallons Per Inch \_\_\_\_\_ = Sludge Volume \_\_\_\_\_ Gallons

Scum Level \_\_\_\_\_ in.  Gallons Per Inch \_\_\_\_\_ = Scum Volume \_\_\_\_\_ Gallons

Sludge Volume \_\_\_\_\_ + Scum Volume \_\_\_\_\_ = Total Sludge and Scum Volume \_\_\_\_\_ Gallons

Total Sludge and Scum Volume \_\_\_\_\_ / Liquid Capacity \_\_\_\_\_ = Percent Sludge and Scum in Tank \_\_\_\_\_ %

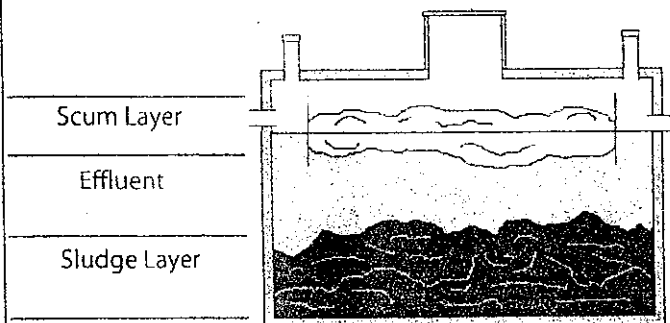

Tank Depth measured from invert of outlet pipe to bottom of tank

\*Tanks must be pumped if either of the following conditions exist:  
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or  
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.