

## SSTS MAINTENANCE REPORT

System Location			
Address <u>5210 Jamece Blvd N</u>	Telephone Number _____		
City <u>Lake Elmo</u>	State <u>MN</u>	ZIP <u>55042</u>	Property ID No./GEO Code _____
Owner <u>Jim Sotersmoen</u>	Pumping Date <u>10/16/15</u>		
Contractor			
Maintainer <u>MEYER SEWER</u>	MPCA License No. <u>915</u>	Telephone Number <u>651-459-016</u>	

What was done to the system?
<input checked="" type="checkbox"/> Tank(s) Pumped <input type="checkbox"/> Sludge and scum measured. Do tanks need to be pumped? <input type="checkbox"/> Yes <input type="checkbox"/> No (If no provide measurements below)


Report Liquid Capacity in Gallons
Tank 1: <u>1000</u> <input checked="" type="checkbox"/> Pumped    Tank 2: <u>1000</u> <input checked="" type="checkbox"/> Pumped Tank 3: _____ <input type="checkbox"/> Pumped    Tank 4: _____ <input type="checkbox"/> Pumped Total Gallons Pumped: <u>2000</u>

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

**\*Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length _____ in.	<input checked="" type="checkbox"/>	Tank Width _____ in.	<input checked="" type="checkbox"/>	Tank Depth _____ in.	=	Tank Volume (cubic inches) _____	
Tank Radius _____ in.	<input checked="" type="checkbox"/>	Tank Radius _____ in.	<input checked="" type="checkbox"/>	<b>3.14</b>	=	Tank Volume (cubic inches) _____	
Tank Volume (cu. in.) _____	/	<b>231.01</b>	=	Liquid Capacity _____ Gallons /	Tank Depth _____ in.	=	Gallons/Inch _____
Sludge Level _____ in.	<input checked="" type="checkbox"/>	Gallons Per Inch _____	=	Sludge Volume _____	Gallons		
Scum Level _____ in.	<input checked="" type="checkbox"/>	Gallons Per Inch _____	=	Scum Volume _____	Gallons		
Sludge Volume _____	+	Scum Volume _____	=	Total Sludge and Scum Volume _____	Gallons		
Total Sludge and Scum Volume _____	/	Liquid Capacity _____	=	Percent Sludge and Scum in Tank _____	%		

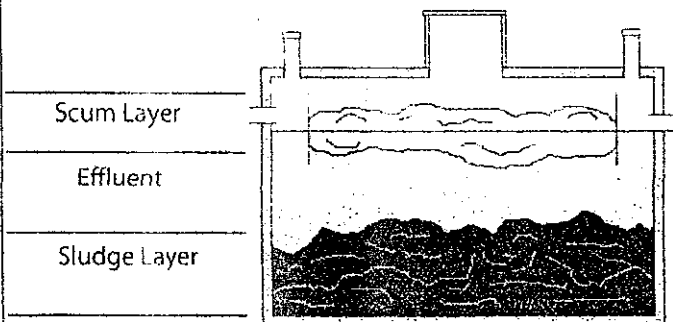

Tank Depth measured from invert of outlet pipe to bottom of tank

\*Tanks must be pumped if either of the following conditions exist:  
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or  
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.