Midwest Sewer Services

P.O. Box 10853 White Bear Lake, MN 55110 651-492-7550/Brian@Midwestsoiltesting.com

Brian Humpal

MPCA Licensed Advanced Inspector

SUBSURFACE SEWAGE TREATMENT SYSTEM (SSTS) COMPLIANCE REPORT

Date: July 14, 2020 Time: 1:15 PM Owner: Sharon Mattren

Inspection Address: 9203 55th St N, Lake Elmo, MN 55042

REPORT SUMMARY

I have performed an "MPCA Compliance Inspection" on this system and have reviewed the original design/permit records on file at Washington County. This very old system (installed in 1987) consists of a pre-cast septic tank and a rock trench drainfield. It should be noted that the average life expectancy of a septic system is approximately 30 years. This house is presently vacant.

Predicated on my inspection of the system and my review of the original design/permit records, it is my opinion that this system <u>presently meets</u> MPCA minimum compliance inspection requirements.

Midwest Sewer Services have been hired to perform a compliance inspection of this SSTS for compliance with local ordinances pursuant to Minn. Stat. § 115.55 (2013). This compliance inspection covers only the criteria required by Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011). A compliance inspection is an indication of the current compliance status of the system and does not guarantee the performance or longevity of this system beyond the date of inspection, as it is impossible to determine the future performance of any system. Midwest Sewer Services disclaim any use of this compliance inspection beyond determining SSTS compliance pursuant to Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011).

Please contact me should you have any questions.

Christopher Uebe

Brian Humpal

Brian Humpal



Compliance Inspection Form

Existing Subsurface Sewage Treatment Systems (SSTS)

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached forms – additional local requirements may also apply.	For local tracking purposes:					
Submit completed form to Local Unit of Government (LUG) and system owner within 15 days						
System Status						
System status on date (mm/dd/yyyy):7/24/2020						
 ✓ Compliant – Certificate of Compliance (Valid for 3 years from report date, unless shorter time frame outlined in Local Ordinance.) ✓ Noncompliant – Notice of Noncompliance (See Upgrade Requirements on page 3) 						
Reason(s) for noncompliance (check all applicable) Impact on Public Health (Compliance Component #1) – Imminent threat to Other Compliance Conditions (Compliance Component #3) – Imminent threat the Tank Integrity (Compliance Component #2) – Failing to protect groundwate Other Compliance Conditions (Compliance Component #3) – Failing to protect groundwate Soil Separation (Compliance Component #4) – Failing to protect groundwate Operating permit/monitoring plan requirements (Compliance Component #4)	reat to public health and safety ter otect groundwater rater					
Property Information Parcel ID# or Sec/Twp/Rang	ge:					
th	or inspection: Property Transfer					
Property owner: Sharon Mattren Owner's por	phone: 612-583-1720					
Owner's representative: Represer	ntative phone:					
Local regulatory authority: Washington County Regulator	ry authority phone: 651-430-6655					
Brief system description: A pre-cast septic tank and a rock trench drainfield.						
Comments or recommendations:						
Certification						
I hereby certify that all the necessary information has been gathered to determine the of determination of future system performance has been nor can be made due to unknown possible abuse of the system, inadequate maintenance, or future water usage.						
Inspector name: Brian Humpal/Christopher Uebe Certification	ion number: <u>C5342/C9852</u>					
Business name: Midwest Sewer Services Licer	nse number: _L2896					
Inspector signature: Bean Humpal Hour Man Pho	one number: 651-492-7550					
Necessary or Locally Required Attachments						
	local ordinance					
☐ Other information (list): Report Summary, Property Information, Disclaimer, Lic						

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12 Page 1 of 3

Property address: 9203 55th St N, Lake Elmo, MN 55042

Inspector initials/Date: __7/14/2020 **B**#

1.	In	npact on Public Health – Con	npliance o	component #1 of	of 5
	Sy gro Sy or Sy dw An	estem discharge sewage to the bund surface. Its tem discharge sewage to drain tile surface waters. Its tem cause sewage backup into velling or establishment. In y "yes" answer above indicates in Imminent Threat to Public Heal of the above found.	the syst	⊠ No ⊠ No tem is	Verification method(s): Searched for surface outlet Searched for seeping in yard/backup in home Excessive ponding in soil system/D-boxes Homeowner testimony (See Comments/Explanation) "Black soil" above soil dispersal system System requires "emergency" pumping Performed dye test Unable to verify (See Comments/Explanation) Other methods not listed (See Comments/Explanation)
2.		ank Integrity — Compliance com	ponent #	2 of 5	Verification method(s):
2	Syce Secon Secon de If y	rstem consists of a seepage pit, sspool, drywell, or leaching pit. sspool, drywell, or leaching pit. sepage pits meeting 7080.2550 may be impliant if allowed in local ordinance. swage tank(s) leak below their signed operating depth. yes, which sewage tank(s) leaks: ny "yes" answer above indicates in the second system is Failing to Protect Green comments/Explanation: wered underwater camera into tank - by	oundwat paffles and	⊠ No	 ☑ Probed tank(s) bottom ☑ Examined construction records ☐ Examined Tank Integrity Form (Attach) ☐ Observed liquid level below operating depth ☐ Examined empty (pumped) tanks(s) ☐ Probed outside tank(s) for "black soil" ☐ Unable to verify (See Comments/Explanation) ☑ Other methods not listed (See Comments/Explanation)
3.	a. b.	Maintenance hole covers are damaged Other issues (electrical hazards, etc.) to in *System is an imminent threat to put Explain: System is non-protective of ground wa *System is failing to protect grounds Explain:	d, cracked, mmediately blic health	unsecured, or apport and adversely import and safety	pear to structurally unsound. ☐ Yes* ☒ No ☐ Unknown

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12 Page 2 of 3

Inspector initials/Date: 7/14/2020 **BA** Property address: 9203 55th St N, Lake Elmo, MN 55042 **Soil Separation** – Compliance component #4 of 5 Date of installation: 1987 Unknown Verification method(s): Shoreland/Wellhead protection/Food Beverage ☐ Yes ☐ No Soil observation does not expire. Previous soil Lodging? observations by two independent parties are sufficient, unless site conditions have been altered or local Compliance criteria: requirements differ. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead ☐ Conducted soil observation(s) (Attach boring logs) Protection Area or not serving a food. ☐ Two previous verifications (Attach boring logs) beverage or lodging establishment: ☐ Not applicable (Holding tank(s), no drainfield) Drainfield has at least a two-foot vertical ☐ Unable to verify (See Comments/Explanation) separation distance from periodically ○ Other (See Comments/Explanation) saturated soil or bedrock. ☐ Yes ☐ No Non-performance systems built April 1, Comments/Explanation: 1996, or later or for non-performance Reviewed design and permit records. systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment: Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.* "Experimental", "Other", or "Performance" ☐ Yes ☐ No Indicate depths of elevations systems built under pre-2008 Rules; Type IV See Attached or V systems built under 2008 Rules (7080. Boring Log(s) A. Bottom of distribution media 2350 or 7080.2400 (Advanced Inspector License required) B. Periodically saturated soil/bedrock Drainfield meets the designed vertical separation distance from periodically C. System separation saturated soil or bedrock. D. Required compliance separation* Any "no" answer above indicates the system is *May be reduced up to 15 percent if allowed by Local Failing to Protect Groundwater. Ordinance. 5. Operating Permit and Nitrogen BMP* – Compliance component #5 of 5 Not applicable ☐ Yes ☐ No If "yes", A below is required Is the system operated under an Operating Permit? Is the system required to employ a Nitrogen BMP? ☐ Yes ☐ No If "yes", B below is required BMP=Best Management Practice(s) specified in the system design If the answer to both questions is "no", this section does not need to be completed. Compliance criteria a. Operating Permit number: ☐ Yes ☐ No Have the Operating Permit requirements been met?

Any "no" answer indicates Noncompliance.

b. Is the required nitrogen BMP in place and properly functioning?

Upgrade Requirements (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

☐ Yes ☐ No


www.pca.state.mn.us • 651-296-6300 • 800-657-3864 TTY 651-282-5332 or 800-657-3864 • Available in alternative formats Page 3 of 3

<u>Midwest & ewer Testing</u> <u>Subsurface Sewage Treatment System Owner/Property Information</u>

This information will be used for the purpose of conducting an MPCA Compliance Inspection.							
Date of Inspection: July 14, 2020 Time: 1:15 PM							
Property Address:	9203 55 th St N, La	ke Elmo, MN	Zip: 55042				
Property Owner:	Sharon Mattren		Phone: 612-670-8581				
Tank(s) Septic 1 Aerobic Lift Holding Other:	Tank(s)Material Fiberglass Plastic Metal Concrete Block Other cenance covers acces	Soil Treatment System Rock trench Gravelless trench Chamber trench Seepage bed Mound At-grade Ssible? Ves No *I	Other Alternative system Experimental system Cesspool system Other system f no, proper maintenance must be				
performed through the ground surface	the maintenance ho to facilitate access		vers should be made accessible to				
Year house built: 1		ptic installed: 1987	Tank size (gals.): 1250				
	er owned the proper		residents in home?				
Number of bedroom	ms? 3	Are all floors drained by	<u> </u>				
Garbage disposal?		Whirlpool bath	1?				
	tem (laundry, etc.)?						
		rain tiles connected to the					
Are any buildings on this property such as garages or out-buildings connected to this system?							
Are there any additional systems on this property serving other buildings?							
	system on lot? Sout	h Side					
Location of water			he well a deep well? Y				
			s: tree roots, sewage back-ups,				
surfacing of sewag to the system?	e onto the ground, s If yes, explain:	septic tank overflowing, et	c.; or have any repairs been made				
	em last pumped? 20		mper: Pinky's Sewer Service				
	l in previous years?		m on a monitoring plan?				
	Have you received notices from any government agency concerning this system?						
		l management area? N					
Do you have any a	dditional information	on that should be given to	the new owner?				
considered "non-complia local government unit w	ant/failing" per MPCA rithin 15 days of the da ultimately responsible	rules, that the inspector must be te of inspection completion. I for payment of all fees for all v	ge. I also understand that if the system is y law submit a copy of this report to the also agree that unless otherwise noted in work performed relative to this inspection				

Date:

Owner/Occupant:

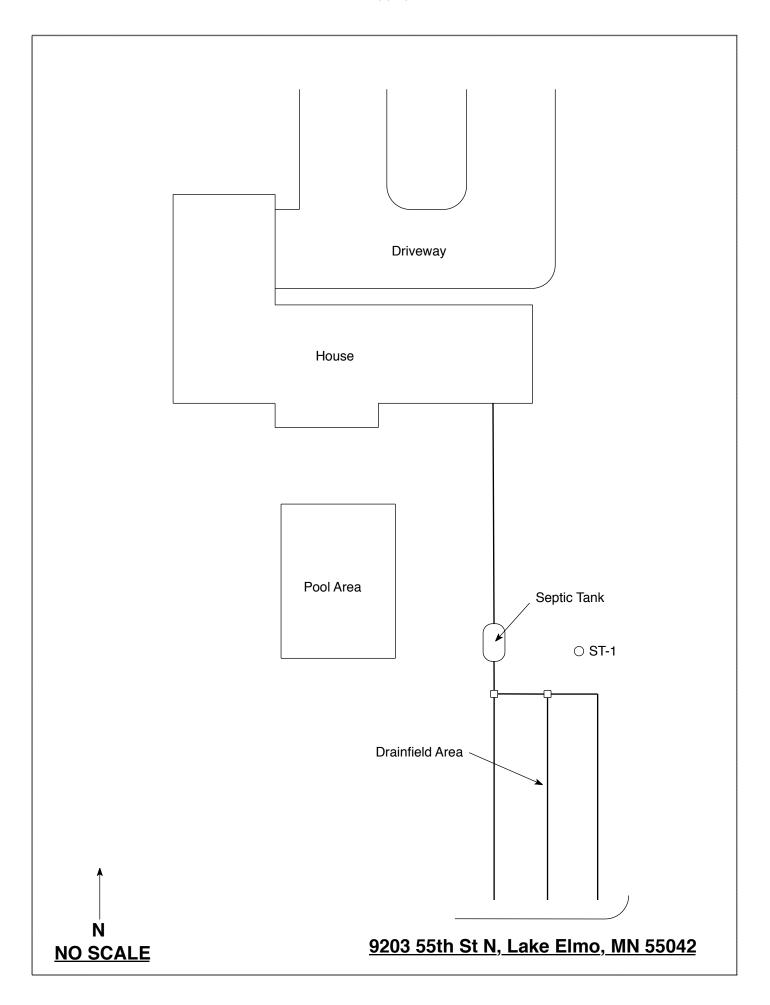

Soil Observations Log

Location of Project: 9 Observations Made By: N Classification System:			<i>'</i>			
Classification System		vices		Date:	7/14/2020	
Classification System.						
Soil Observation: ST-1			Soil O	bservation:		
	d surface as last eld trench	Surface Elevation of Observation				
Depth In Inches Rock % Soils En	ncountered	Depth In Inches	Rock %	Soils Encountered		
8-31 Few 7.5YR 3/4	Sandy Loam With Cobbles I Sandy Loam ny Sand With Gravel					
77" Depth To End Of Soil Observation Or Redox			Depth T	o End Of Soil	Observation Or Redox	
Same Elevation Of Observation			Elevatio	n Of Observat	tion Relative To System	
-45" Depth To Bottom Of Dist	tribution Media	Depth To Bottom Of Distribution Media				
≥32" Of Separation			Of Sepa	ration		
End Of Soil Observation At:	77"	End Of	Soil Obs	servation At:		
Redox Present At:	None			x Present At:		
Standing Water Present At:	None	Standi		r Present At:		

Bottom Of Dist	ribution Medium At: 45 Inches
Signature:	Chan la


-SOIL BORINGS-

Soil borings are made in order to determine the type and structure of soils at various depths as well as the location of the water table, impervious strata or bedrock.

Borings are most easily made with a hand auger, however other expedients may be utilized - back hoe, post hole auger, etc.

Soils encountered at various depths should be listed as to appearance, texture and composition.

Depth at which water, bedrock or heavy clay layer is encountered should be recorded.

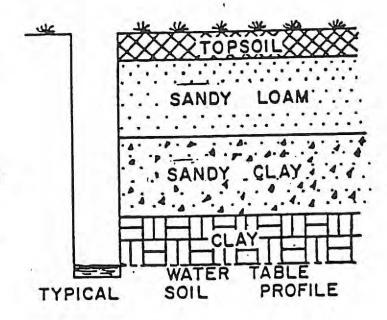

Backhoe Borings: R. Johnson 6/1/85

LOG OF SOIL BORINGS

BORI	NG NO. I	BOR	NG NO. 2	BORI	NG NO. 3	BORIN	NG NO. 4
DEPTH IN FEET	SOIL DESCRIPTION	DEPTH IN FEET	SOIL DESCRIPTION Very Dark	DEPTH IN FEET	SOIL DESCRIPTION Very Dark Crayish Brown Silt Loam	DEPTH IN FEET	SOIL DESCRIPTION
. 0	very Dark Grayish Brown	0	Grayish Brown	0	Grayish Brown	0	
1/2	Loamy Fine	1/2	Sandy Loam Grayish Brown	1/2	Grayish Brown		
	Sand		Fine Sandy Lo	am	Fine Sandy Loam		
11/2	Dark Grayish	11/2	2.11	11/2	Domin	11/2	7
2	Brown Fine Sandy Los		Reddish Brown	2	Reddish	2	r e
21/2		21/2		21/2	Brown	21/2	¥.
3	Brown	3	·Gravelly	3		3	
31/2	Gravelly San		Gravetly	31/2	Gravelly	31/2	
4		4	Sand	4	diarozzy	4	
41/2	Mottling Depth: 30"	41/2		41/2	Sand	41/2	
5	Jopan, Jo	5		5		5	
51/2		51/2		51/2		51/2	
6		6		6	-	6	
61/2		61/2		61/2		61/2	
7	Note-This	7		7		7	
71/2	boring is located in	71/2		71/2		71/2	
8	drainage	8		8		8	
81/2	swale to be	81/2		81/2		81/2	
9	filled	9		9		9	

DISCLAIMER

Brian L. Humpal, Inc. dba. Midwest Sewer Services, Inspect Minnesota, Midwest Soil Testing Relative to Subsurface Sewage Treatment System (SSTS) Compliance Inspections

- 1. This inspection/report is being performed for only the seller/owner of the property on which the SSTS is located. In such case that another party is paying for the inspection, the contract is between only said party and Brian L. Humpal, Inc.; there is no contract between Brian L. Humpal, Inc. and any other party unless otherwise noted.
- 3. Brian L. Humpal, Inc. has not been retained to warranty, guarantee, or certify the proper functioning of the SSTS for any period of time beyond the date of inspection or into the future. Because of the numerous factors (usage, maintenance, soil characteristics, previous failures, etc.) which may affect the proper operation of an SSTS, as well as the inability of Brian L. Humpal, Inc. to supervise or monitor the use or maintenance of the SSTS, the report shall not be construed as a warranty by Brian L. Humpal, Inc. that the SSTS will function properly for any particular party for any period of time.
- 4. Brian L. Humpal, Inc. is unable to verify the frequency and/or, quality of prior or future maintenance of the SSTS. Maintenance of the tank(s) must be performed through the tanks maintenance hole. The removal of solids from any location other than the maintenance hole is not a compliant method of maintenance. It is strongly recommended that maintenance covers be made accessible to the ground surface to facilitate proper maintenance.
- 5. Minimum Compliance Inspection requirements relative to this inspection and this report include only verification that the SSTS has tank(s) (septic tanks, lift tanks, dosing tanks, stilling tanks, etc.) which are watertight below the designed operating depth, the required separation between the bottom of the subsurface soil distribution medium and seasonally saturated soils, no back-ups of sewage into the dwelling, no discharge of sewage/effluent to the ground surface or surface waters, and no imminent safety hazards. Brian L. Humpal, Inc. does not inspect plumbing or pumps prior to the first SSTS component as these are plumbing components. The performance of exterior pumps and associated components are not inspected as they are considered to be maintenance items. Additionally, no indications relative to compliance with electrical code requirements have been made. It is recommended that any other applicable plumbing, electrical, housing, etc. inspections be performed by a qualified inspection business. Sewage back-up verification is limited to observing the floor drain area and/or the information supplied by the last occupants of the building prior to inspection relative to back-ups is accurate.
- 4. Certification of this SSTS does not warranty future use beyond the date of the inspection. Any SSTS, old or new, can become hydraulically overloaded or discharge sewage/effluent to the ground surface as a result of more people moving into the house than were previously occupying the house, improper maintenance, heavy usage, leaking plumbing fixtures, groundwater infiltration, tree roots, freezing conditions, surface drainage problems, poor initial design, poor construction practices, or unsuitable materials used in constructing the system; the system can also simply stop working because of its age. An SSTS that has been properly designed and installed, properly maintained, and used in the manner for which the system was designed can be expected to provide service for twenty to twenty-five years on average. Some parts of the SSTS such as alarms, switches, pumps, filters, etc. will most likely have to be repaired or replaced over the lifetime of the system
- 5. A Compliance Inspection is not meant to be a test or inspection for longevity of the system; a Compliance Inspection is strictly for the purpose of determining if the SSTS is protective of public health and safety, as well as the groundwater at the date and time the inspection was performed. This inspection is not intended to determine if the SSTS was originally designed or installed to past or present MPCA or other Local Government Unit code requirements. This inspection is not intended to determine if the SSTS was designed and/or installed to support the anticipated flow from the building as the use of the building may have changed since the design and construction of the SSTS due to the addition of bedrooms, occupants, etc. In addition, this inspection is not intended to determine the quality of the original SSTS design, the quality of the construction practices used while installing the SSTS, or the quality of the materials used in constructing the SSTS.
- 6. Brian L. Humpal, Inc. cannot guarantee the performance of SSTS products/components such as: gravelless pipe, chamber trenches, effluent filters, tanks, sewage pre-treatment components, piping, etc. Products such as gravelless pipe are no longer approved for installation in the State of Minnesota and may have a significantly reduced performance and/or life expectancy.
- 7. WINTER WORK: By accepting this report, it is understood that inspections conducted during winter months (approximately November 1st through April 1st) are more difficult to perform because of possible snow cover and/or ground frost. SSTS components such as tanks, maintenance covers, tank inspection pipes, subsurface distribution medium inspection pipes, and soil treatment areas are more difficult or impossible to locate due to snow cover and/or ground frost. In addition, soil borings are more difficult to perform due to snow cover and/or ground frost. Brian L. Humpal, Inc. will attempt to use the same level of standards when performing work during winter periods as when performing work during non-winter periods. However, the recipient of this report understands that because of the aforementioned considerations, the same level of standards may not be possible.
- 8. By accepting this report, the client understands that Brian L. Humpal, Inc. will not be responsible for any monetary damages exceeding the fee for the services provided.

Subsurface Sewage Treatment Systems

Non-transferable

Business License

Midwest Sewer Services

License # L2896

License Expires: 12/22/2020

Issued: 11/26/2019

Specialty Area(s):

Installer
Maintainer
Service Provider
Advanced Designer
Advanced Inspector

Designated Certified Individual(s):

Cert # Na

Name

Certification Expires:

C5342

Brian L Humpal

10/15/2023

Installer, Maintainer, Serv Prov, Adv Designer, Adv Inspector

C9852 4

Christopher R Uebe

3/4/2021

Designer, Inspector



520 Lafayette Road North St. Paul, Minnesota 55155-4194 Mich Haig

Nick Haig, Supervisor Certification and Training Unit