


**SSTS MAINTENANCE REPORT**



<b>System Location</b>		
Address <u>8470 Lofton Ave. N</u>	Telephone Number	
City <u>Stillwater</u>	State <u>MN</u> ZIP <u>55082</u>	Property ID No./GEO Code
Owner <u>Gasthaus Bavarian Hunter</u>	Pumping Date <u>9/11/15</u>	
<b>Contractor</b>		
Maintainer <u>MEYER SEWER</u>	MPCA License No. <u>915</u>	Telephone Number <u>651-459-0165</u>

**What was done to the system?**

Tank(s) Pumped /

Sludge and scum measured.

Do tanks need to be pumped?

Yes  No (If no provide measurements below)

**Report Liquid Capacity in Gallons**

Tank 1: 1200  Pumped Tank 2:       Pumped

Tank 3:       Pumped Tank 4:       Pumped

Total Gallons Pumped: 1200

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

**\*Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length      in.  Tank Width      in.  Tank Depth      in. = Tank Volume (cubic inches)     

Tank Radius      in.  Tank Radius      in.  3.14 = Tank Volume (cubic inches)     

Tank Volume (cu. in.)      / 231.01 = Liquid Capacity      Gallons / Tank Depth      in. = Gallons/inch     

Sludge Level      in.  Gallons Per Inch      = Sludge Volume      Gallons


Scum Level      in.  Gallons Per Inch      = Scum Volume      Gallons

Sludge Volume      + Scum Volume      = Total Sludge and Scum Volume      Gallons

Total Sludge and Scum Volume      / Liquid Capacity      = Percent Sludge and Scum in Tank      %

\*Tanks must be pumped if either of the following conditions exist:

1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

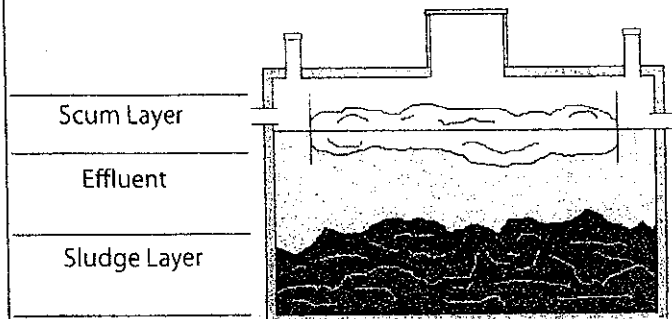

Tank Depth measured from invert of outlet pipe to bottom of tank

Signature [Handwritten Signature]

Date 9/11/15

Reset Form