


SSTS MAINTENANCE REPORT



System Location		
Address	<u>3717 Oakgreen Ave. S</u>	Telephone Number
City	<u>Afton</u>	State <u>MN</u> ZIP <u>55001</u> Property ID No./GEO Code
Owner	<u>Ken Meidlinger</u>	Pumping Date <u>9/18/15</u>
Contractor		
Maintainer	<u>MEYER SEWER</u>	MPCA License No. <u>915</u> Telephone Number <u>651-459-0168</u>

What was done to the system?

Tank(s) Pumped 1

Sludge and scum measured.

Do tanks need to be pumped?

Yes No (If no provide measurements below)

Report Liquid Capacity in Gallons

Tank 1: 1000 Pumped Tank 2: Pumped

Tank 3: Pumped Tank 4: Pumped

Total Gallons Pumped: 1000

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

***Tank Measurements-Use Only if Tank(s) Were NOT Pumped**

Tank Length in. Tank Width in. Tank Depth in. = Tank Volume (cubic inches)

Tank Radius in. Tank Radius in. **3.14** = Tank Volume (cubic inches)


Tank Volume (cu. in.) / **231.01** = Liquid Capacity Gallons / Tank Depth in. = Gallons/Inch

Sludge Level in. Gallons Per Inch = Sludge Volume Gallons

Scum Level in. Gallons Per Inch = Scum Volume Gallons

Sludge Volume + Scum Volume = Total Sludge and Scum Volume Gallons

Total Sludge and Scum Volume / Liquid Capacity = Percent Sludge and Scum in Tank %

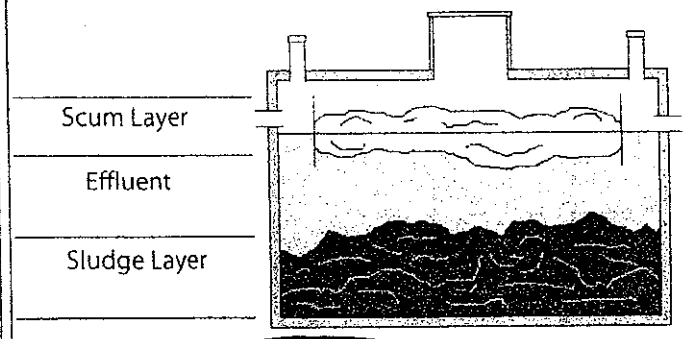

*Tanks must be pumped if either of the following conditions exist:

1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Tank Depth measured from invert of outlet pipe to bottom of tank

Signature *[Handwritten Signature]* Date 9/18/15 Reset Form