

SSTS MAINTENANCE REPORT


System Location	
Address <u>14140 Scandia Trl</u>	Telephone Number <u>763-645-2097</u>
City <u>Scandia</u>	State <u>MN</u> ZIP <u>55073</u> Property ID No./GEO Code
Owner <u>David Clark</u>	Pumping Date <u>5-10-16</u>
Contractor	
Maintainer <u>R&M Septic</u>	MPCA License No. <u>7798-13070</u> Telephone Number (651) 674-8520

What was done to the system?
<input type="checkbox"/> Tank(s) Pumped <input checked="" type="checkbox"/> Sludge and scum measured. Do tanks need to be pumped? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No (If no provide measurements below)

Report Liquid Capacity in Gallons
Tank 1: <u>1500</u> <input checked="" type="checkbox"/> Pumped Tank 2: <u>1500</u> <input checked="" type="checkbox"/> Pumped Tank 3: _____ <input type="checkbox"/> Pumped Tank 4: _____ <input type="checkbox"/> Pumped Total Gallons Pumped: <u>3000</u>

Visual Inspection (note any problems with the system):

NOTE: This does not serve as a compliance inspection.

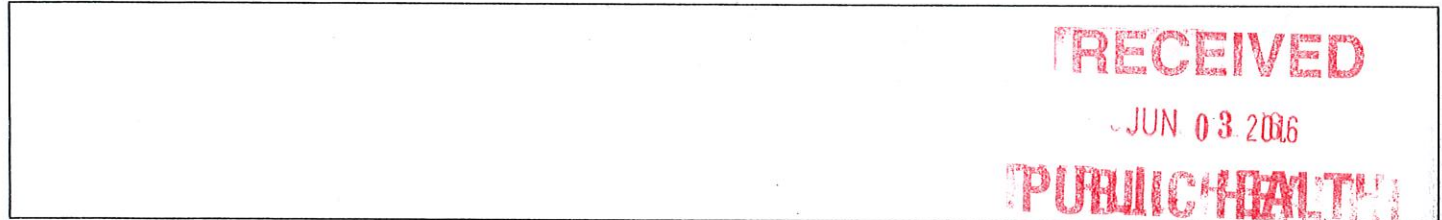

*Tank Measurements-Use Only If Tank(s) Were NOT Pumped		
Tank Length _____ in. <input checked="" type="checkbox"/>	Tank Width _____ in. <input checked="" type="checkbox"/>	Tank Depth _____ in. = Tank Volume (cubic inches) _____
Tank Radius _____ in. <input checked="" type="checkbox"/>	Tank Radius _____ in. <input checked="" type="checkbox"/>	3.14 = Tank Volume (cubic inches) _____
Tank Volume (cu. in.) _____ / 231.01 = Liquid Capacity _____ Gallons / Tank Depth _____ in. = Gallons/Inch _____		
Sludge Level _____ in. <input checked="" type="checkbox"/>	Gallons Per Inch _____ = Sludge Volume _____ Gallons	
Scum Level _____ in. <input checked="" type="checkbox"/>	Gallons Per Inch _____ = Scum Volume _____ Gallons	
Sludge Volume _____ + Scum Volume _____ = Total Sludge and Scum Volume _____ Gallons		
Total Sludge and Scum Volume _____ / Liquid Capacity _____ = Percent Sludge and Scum in Tank _____ %		

Scum Layer
Effluent
Sludge Layer

Tank Depth measured from invert of outlet pipe to bottom of tank

*Tanks must be pumped if either of the following conditions exist:
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Signature Richard Clemens Date 5-10-16 Reset Form