

Compliance inspection report form Existing Subsurface Sewage Treatment System (SSTS)

520 Lafayette Road North St. Paul, MN 55155-4194

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached supporting documentation – additional local requirements may also apply. Further information can be found here: https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf.

Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance.


Property information	Local tracking number:
Parcel ID# or Sec/Twp/Range: 15.032.21.14.0004	Local regulatory authority: Washington County 651-430-6655
Property address: 8255 Scandia Trail N Forest Lake, MN 55	5021
Owner/representative: Matthew Deitner	Owner's phone:
Brief system description: 1250 gallon septic tank, 1000 gallon	n pump tank and a pressure bed drainfield
System status	
System status on date (mm/dd/yyyy): 4/2/2021	
☐ Compliant – Certificate of compliance*	☑ Noncompliant – Notice of noncompliance
(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exist in Local Ordinance.) *Note: Compliance indicates conformance with Minimum.	upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8. Systems failing to protect ground water must be upgraded,
R. 7080.1500 as of system status date above and does not guarantee future performance.	replaced, or use discontinued within the time required by local ordinance.
 ☐ Other Compliance Conditions (Compliance compound ☐ System not abandoned according to Minn. R. 708 ☑ Soil separation (Compliance component #5) – Fair 	ling to protect groundwater conent #3) – Imminent threat to public health and safety conent #3) – Failing to protect groundwater 80.2500 (Compliance component #3) – Failing to protect groundwater cilling to protect groundwater Compliance component #4) – Noncompliant - local ordinance applies
abuse of the system, inadequate maintenance, or future water	be made due to unknown conditions during system construction, possible rusage.
By typing my name below, I certify the above statements to be can be used for the purpose of processing this form.	be true and correct, to the best of my knowledge, and that this information
Business name: All State Septic Services LLC	Certification number: 323
Inspector signature: Tom Trooien	License number: 1568
(This document has been electronically sign	nned) Phone: 612-594-4496
Necessary or locally required supporting d	documentation (must be attached)
☑ Soil observation logs☑ Locally required forms☑ Other information (list):Site plan	
https://www.pca.state.mn.us • 651-296-6300 • 800-657-3	3864 • Use your preferred relay service • Available in alternative formats

Compliance criteria:			Attached supporting documentat	ion:
System discharges sewage to the pround surface	☐ Yes*	⊠ No	☐ Other: ☑ Not applicable	
System discharges sewage to drain le or surface waters.	☐ Yes*	⊠ No	M Not applicable	
System causes sewage backup into welling or establishment.	☐ Yes*	⊠ No		
Any "yes" answer above indicates mminent threat to public health ar				
Describe verification methods and	results:			
nk integrity – Compliance Compliance criteria:	compo	onent #2	of 5 Attached supporting documentat	ion:
System consists of a seepage pit,	☐ Yes*	☑ No	✓ Pumped at time of inspection	1011.
cesspool, drywell, leaching pit, or other pit?			Name of maintenance business:	Olson's Sewe Service
Sewage tank(s) leak below their	☐ Yes*	⊠ No	License number of maintenance bus	iness: <u>216</u>
designed operating depth?			Date of maintenance:	4/2/2021
			Existing tank integrity assessment (A	Attach)
f von which cowers tank(a) lanks			Date of maintenance (mm/dd/yyyy): (must be w	vithin three years)
f yes, which sewage tank(s) leaks: Any "yes" answer above indic	nton the	au catama		
is failing to protect groundwat		system	(See form instructions to ensure ass Minn. R. 7082.0700 subp. 4 B (1))	essment compiles w
			☐ Tank is Noncompliant (pumping not ne	ecessary – explain bek
			Other:	

3.	Other compliance conditions – Compliance component #3 of 5
	3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured? ☐ Yes* ☒ No ☐ Unknown 3b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety? ☐ Yes* ☒ No ☐ Unknown *Yes to 3a or 3b - System is an imminent threat to public health and safety. 3c. System is non-protective of ground water for other conditions as determined by inspector? ☐ Yes* ☒ No 3d. System not abandoned in accordance with Minn. R. 7080.2500? ☐ Yes* ☒ No *Yes to 3c or 3d - System is failing to protect groundwater. Describe verification methods and results:
	Attached supporting documentation: Not applicable
4.	Operating permit and nitrogen BMP* — Compliance component #4 of 5 Not applicable Is the system operated under an Operating Permit?
	Attached supporting documentation:

5. Soil separation - Compliance component #5 of 5 Date of installation 6/8/1985 Unknown (mm/dd/yyyy) Shoreland/Wellhead protection/Food ☐ Yes ☒ No Attached supporting documentation: beverage lodging? Soil observation logs completed for the report (Attach) Compliance criteria (select one): ☐ Two previous verifications of required vertical separation (Attach) 5a. For systems built prior to April 1, 1996, ☐ Yes ☐ No* and not located in Shoreland or Wellhead ☐ Not applicable (No soil treatment area) Protection Area or not serving a food. beverage or lodging establishment: Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock. 5b. Non-performance systems built April 1, ☐ Yes ☒ No* Indicate depths or elevations 1996, or later or for non-performance A. Bottom of distribution media 42" systems located in Shoreland or Wellhead Protection Areas or serving a food, B. Periodically saturated soil/bedrock 48" beverage, or lodging establishment: C. System separation 6" Drainfield has a three-foot vertical separation distance from periodically D. Required compliance separation* 24" saturated soil or bedrock.* *May be reduced up to 15 percent if allowed by Local Ordinance. 5c. "Experimental", "Other", or "Performance" ☐ Yes ☐ No* systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080. 2350 or 7080.2400 (Advanced Inspector License required) Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock. *Any "no" answer above indicates the system is failing to protect groundwater. Describe verification methods and results: Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced,

or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

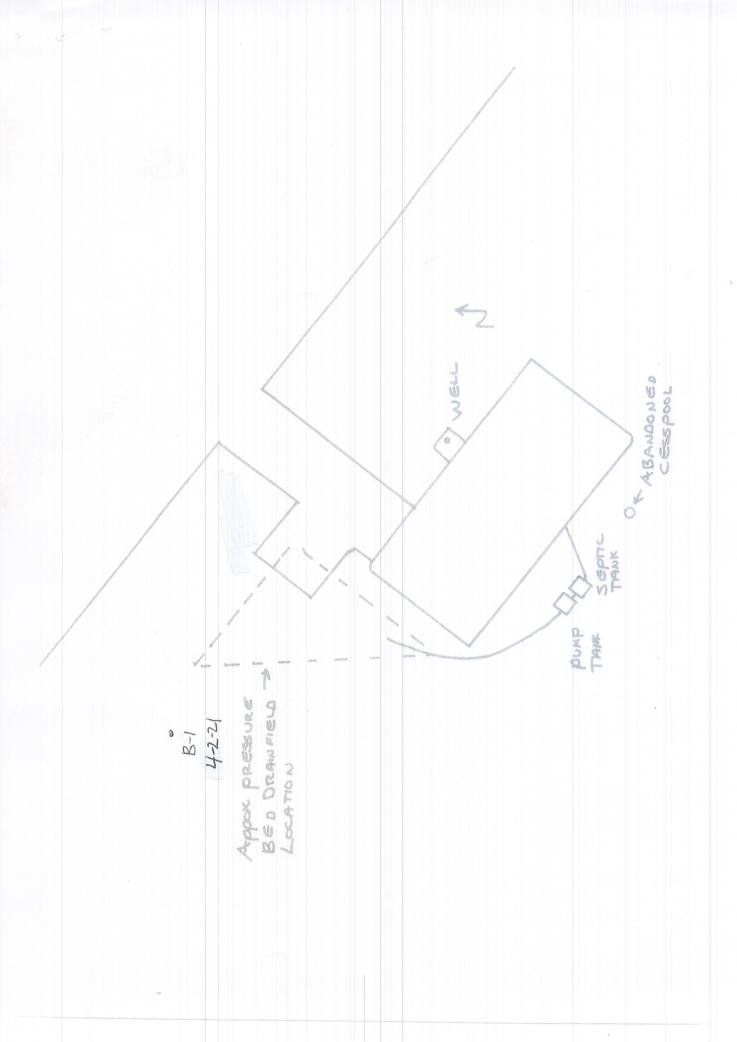



Soil Observation Log

PROGRAM	25)	Project ID:			v 04.01.2020
Client:			Matthew Deitner		Locat	Location / Address:	8255 Scal	ndia Trail N Fores	8255 Scandia Trail N Forest Lake, MN 55025
Soil parent ma	Soil parent material(s): (Check all that apply)	ck all that	Ш	Outwash Lacustrine	Loess	Alluvium	Bedrock	ck Organic Matter	: Matter
Landscape Po	Landscape Position: (select one)	one)		Slope %:	Slope shape			Elevatio	Elevation-relative to benchmark:
Vegetation:			6	Soil survey map units:				Limiting Layer Elevation:	Elevation:
Weather Cond	Weather Conditions/Time of Day:	Day:					Date	0	04/02/21
Observatio	Observation #/Location:		B-1			Obser	Observation Type:		Auger
Denth (in)	Texture	Rock	Matrix Color(s)	Mottle Color(c)	Dodov Vind(c)	Indicator(a)	1	Structure	
(III) IIIdad	ובענמור	Frag. %	Maci In Cotol (3)	ואוסררוב החוחו (s)	(s) NIII (s)	IIIUICALOI (S)	Shape	Grade	Consistence
8-0	Top Soil	<35%	10YR 2/2				Granular	Weak	Friable
00.0	Fine Sandy	, OHC.	10YR 4/4				-		
05-0	Loam	%665			•	•	Granular	Moderate	Friable
30.54	Sandy Clay	,350	7.5YR 4/6	10YR 6/8	Concentrations	S1	-		
5	Loam	%75%		10YR 7/1	Depletions	51	БІОСКУ	Moderate	Hrm
•		· *** ***	********		•				
	35	300K 300K 380							
	30	*** *** **	***********						
***************************************	ASE	× 386 386						near near near	
							N. 44 E444 E4		
***************************************	AND NE			•			49 6449 649 64	or work work w	
***************************************	345.33							********	
							444 LEAS		
Comments	Comments Redox at 48"								
I hereby certify	y that I have or	ompleted	I hereby certify that I have completed this work in accordance with		all applicable ordinances, rules and laws.	and laws.			
	Tom Trooien		100	Troopen			1568		3/30/21
(Desi	(Designer/Inspector)			(Signature)			(License #)		(Date)