

520 Lafayette Road North St. Paul, MN 55155-4194

# Compliance inspection report form

# Existing Subsurface Sewage Treatment System (SSTS)

Doc Type: Compliance and Enforcement

Instructions: Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance. Instructions for filling out this form are located on the Minnesota Pollution Control Agency (MPCA) website at https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf.

### Prop

Property information	Local tracking number:		
Parcel ID# or Sec/Twp/Range: 0502820340003	Reason for Inspection	Property Transfer	
Local regulatory authority info: Washington County			
Property address: 13288 10th St S Afton, Mn. 55001			
Owner/representative: Chad Fredkove		Owner's phone: 651-387-7787	

Brief system description: 1 Septic tank to gravity drainfield. This is a very old system and length of lifespan is unknown.

### System status

System status on date (mm/dd/yyyy): 3/31/2022

Compliant – Certificate of compliance\*

(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists in Local Ordinance.)

\*Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.

### ☐ Noncompliant – Notice of noncompliance

Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.

An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.

### Reason(s) for noncompliance (check all applicable)

Impact on public health (Compliance component #1) - Imminent threat to public health and safety

Tank integrity (Compliance component #2) – Failing to protect groundwater

Other Compliance Conditions (Compliance component #3) – Imminent threat to public health and safety

Other Compliance Conditions (Compliance component #3) – Failing to protect groundwater

System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) - Failing to protect groundwater

Soil separation (Compliance component #5) – Failing to protect groundwater

Operating permit/monitoring plan requirements (Compliance component #4) - Noncompliant - local ordinance applies

## Comments or recommendations

### Certification

I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.

By typing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Business name: David	I R Brown	Certification number: 9370
Inspector signature:	DRB	License number: 3649
	(This document has been electronically signed)	Phone: 651-788-3296
Necessary or le	ched)	

Soil observation logs	System/As-Built	Locally required forms	Tank Integrity Assessment	Operating Permit
Other information (list):				

## 1. Impact on public health – Compliance component #1 of 5

Compliance criteria:		Attached supporting documentation:
System discharges sewage to the ground surface	🗌 Yes* 🛛 No	☐ Other: ☐ Not applicable
System discharges sewage to drain tile or surface waters.	🗋 Yes* 🖾 No	_
System causes sewage backup into dwelling or establishment.	🗌 Yes* 🖾 No	
Any "yes" answer above indicates imminent threat to public health ar		-

Describe verification methods and results:

## 2. Tank integrity - Compliance component #2 of 5

Compliance criteria:		Attached supporting of	documentatior	<b>):</b>
System consists of a seepage pit, cesspool, drywell, leaching pit, or other pit?	☐ Yes* ⊠ No	Empty tank(s) viewed Name of maintenance		Meyer's
Sewage tank(s) leak below their	🗌 Yes* 🛛 No	License number of maintenance business: 915		
designed operating depth?		Date of maintenance:		3/31/2022
		Existing tank integrity	assessment (Atta	ach)
If yes, which sewage tank(s) leaks:		Date of maintenance (mm/dd/yyyy):	(must be with	in three years)
Any "yes" answer above indic is failing to protect groundwat		(See form instructions Minn. R. 7082.0700 รเ		sment complies with
		Tank is Noncompliant	(pumping not nece	ssary – explain below)
		Other:		
Describe verification methods and	results:			

.

# 3. Other compliance conditions - Compliance component #3 of 5

3a	Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured?			
	□ Yes*			
3b	. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety?	' 🗌 Yes*	🖾 No 🗌 Unknown	
	*Yes to 3a or 3b - System is an imminent threat to public health and safety.			
3c	. System is non-protective of ground water for other conditions as determined by inspector?	□ Yes*	🖾 No	
3d	. System not abandoned in accordance with Minn. R. 7080.2500?	☐ Yes*	🖾 No	
	*Yes to 3c or 3d - System is failing to protect groundwater.			
	Describe verification methods and results:			

Attached supporting documentation: 
Not applicable

## 4. Operating permit and nitrogen BMP\* – Compliance component #4 of 5 🛛 Not applicable

Is the system operated under an Operating Permit?	🗌 Yes	🖾 No	If "yes", A below is required		
Is the system required to employ a Nitrogen BMP specified in the system de	esign? 🗌 Yes	🛛 No	If "yes", B below is required		
BMP = Best Management Practice(s) specified in the system design					
If the answer to both questions is "no", this section does not need to be completed.					
Compliance criteria:					
a. Have the operating permit requirements been met?	res 🗌 No				
b. Is the required nitrogen BMP in place and properly functioning?	res 🗌 No				
Any "no" answer indicates noncompliance.					
Describe verification methods and results:					

Attached supporting documentation: 
Operating permit (Attach)


### Soil separation – Compliance component #5 of 5


Date of installation 1979 (mm/dd/yyyy)	Unknown		
Shoreland/Wellhead protection/Food beverage lodging? Compliance criteria (select one): 5a. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment: Drainfield has at least a two-foot vertical separation distance from periodically	☐ Yes ⊠ No	Attached supporting documentation: Soil observation logs completed for th Two previous verifications of required Not applicable (No soil treatment area	vertical separation
saturated soil or bedrock. 5b. Non-performance systems built April 1, 1996, or later or for non- performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment: Drainfield has a three-foot vertical	⊠ Yes □ No*	Indicate depths or elevations A. Bottom of distribution media	36"
		B. Periodically saturated soil/bedrock C. System separation	72" 36"
separation distance from periodically saturated soil or bedrock.*		D. Required compliance separation* 36" *May be reduced up to 15 percent if allowed by Local Ordinance.	
<ul> <li>5c. "Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080. 2350 or 7080.2400 (Intermediate Inspector License required ≤ 2,500 gallons per day; Advanced Inspector License required &gt; 2,500 gallons per day)</li> <li>Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.</li> </ul>	☐ Yes ☐ No*		

\*Any "no" answer above indicates the system is failing to protect groundwater.

Describe verification methods and results:

Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

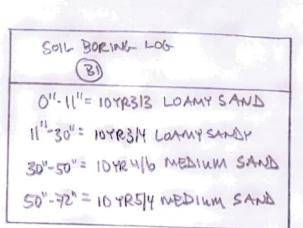

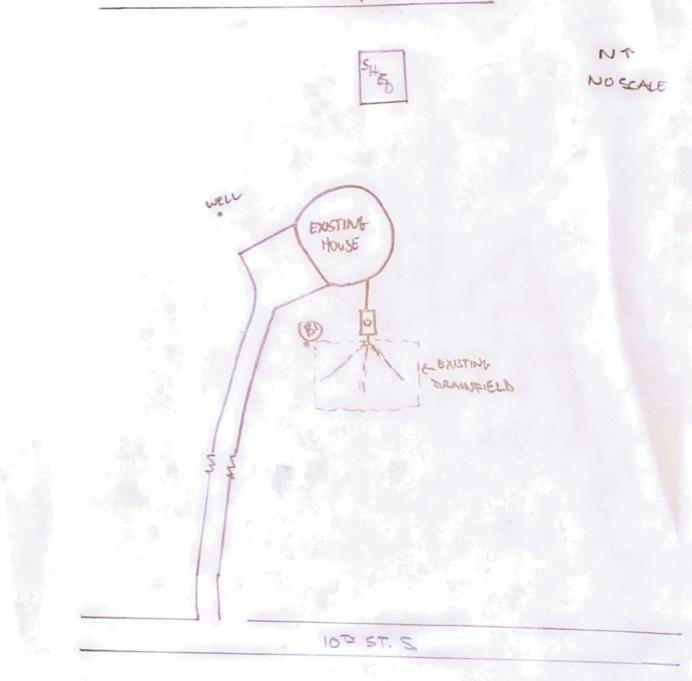

# 13288 100 ST.S. AFTON, MN. 55001