

## Compliance inspection report form

**Existing Subsurface Sewage Treatment System (SSTS)** 

520 Lafayette Road North St. Paul, MN 55155-4194

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached supporting documentation - additional local requirements may also apply. Further information can be found here: https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf.

Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance.

Property information	Local tracking number:					
Parcel ID# or Sec/Twp/Range: 2702920220003 Local	regulatory authority: Washinton County					
Property address: 1785 Panama Ave N West Lakeland, Mn.55082						
Owner/representative: Gale Reller (Lynn)	Owner's phone: 612-710-8672					
Brief system description: 2 septic tanks and 1 lift tank to gravity drain	nfield					
System status						
System status on date (mm/dd/yyyy): _6/7/2022						
□ Compliant – Certificate of compliance*     □	Noncompliant – Notice of noncompliance					
(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists	An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.					
in Local Ordinance.)  *Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.	Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.					
Reason(s) for noncompliance (check all applicable)    Impact on public health (Compliance component #1) – Imminent threat to public health and safety   Tank integrity (Compliance component #2) – Failing to protect groundwater   Other Compliance Conditions (Compliance component #3) – Imminent threat to public health and safety   Other Compliance Conditions (Compliance component #3) – Failing to protect groundwater   System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) – Failing to protect groundwater   Soil separation (Compliance component #5) – Failing to protect groundwater   Operating permit/monitoring plan requirements (Compliance component #4) – Noncompliant - local ordinance applies  Comments or recommendations  System was installed with a permit from Washington County						
Certification  I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible						
abuse of the system, inadequate maintenance, or future water usage.  By typing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.						
Business name: David R Brown	Certification number: 9370					
Inspector signature: DRB	License number: 3649					
(This document has been electronically signed)	Phone: 651-788-3296					
Necessary or locally required supporting documentation (must be attached)						
<ul><li>☑ Soil observation logs</li><li>☑ Locally required forms</li><li>☐ Other information (list):</li></ul>	☐ Tank Integrity Assessment ☐ Operating Permit					

1. Impact on public health - Compliance component #1 of 5 Compliance criteria: Attached supporting documentation: System discharges sewage to the ☐ Yes\* ⊠ No Other: ground surface ☐ Not applicable System discharges sewage to drain ☐ Yes\* ☒ No tile or surface waters. System causes sewage backup into ☐ Yes\* ☒ No dwelling or establishment. Any "yes" answer above indicates the system is an imminent threat to public health and safety. Describe verification methods and results: 2. Tank integrity – Compliance component #2 of 5 Attached supporting documentation: Compliance criteria: ☐ Yes\* ☒ No □ Pumped at time of inspection System consists of a seepage pit, cesspool, drywell, leaching pit, Name of maintenance business: or other pit? Meyer's ☐ Yes\* ☒ No License number of maintenance business: 915 Sewage tank(s) leak below their designed operating depth? Date of maintenance: 6/7/2022 ☐ Existing tank integrity assessment (Attach) Date of maintenance (mm/dd/yyyy): (must be within three years) If yes, which sewage tank(s) leaks: (See form instructions to ensure assessment complies with Any "yes" answer above indicates the system Minn. R. 7082.0700 subp. 4 B (1)) is failing to protect groundwater. ☐ Tank is Noncompliant (pumping not necessary – explain below) ☐ Other: Describe verification methods and results:

3.	Other compliance conditions – Compliance component #3 of 5					
	3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured?  ☐ Yes* ☑ No ☐ Unknown					
	3b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety? ☐ Yes* ☒ No ☐ Unknown *Yes to 3a or 3b - System is an imminent threat to public health and safety.					
	3c. System is non-protective of ground water for other conditions as determined by inspector?	☐ Yes* ☒ No				
	3d. System not abandoned in accordance with Minn. R. 7080.2500?	☐ Yes* ☒ No				
	*Yes to 3c or 3d - System is failing to protect groundwater.					
	Describe verification methods and results:					
	The second secon					
	Attached annual discount disco					
	Attached supporting documentation:   Not applicable					
4.	Operating permit and nitrogen BMP* – Compliance component #4 of	5 Not applicable				
	Is the system operated under an Operating Permit? ☐ Yes ☒ No ☐ If	"yes", A below is required				
	Is the system required to employ a Nitrogen BMP specified in the system design? $\square$ Yes $\square$ No $\square$ If	"yes", B below is required				
	BMP = Best Management Practice(s) specified in the system design					
	If the answer to both questions is "no", this section does not need to be completed.					
	Compliance criteria:					
	a. Have the operating permit requirements been met? ☐ Yes ☐ No					
	b. Is the required nitrogen BMP in place and properly functioning? ☐ Yes ☐ No					
	Any "no" answer indicates noncompliance.					
	Describe verification methods and results:					
	Attached cupporting decumentations					
	Attached supporting documentation:   Operating permit (Attach)					


## 5. Soil separation – Compliance component #5 of 5

Date of installation 10/17/2002 (mm/dd/yyyy)	Unknowr	n		
Shoreland/Wellhead protection/Food beverage lodging?	☐ Yes ⊠	☐ Soil observation logs completed for the report (Att		
Compliance criteria (select one):  5a. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment:	☐ Yes ☐	No*	<ul> <li>☐ Two previous verifications of required separation (Attach)</li> <li>☐ Not applicable (No soil treatment area</li> </ul>	
Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.				
5b. Non-performance systems built April 1,	⊠ Yes □	No*	Indicate depths or elevations	
1996, or later or for non-performance systems located in Shoreland or Wellhead		_	A. Bottom of distribution media	36"
Protection Areas or serving a food,		_	B. Periodically saturated soil/bedrock	76"
beverage, or lodging establishment:  Drainfield has a three-foot vertical		_	C. System separation	40"
separation distance from periodically		_	D. Required compliance separation*	36"
saturated soil or bedrock.*			*May be reduced up to 15 percent if allowed by Local Ordinance.	
5c. "Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080. 2350 or 7080.2400 (Advanced Inspector License required)	☐ Yes ☐	No*		
Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.				
*Any "no" answer above indicates the failing to protect groundwater.	system is			

Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

Describe verification methods and results:

19th ST. N.

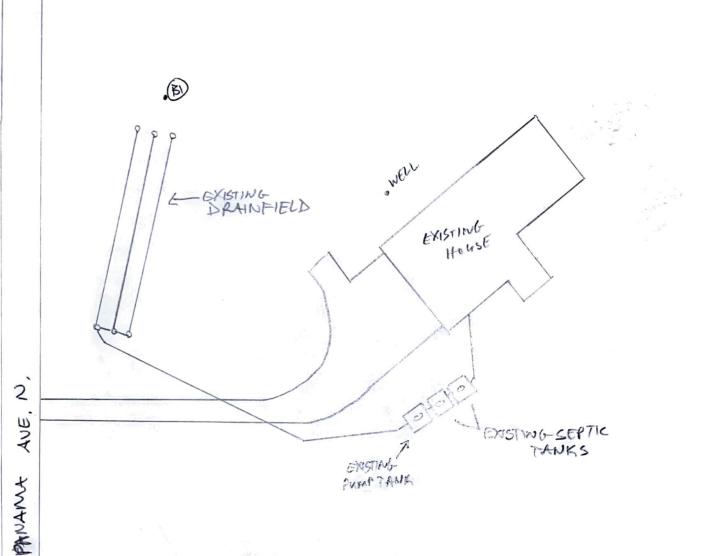

SOIL BORING LOG

0"-26"= 10 YR313 SANDY LOAM 26"70"=10 YR3/4 LOAMY SAND 70"-76"=10 YR4/6 LOAMY SAND