

520 Lafayette Road North St. Paul, MN 55155-4194

Compliance inspection report form **Existing Subsurface Sewage Treatment System (SSTS)**

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached supporting documentation - additional local requirements may also apply. Further information can be found here: https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf.

Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance.

Property information	Local tracking number:				
Parcel ID# or Sec/Twp/Range:Loca	I regulatory authority: Washington County				
Property address: 11681 LeHigh Ave South Hastings Mn. 55033					
Owner/representative: Les and Vicky Milverstedt	Owner's phone: 651-238-2054				
Brief system description: two non conforming tanks (cesspools)					
System status					
System status on date (mm/dd/yyyy): _7/6/2022					
☐ Compliant – Certificate of compliance*	☑ Noncompliant – Notice of noncompliance				
(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists	An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.				
in Local Ordinance.) *Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.	Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.				
Reason(s) for noncompliance (check all applicable) ☐ Impact on public health (Compliance component #1) – Imminent threat to public health and safety ☐ Tank integrity (Compliance component #2) – Failing to protect groundwater ☐ Other Compliance Conditions (Compliance component #3) – Imminent threat to public health and safety ☐ Other Compliance Conditions (Compliance component #3) – Failing to protect groundwater ☐ System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) – Failing to protect groundwater ☐ Soil separation (Compliance component #5) – Failing to protect groundwater ☐ Operating permit/monitoring plan requirements (Compliance component #4) – Noncompliant - local ordinance applies Comments or recommendations					
replace septic system, Home has a 1972 nonconformitng to	70 tank system				
Certification					
I hereby certify that all the necessary information has been gathered determination of future system performance has been nor can be maduse of the system, inadequate maintenance, or future water usage By typing my name below, I certify the above statements to be true.	ade due to unknown conditions during system construction, possible e.				
can be used for the purpose of processing this form.					
Business name: Bob Freiermuth	Certification number: C818				
Inspector signature:	License number: L492				
(This document has been electronically signed)	Phone: 651 437-5566				
Necessary or locally required supporting docu	mentation (must be attached)				
☐ Soil observation logs ☐ Locally required forms ☐ Other information (list):	☐ Tank Integrity Assessment ☐ Operating Permit				

1. Impact on public health – Compliance component #1 of 5 Compliance criteria: Attached supporting documentation: System discharges sewage to the ☐ Yes* ☒ No Other: ground surface Not applicable System discharges sewage to drain ☐ Yes* ☒ No tile or surface waters. ☐ Yes* ⊠ No System causes sewage backup into dwelling or establishment. Any "yes" answer above indicates the system is an imminent threat to public health and safety. Describe verification methods and results: visual inspection of site 2. Tank integrity – Compliance component #2 of 5 Compliance criteria: Attached supporting documentation: Yes* □ No System consists of a seepage pit, ☐ Pumped at time of inspection cesspool, drywell, leaching pit, or other pit? Name of maintenance business: Sewage tank(s) leak below their Yes^{*} □ No License number of maintenance business: designed operating depth? Date of maintenance: ☐ Existing tank integrity assessment (Attach) Date of maintenance (mm/dd/yyyy): (must be within three years) If yes, which sewage tank(s) leaks: (See form instructions to ensure assessment complies with Any "yes" answer above indicates the system Minn. R. 7082.0700 subp. 4 B (1)) is failing to protect groundwater. ☐ Tank is Noncompliant (pumping not necessary – explain below) Other: Describe verification methods and results: probe tanks no bottom,

3.	Other compliance conditions – Compliance component #3 of 5					
	3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured? ☐ Yes* ☐ No ☒ Unknown					
	3b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety? ☐ Yes* ☒ No ☐ Unknown*Yes to 3a or 3b - System is an imminent threat to public health and safety.					
	3c. System is non-protective of ground water for other conditions as determined by inspector?	☑ Yes* ☐ No				
	3d. System not abandoned in accordance with Minn. R. 7080.2500?	☐ Yes* ☒ No				
	*Yes to 3c or 3d - System is failing to protect groundwater.					
	Describe verification methods and results:					
	probe tanks no bottoms					
	proportaline no potonio					
	Attached supporting documentation: Not applicable					
Л	Occupies a consist and vituation DMD* Consuling a consule was					
4.	Operating permit and nitrogen BMP* – Compliance component #4 o	Not applicable				
	Is the system operated under an Operating Permit?	f "yes", A below is required				
	Is the system required to employ a Nitrogen BMP specified in the system design? Yes No I	f "yes", B below is required				
	BMP = Best Management Practice(s) specified in the system design					
	If the answer to both questions is "no", this section does not need to be completed	<i>I</i> .				
	Compliance criteria:					
	a. Have the operating permit requirements been met? ☐ Yes ☐ No					
	b. Is the required nitrogen BMP in place and properly functioning? ☐ Yes ☐ No					
	Any "no" answer indicates noncompliance.					
	Describe verification methods and results:					
	Describe verification metrious and results.					
	Attached supporting documentation: Operating permit (Attach)					

https://www.pca.state.mn.us wq-wwists4-31b • 1/11/21

5. Soil separation - Compliance component #5 of 5 1972 Date of installation Unknown (mm/dd/yyyy) Shoreland/Wellhead protection/Food ☐ Yes ☒ No Attached supporting documentation: beverage lodging? ☐ Soil observation logs completed for the report (Attach) Compliance criteria (select one): ☐ Two previous verifications of required vertical separation (Attach) 5a. For systems built prior to April 1, 1996, ☐ Yes ☒ No* ☐ Not applicable (No soil treatment area) and not located in Shoreland or Wellhead Protection Area or not serving a food. No soil observation done beverage or lodging establishment: Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock. 5b. Non-performance systems built April 1, ☐ Yes ☐ No* Indicate depths or elevations 1996, or later or for non-performance A. Bottom of distribution media systems located in Shoreland or Wellhead Protection Areas or serving a food, B. Periodically saturated soil/bedrock beverage, or lodging establishment: C. System separation Drainfield has a three-foot vertical separation distance from periodically D. Required compliance separation* saturated soil or bedrock.* *May be reduced up to 15 percent if allowed by Local Ordinance. 5c. "Experimental", "Other", or "Performance" ☐ Yes ☐ No* systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080, 2350 or 7080, 2400 (Advanced Inspector License required) Drainfield meets the designed vertical separation distance from periodically

*Any "no" answer above indicates the system is failing to protect groundwater.


Describe verification methods and results:

two non conforming tanks (cesspools)

saturated soil or bedrock.

Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

800-657-3864

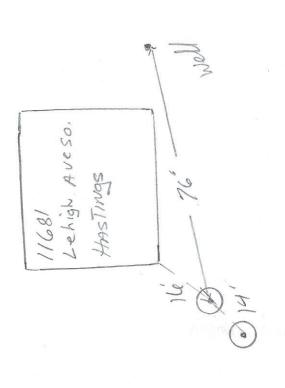

Lehigh Ave so.

Date:	6 July 2022	
Customer Name:	Les Milverstedt	
Street Address:	11681 Lehigh Ave south	5
City, State, Zip	Hastings Mn. 55033	
Phone Number:	651-238-2054	

Based on what we were able to observe and on our experience with on-site wastewater technology, we submit this Onsite Sewage Treatment System Inspection Report based on the present condition of the onsite sewage disposal system. Bob Freiermuth has not been retained to warrant, guarantee, or certify The proper functioning of the system for any period of time in the future. Because of the numerous factors (usage, soil characteristics, previous failures, etc.) which may affect the proper operation of a septic system, this report shall not be construed as a warranty by our company that the system will function properly for any particular buyer. Bob Freiermuth hereby DISCLAIMS ANY WARRANTY, either expressed or implied, arising from the inspection of the septic system or this report. We are not also ascertaining any affect the system is having on the groundwater.

(Owners Signature			
		License No:	818	
Inspecting Company	Bob Freiermuth	Phone	651 437-5566	

I have studied the information contained herein and certify that my assessment is honest, thorough, and to the best of my ability correct.

Name:

Bob Freiermuth / Joh Freuends

Title

SSTS Inspector 818