

---



---

## Midwest Sewer Services

---



---

P.O. Box 10853 White Bear Lake, MN 55110  
651-492-7550/Brian@Midwestsoiltesting.com

Brian Humpal  
MPCA Licensed Advanced Inspector

---

### SUBSURFACE SEWAGE TREATMENT SYSTEM (SSTS) COMPLIANCE REPORT

---

**Date:** October 6, 2022

**Time:** 2:00 PM

**Owner:** Hilda Dunbar

**Inspection Address:** 8285 River Acres Rd, Cottage Grove, MN 55016

---

### REPORT SUMMARY

I have performed an “MPCA Compliance Inspection” on this system and have reviewed the original design/permit records, along with a previous compliance inspection from 2015, which were on file at Washington County. This very old system (installed in 1990) consists of a pre-cast septic tank and a rock trench drainfield. It should be noted that the average life expectancy of a septic system is approximately 30 years. Schlomka’s Services pumped the septic tank on September 9, 2022.

Predicated on my inspection of the system and my review of the records, it is my opinion that this system presently meets MPCA minimum compliance inspection requirements.


Midwest Sewer Services have been hired to perform a compliance inspection of this SSTS for compliance with local ordinances pursuant to Minn. Stat. § 115.55 (2013). This compliance inspection covers only the criteria required by Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011). A compliance inspection is an indication of the current compliance status of the system and does not guarantee the performance or longevity of this system beyond the date of inspection, as it is impossible to determine the future performance of any system. Midwest Sewer Services disclaim any use of this compliance inspection beyond determining SSTS compliance pursuant to Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011).

Please contact me should you have any questions.




---

Christopher Uebe




---

Brian Humpal

**NOTE:** This report is not complete without the inclusion/attachment of the additional pages which consist of up to three (3) MPCA drafted Compliance Inspection Documents, one (1) Homeowner/Occupant Information Sheet (when obtainable), one (1) site diagram, one (1) log of soil boring(s), one (1) Brian L Humpal, Inc. Disclaimer Sheet, and one (1) MPCA License.

# Compliance inspection report form

## Existing Subsurface Sewage Treatment System (SSTS)

Doc Type: Compliance and Enforcement

**Instructions: Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance.** Instructions for filling out this form are located on the Minnesota Pollution Control Agency (MPCA) website at <https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf>.

### Property information

Local tracking number: \_\_\_\_\_

Parcel ID# or Sec/Twp/Range: \_\_\_\_\_ Reason for Inspection \_\_\_\_\_ Property Transfer \_\_\_\_\_

Local regulatory authority info: Washington CountyProperty address: 8285 River Acres Rd, Cottage Grove, MN 55106Owner/representative: Hilda Dunbar Owner's phone: 651-458-0966

Brief system description: A pre-cast septic tank and a rock trench drainfield.

### System status

System status on date (mm/dd/yyyy): 10/6/2022 **Compliant – Certificate of compliance\***

*(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists in Local Ordinance.)*

**\*Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.**

 **Noncompliant – Notice of noncompliance**

*Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.*

*An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.*

#### Reason(s) for noncompliance (check all applicable)


- Impact on public health (Compliance component #1) – *Imminent threat to public health and safety*
- Tank integrity (Compliance component #2) – *Failing to protect groundwater*
- Other Compliance Conditions (Compliance component #3) – *Imminent threat to public health and safety*
- Other Compliance Conditions (Compliance component #3) – *Failing to protect groundwater*
- System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) – *Failing to protect groundwater*
- Soil separation (Compliance component #5) – *Failing to protect groundwater*
- Operating permit/monitoring plan requirements (Compliance component #4) – *Noncompliant - local ordinance applies*

#### Comments or recommendations

### Certification

*I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.*

**By typing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.**

Business name: Midwest Sewer Services Certification number: 5342/9852
 Inspector signature:  License number: L2896  
 (This document has been electronically signed) Phone: 651-492-7550

### Necessary or locally required supporting documentation (must be attached)

- Soil observation logs    System/As-Built    Locally required forms    Tank Integrity Assessment    Operating Permit
- Other information (list): Report Summary, Property Information, Disclaimer

Property Address: 8285 River Acres Rd, Cottage Grove, MN 55106

Business Name: Midwest Sewer Services

Date: 10/6/2022

**1. Impact on public health – Compliance component #1 of 5****Compliance criteria:**

System discharges sewage to the ground surface	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
System discharges sewage to drain tile or surface waters.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
System causes sewage backup into dwelling or establishment.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No

**Any "yes" answer above indicates the system is an imminent threat to public health and safety.**

**Describe verification methods and results:**

None of the above found.

**Attached supporting documentation:** Other: \_\_\_\_\_ Not applicable**2. Tank integrity – Compliance component #2 of 5****Compliance criteria:**

System consists of a seepage pit, cesspool, drywell, leaching pit, or other pit?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
Sewage tank(s) leak below their designed operating depth?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
If yes, which sewage tank(s) leaks:	

**Any "yes" answer above indicates the system is failing to protect groundwater.**

**Describe verification methods and results:****Attached supporting documentation:** Empty tank(s) viewed by inspector

Name of maintenance business: \_\_\_\_\_

License number of maintenance business: \_\_\_\_\_

Date of maintenance: \_\_\_\_\_

 Existing tank integrity assessment (Attach)

Date of maintenance 9/9/2022

(mm/dd/yyyy):

(must be within three years)

(See form instructions to ensure assessment complies with Minn. R. 7082.0700 subp. 4 B (1))

 Tank is Noncompliant (pumping not necessary – explain below) Other: \_\_\_\_\_

Property Address: 8285 River Acres Rd, Cottage Grove, MN 55106

Business Name: Midwest Sewer Services

Date: 10/6/2022

### 3. Other compliance conditions – Compliance component #3 of 5

3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured?

Yes\*  No  Unknown

3b. Other issues (*electrical hazards, etc.*) to immediately and adversely impact public health or safety?  Yes\*  No  Unknown

**\*Yes to 3a or 3b - System is an imminent threat to public health and safety.**

3c. System is non-protective of ground water for other conditions as determined by inspector?

Yes\*  No

3d. System not abandoned in accordance with Minn. R. 7080.2500?

Yes\*  No

**\*Yes to 3c or 3d - System is failing to protect groundwater.**

**Describe verification methods and results:**

Attached supporting documentation:  Not applicable

### 4. Operating permit and nitrogen BMP\* – Compliance component #4 of 5 Not applicable

Is the system operated under an Operating Permit?

Yes  No **If "yes", A below is required**

Is the system required to employ a Nitrogen BMP specified in the system design?  Yes  No

**If "yes", B below is required**

*BMP = Best Management Practice(s) specified in the system design*

**If the answer to both questions is "no", this section does not need to be completed.**

**Compliance criteria:**

a. Have the operating permit requirements been met?

Yes  No

b. Is the required nitrogen BMP in place and properly functioning?

Yes  No

**Any "no" answer indicates noncompliance.**

**Describe verification methods and results:**

Attached supporting documentation:  Operating permit (Attach)

Property Address: 8285 River Acres Rd, Cottage Grove, MN 55106

Business Name: Midwest Sewer Services

Date: 10/6/2022

### 5. Soil separation – Compliance component #5 of 5

Date of installation 1990  Unknown  
(mm/dd/yyyy)

Shoreland/Wellhead protection/Food beverage lodging?  Yes  No

**Compliance criteria (select one):**

5a. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment:  Yes  No\*  
 Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.

5b. Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment:  Yes  No\*  
 Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.\*

5c. "Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080.2350 or 7080.2400 (Intermediate Inspector License required ≤ 2,500 gallons per day; Advanced Inspector License required > 2,500 gallons per day)  Yes  No\*  
 Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.

**Attached supporting documentation:**

- Soil observation logs completed for the report
- Two previous verifications of required vertical separation
- Not applicable (No soil treatment area)
- Reviewed previous compliance report from 2015.  
 Reviewed design and permit records.

**Indicate depths or elevations**

A. Bottom of distribution media	See Attached Boring Log(s)
B. Periodically saturated soil/bedrock	
C. System separation	
D. Required compliance separation*	

\*May be reduced up to 15 percent if allowed by Local Ordinance.

**\*Any "no" answer above indicates the system is failing to protect groundwater.**

**Describe verification methods and results:**

**Upgrade requirements:** (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.



520 Lafayette Road North  
St. Paul, MN 55155-4194

# Sewage tank maintenance reporting form

## Subsurface Sewage Treatment Systems (SSTS) Program

Doc Type: Compliance and Enforcement

**Purpose:** Management and maintenance of Subsurface Sewage Treatment Systems (SSTS) are important to ensure resource protection and long-term and cost-effective sewage treatment. Completion of this form complies with the sewage tank maintenance requirements under Minn. R. 7080.2450 and 7082.0600. This form *may* be used to certify the compliance status of the sewage tank components of the SSTS. **This form is not a complete SSTS inspection report, only a tank integrity assessment, and may only certify sewage tank compliance status when entirely completed and signed on page 3 by a qualified professional.**

**Instructions:** A copy of this information must be submitted to the system owner within 30 days of the maintenance date and be maintained by the licensed SSTS maintainer business for a period of five (5) years from the maintenance date. Maintenance reporting to the local unit of government *may* be required by local ordinance. Check with your local SSTS program for maintenance reporting protocol. **Page 3 is optional and not required to be completed on routine maintenance events.**

### Secure maintenance hole covers

All maintenance hole covers must be returned to service in a sound and durable condition and be capable of withstanding the anticipated load.

Covers must be re-secured in accordance with Minn. R. 7080.2450, subp. 3, Items C or D:

- Covers installed under local ordinances adopted after February 4, 2008 must be locked, bolted or screwed or must be 95 pounds in weight. They must be made of material suitable for outdoor use, resistant to ultraviolet degradation and leaks, and not susceptible to being slid or flipped. They must have a label warning of hazardous conditions inside the tank. All screw openings must be refastened.
- Covers installed under local ordinances adopted before February 4, 2008 must either be buried with at least 12 inches of soil cover or be secured according to the local ordinance in effect before February 4, 2008.
- Covers must meet item 'a' above when raised to the ground surface or less than 12 inches from the ground surface.

### Reporting information

Date of maintenance (mm/dd/yyyy): 09/09/2022 Reason for maintenance: For Compliance  
 Property address: 8285 River Acres Road Parcel ID: \_\_\_\_\_  
 City: Cottage Grove State: MN Zip code: 55016  
 Property owner's name: Hilda Dunbar  
 Property-owner's address (if different): \_\_\_\_\_  
 City: \_\_\_\_\_ State: \_\_\_\_\_ Zip code: \_\_\_\_\_  
 Phone number: \_\_\_\_\_ Email address: \_\_\_\_\_

1. Did you measure the accumulation of scum and sludge?  Yes  No (tank(s) pumped without measuring)

Tank (check if present)	Scum	Sludge	Operating depth	Percent full
<input type="checkbox"/> Septic/holding tank #1				
<input type="checkbox"/> Septic/holding tank #2				
<input type="checkbox"/> Pretreatment tank				
<input type="checkbox"/> Pump tank				

2. Access used to remove septage:  Maintenance hole  Other (Unless a holding tank, go to #4 below)
3. If the maintenance hole was used, were all covers secured in place?  Yes  No If no, please explain below:

4. If the owner refuses to allow a Subsurface Sewage Treatment System (SSTS) to be pumped through the maintenance hole, have them complete and sign the following statement.

I, \_\_\_\_\_, refuse to allow the removal of the solids and liquids through the maintenance  
(Print owner's name)

hole. I understand that removal of solids and liquids through other access points is not considered a compliant method of solids removal and does not fulfill the solids removal requirements of Minn. R. 7080.2450 and 7082.0600.

**By typing/signing my name below,** I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Owner's signature: \_\_\_\_\_ Date (mm/dd/yyyy): \_\_\_\_\_

Property address: 8285 River Acres Road Parcel ID: \_\_\_\_\_  
 City: Cottage Grove State: MN Zip code: 55016

5. Is the tank designed as a leaky tank? (Example: seepage pit, cesspool, drywell, leaching pit)

Tank #1:  Yes  No Verification method used: Visual  
 Tank #2:  Yes  No Verification method used: \_\_\_\_\_

6. Is there evidence of the following?

Tank (check if present)	Tank leaks below the designed operating depth	Tank leaks above the designed operating depth	Maintenance hole cover is damaged, cracked, unsecured, or appears to be structurally unsound
<input checked="" type="checkbox"/> Septic/holding Tank #1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
<input type="checkbox"/> Septic/holding Tank #2	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/> Pretreatment Tank	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No
<input type="checkbox"/> Pump Tank	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No
Describe detail for any "Yes"			

7. How many gallons of septage were removed?

Tank #1: 1500 Tank #2: \_\_\_\_\_ Pretreatment Tank: \_\_\_\_\_ Pump Tank: \_\_\_\_\_

8. Where was the septage taken?  Wastewater treatment facility  Land application  Other

Explanation (Facility name/Site #): MCES

9. Did you identify any operational issues or unsafe conditions while assessing the sewage tanks in this system?

Yes  No If yes, identify tank and explain:  
 Evidence of non-domestic waste  Baffle(s) condition  Effluent screen condition  
 Maintenance hole and extensions condition  Other conditions (e.g. structural integrity of tank or lid, electrical hazard, etc.)

Explanation: \_\_\_\_\_

10. List any troubleshooting and minor repairs completed or declined by owner:

<input type="checkbox"/> Troubleshooting and repairs conducted:	<input type="checkbox"/> Repairs declined by owner:
_____	_____
_____	_____

Additional comments or suggestions for owner's consideration:


## Pumping record

I personally conducted the work described above on behalf of a Minnesota-licensed SSTS Maintenance Business, in compliance with Minnesota Rules Chapters 7080 – 7083:

As a noncertified individual who has received proper training, daily work review, and periodic observation, or  
 As a designated certified individual of the business listed below.

By typing/signing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

### Company information

Company name: Schlomka Services LLC  
 Business license number: 2989  
 Email: Office@schlomkaservices.com  
 Employee's signature: 

### Employee information

Print name: Michael Castillo  
 Certification number: (if applicable): \_\_\_\_\_  
 Phone number: 651.459.3718  
 Date (mm/dd/yyyy): 09/09/2022

Property address: 8285 River Acres Road

Parcel ID: \_\_\_\_\_

City: Cottage GroveState: MNZip code: 55016

## Optional section: Sewage Tank Compliance Certification (Tank integrity assessment)

This form does not represent a complete system inspection report and only certifies sewage tank compliance status. i.e., this form, completed, may serve as a tank integrity assessment.

**Instructions:** This section of the form may be completed and signed by a Designated Certified Individual (DCI) of a licensed SSTS Maintenance Business who personally conducts the necessary procedures to assess the compliance status of each sewage tank in the system.

When this section of the form is signed by a qualified certified professional, it becomes *necessary supporting documentation* to an Existing System Compliance Inspection Report: Compliance inspection form - Existing system (wq-wwists4-31b). This form can be found on the MPCA website at <https://www.pca.state.mn.us/water/service-and-maintenance>.

The information and certified statement on this form is **required** when existing septic tank compliance status is determined by an individual other than the SSTS Inspector that submits an inspection report. This form represents a third party assessment of SSTS component compliance and is allowable under Minn. R. 7082.0700, subp. 4 Item (B) subitem (1). This form is valid for a period of three years beyond the signature date on this form unless a new evaluation is requested by the owner or owner's agent or is required according to local regulations. Additional Administrative Rule references for this activity can be found at Minn. R. 7082.0700, subp. 4 Items B, C, and D; 7083.0730 Item C.

Pages 1 and 2 are not required to accompany this form when the optional third page is completed and used to certify sewage tank compliance status.

### System status

System status on date (mm/dd/yyyy): 09/09/2022 Certificate of sewage tank compliance Notice of sewage tank non-compliance

#### Compliance criteria:

The SSTS has a seepage pit, cesspool, drywell, leaching pit, or other pit - "Failure to Protect Groundwater."	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
The SSTS has a sewage tank that leaks below the designed operating depth - "Failure to Protect Groundwater."	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
The SSTS presents a threat to public safety by reason of structurally unsound (damaged, cracked, or weak) maintenance hole cover(s) or lids or any other unsafe condition - "Imminent Threat to Public Health or Safety."	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No

*Any "yes" answer above indicates sewage tank non-compliance.*

#### Company information

Company name: Schlomka ServicesBusiness license number: 2989

#### Designated Certified Individual (DCI) information

Print name: Larry SchlomkaCertification number: C4253

*I personally conducted the work described above as a Designated Certified Individual of a Minnesota-licensed SSTS Maintenance Business. I personally conducted the necessary procedures to assess the compliance status of each sewage tank in this SSTS.*

*By typing/signing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.*

Designated Certified Individual's signature: \_\_\_\_\_

Date (mm/dd/yyyy): 09/26/2022



8 of 13  
**Midwest Sewer Testing**

**Subsurface Sewage Treatment System Owner/Property Information**


This information will be used for the purpose of conducting an MPCA Compliance Inspection.

Date of Inspection: October 6, 2022		Time: 2:00 PM	
Property Address: 8285 River Acres Rd, Cottage Grove, MN		Zip: 55016	
Property Owner: Hilda Dunbar		Phone: 651-458-0966	
Tank(s) <input checked="" type="checkbox"/> Septic 1 <input type="checkbox"/> Aerobic <input type="checkbox"/> Lift <input type="checkbox"/> Holding <input type="checkbox"/> Other:	Tank(s)Material <input type="checkbox"/> Fiberglass <input type="checkbox"/> Plastic <input type="checkbox"/> Metal <input checked="" type="checkbox"/> Concrete <input type="checkbox"/> Block <input type="checkbox"/> Other _____	Soil Treatment System <input checked="" type="checkbox"/> Rock trench <input type="checkbox"/> Gravelless trench <input type="checkbox"/> Chamber trench <input type="checkbox"/> Seepage bed <input type="checkbox"/> Mound <input type="checkbox"/> At-grade _____	Other <input type="checkbox"/> Alternative system _____ <input type="checkbox"/> Experimental system _____ <input type="checkbox"/> Cesspool system _____ <input type="checkbox"/> Other system _____
Are the tank maintenance covers accessible? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No *If no, proper maintenance must be performed through the maintenance holes. Maintenance hole covers should be made accessible to the ground surface to facilitate access and proper maintenance of the system.			
Year house built: 1990	Year septic installed: 1990	Tank size (gals.): 1500	
How long has seller owned the property?		Number of residents in home?	
Number of bedrooms? 4	Are all floors drained by gravity?		
Garbage disposal?	Whirlpool bath?		
More than one system (laundry, etc.)?			
Does this property have any footing drain tiles connected to the septic system?			
Are any buildings on this property such as garages or out-buildings connected to this system?			
Are there any additional systems on this property serving other buildings?			
Location of septic system on lot? North Side			
Location of water well on lot? South Side		Is the well a deep well? Y	
Have you ever experienced any problems with the system such as: tree roots, sewage back-ups, surfacing of sewage onto the ground, septic tank overflowing, etc.; or have any repairs been made to the system? If yes, explain:			
When was the system last pumped? 9/9/2022		Name of pumper: Schlomka Services	
How often pumped in previous years?		Is system on a monitoring plan?	
Have you received notices from any government agency concerning this system?			
Is your property located in a shoreland management area? Y			
Do you have any additional information that should be given to the new owner?			

I hereby certify that the above information is correct to the best of my knowledge. I also understand that if the system is considered "non-compliant/failing" per MPCA rules, that the inspector must by law submit a copy of this report to the local government unit within 15 days of the date of inspection completion. I also agree that unless otherwise noted in this report, that I/we are ultimately responsible for payment of all fees for all work performed relative to this inspection by Inspect Minnesota and Midwest Soil Testing

Owner/Occupant: \_\_\_\_\_

Date: \_\_\_\_\_

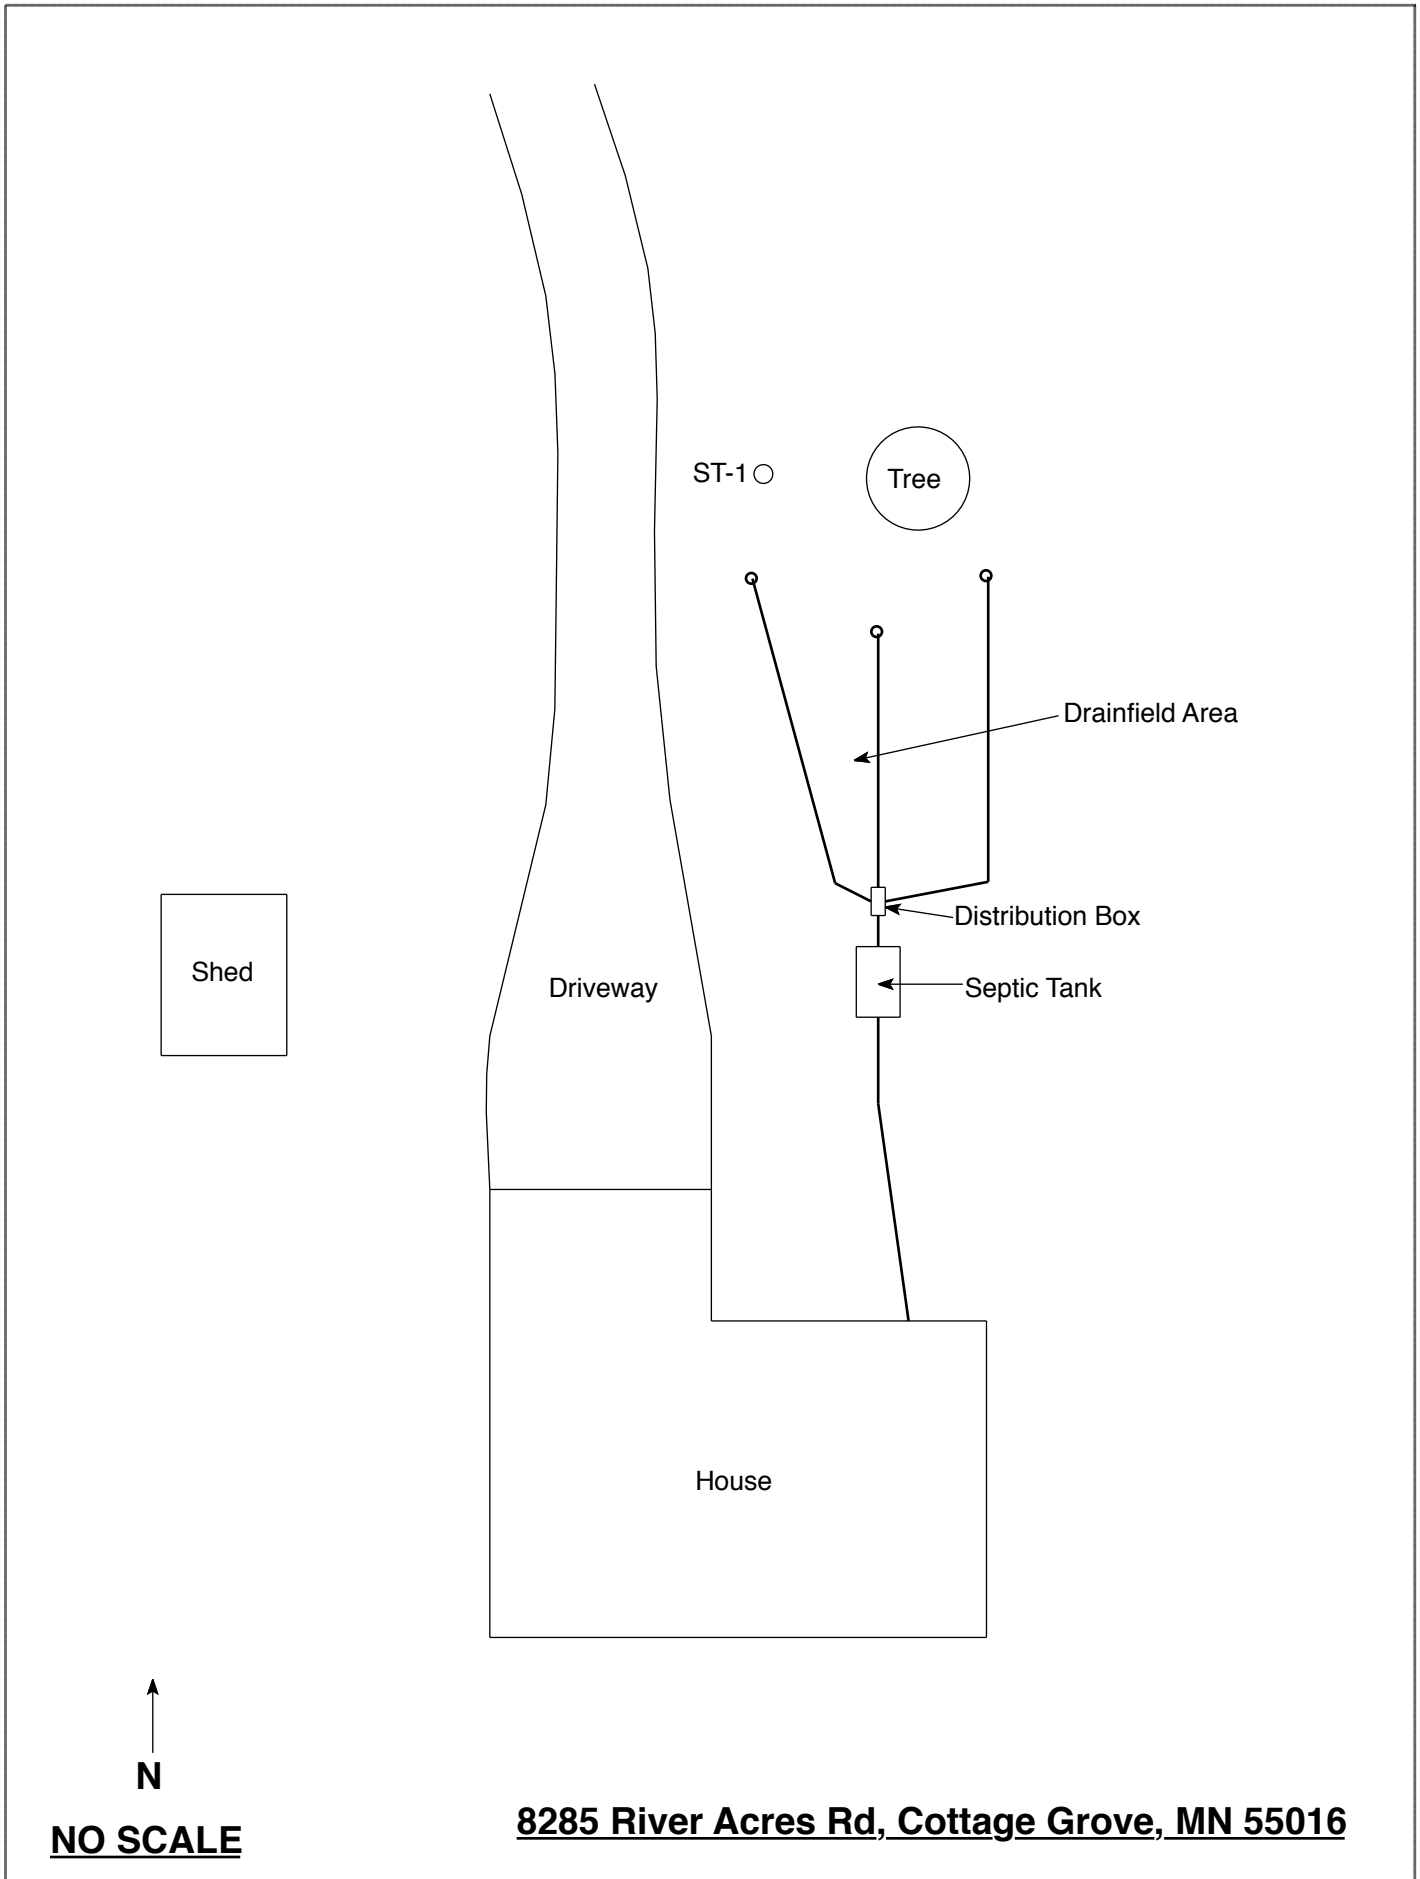

**NO SCALE**

**8285 River Acres Rd, Cottage Grove, MN 55016**

## Soil Observations Log

Location of Project:		8285 River Acres Rd, Cottage Grove, MN 55016			
Observations Made By:		Midwest Sewer Services		Date:	10/6/2022
Classification System:		USDA			
Soil Observation:		ST-1			
Surface Elevation of Observation		Same ground surface as last drainfield trench		Surface Elevation of Observation	
Depth In Inches	Rock %	<u>Soils Encountered</u>		Depth In Inches	Rock %
0-7	≥35	10YR 2/2 Fine Sand (Fill) With Gravel			
7-24		10YR 2/2 Loamy Fine Sand			
24-33		10YR 4/2 Loamy Fine Sand			
33-40		10YR 4/4 Fine Sand			
40-52		10YR 3/4 Fine Sandy Loam			
52-68		10YR 4/4 Fine Sandy Loam			
68-72		10YR 4/4 Fine Sandy Loam (Moist)			
72"	Depth To End Of Soil Observation Or Redox		Depth To End Of Soil Observation Or Redox		
Same	Elevation Of Observation Relative To System		Elevation Of Observation Relative To System		
-35"	Depth To Bottom Of Distribution Media		Depth To Bottom Of Distribution Media		
≥37"	Of Separation		Of Separation		
End Of Soil Observation At:		72"		End Of Soil Observation At:	
Limiting Soil Conditions At:		None		Limiting Soil Conditions At:	
Standing Water Present At:		None		Standing Water Present At:	

Bottom Of Distribution Medium At: 35 Inches

---




---

Signature: \_\_\_\_\_



NT  
NO SCALE

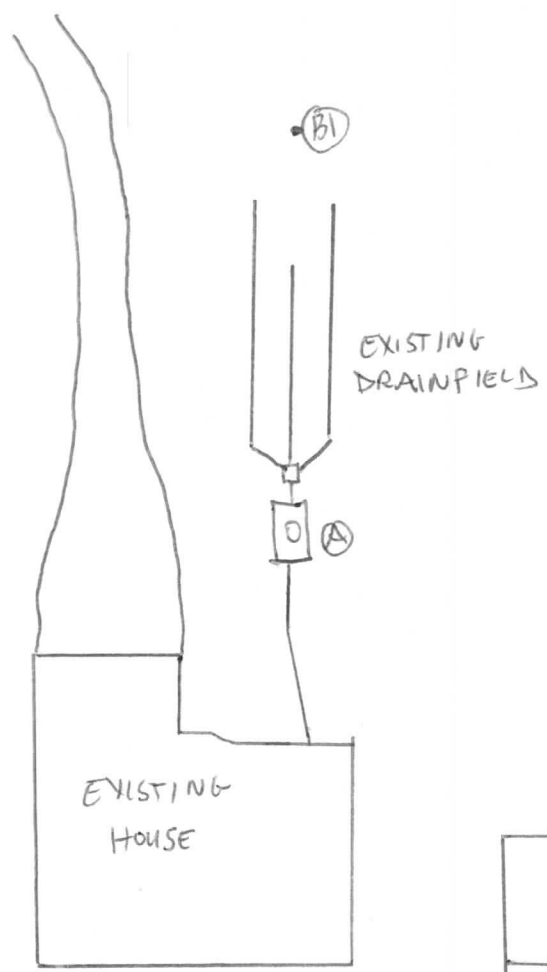

SOIL BORING LOG	
0"-43"	10YR3/3 MEDIUM SAND
43"-50"	10YR3/4 MEDIUM SAND
50"-72"	10YR4/3 MEDIUM SAND

MISSISSIPPI RIVER

## **DISCLAIMER**

### Brian L. Humpal, Inc. dba. Midwest Sewer Services, Inspect Minnesota, Midwest Soil Testing Relative to Subsurface Sewage Treatment System (SSTS) Compliance Inspections

1. This inspection/report is being performed for only the seller/owner of the property on which the SSTS is located. In such case that another party is paying for the inspection, the contract is between only said party and Brian L. Humpal, Inc.; there is no contract between Brian L. Humpal, Inc. and any other party unless otherwise noted.
3. Brian L. Humpal, Inc. has not been retained to warranty, guarantee, or certify the proper functioning of the SSTS for any period of time beyond the date of inspection or into the future. Because of the numerous factors (usage, maintenance, soil characteristics, previous failures, etc.) which may affect the proper operation of an SSTS, as well as the inability of Brian L. Humpal, Inc. to supervise or monitor the use or maintenance of the SSTS, the report shall not be construed as a warranty by Brian L. Humpal, Inc. that the SSTS will function properly for any particular party for any period of time.
4. Brian L. Humpal, Inc. is unable to verify the frequency and/or, quality of prior or future maintenance of the SSTS. Maintenance of the tank(s) must be performed through the tanks maintenance hole. The removal of solids from any location other than the maintenance hole is not a compliant method of maintenance. It is strongly recommended that maintenance covers be made accessible to the ground surface to facilitate proper maintenance.
5. Minimum Compliance Inspection requirements relative to this inspection and this report include only verification that the SSTS has tank(s) (septic tanks, lift tanks, dosing tanks, stilling tanks, etc.) which are watertight below the designed operating depth, the required separation between the bottom of the subsurface soil distribution medium and seasonally saturated soils, no back-ups of sewage into the dwelling, no discharge of sewage/effluent to the ground surface or surface waters, and no imminent safety hazards. Brian L. Humpal, Inc. does not inspect plumbing or pumps prior to the first SSTS component as these are plumbing components. The performance of exterior pumps and associated components are not inspected as they are considered to be maintenance items. Additionally, no indications relative to compliance with electrical code requirements have been made. It is recommended that any other applicable plumbing, electrical, housing, etc. inspections be performed by a qualified inspection business. Sewage back-up verification is limited to observing the floor drain area and/or the information supplied by the last occupants of the building prior to inspection. Brian L. Humpal, Inc. cannot guarantee that the information given to them by the last occupants of the building prior to inspection relative to back-ups is accurate.
4. Certification of this SSTS does not warranty future use beyond the date of the inspection. Any SSTS, old or new, can become hydraulically overloaded or discharge sewage/effluent to the ground surface as a result of more people moving into the house than were previously occupying the house, improper maintenance, heavy usage, leaking plumbing fixtures, groundwater infiltration, tree roots, freezing conditions, surface drainage problems, poor initial design, poor construction practices, or unsuitable materials used in constructing the system; the system can also simply stop working because of its age. An SSTS that has been properly designed and installed, properly maintained, and used in the manner for which the system was designed can be expected to provide service for twenty to twenty-five years on average. Some parts of the SSTS such as alarms, switches, pumps, filters, etc. will most likely have to be repaired or replaced over the lifetime of the system.
5. A Compliance Inspection is not meant to be a test or inspection for longevity of the system; a Compliance Inspection is strictly for the purpose of determining if the SSTS is protective of public health and safety, as well as the groundwater at the date and time the inspection was performed. This inspection is not intended to determine if the SSTS was originally designed or installed to past or present MPCA or other Local Government Unit code requirements. This inspection is not intended to determine if the SSTS was designed and/or installed to support the anticipated flow from the building as the use of the building may have changed since the design and construction of the SSTS due to the addition of bedrooms, occupants, etc. In addition, this inspection is not intended to determine the quality of the original SSTS design, the quality of the construction practices used while installing the SSTS, or the quality of the materials used in constructing the SSTS.
6. Brian L. Humpal, Inc. cannot guarantee the performance of SSTS products/components such as: gravelless pipe, chamber trenches, effluent filters, tanks, sewage pre-treatment components, piping, etc. Products such as gravelless pipe are no longer approved for installation in the State of Minnesota and may have a significantly reduced performance and/or life expectancy.
7. WINTER WORK: By accepting this report, it is understood that inspections conducted during winter months (approximately November 1<sup>st</sup> through April 1<sup>st</sup>) are more difficult to perform because of possible snow cover and/or ground frost. SSTS components such as tanks, maintenance covers, tank inspection pipes, subsurface distribution medium inspection pipes, and soil treatment areas are more difficult or impossible to locate due to snow cover and/or ground frost. In addition, soil borings are more difficult to perform due to snow cover and/or ground frost. Brian L. Humpal, Inc. will attempt to use the same level of standards when performing work during winter periods as when performing work during non-winter periods. However, the recipient of this report understands that because of the aforementioned considerations, the same level of standards may not be possible.
8. By accepting this report, the client understands that Brian L. Humpal, Inc. will not be responsible for any monetary damages exceeding the fee for the services provided.