

ZIERKE SOIL TESTING

Nicholas Pearson
11691 Lansing Ave N
Stillwater, MN 55082

11/22/2023


Dear Nicholas Pearson,

At your request, I have conducted a septic inspection to determine the compliance status of your septic system pursuant to Minnesota Rules Chapter 7080.1500.

The compliance test set out in 7080.1500 has three main inquiries: 1). Is the system functioning hydraulically (disposing of effluent in a manner that prevents it from coming in contact with people)? 2). Are the septic tanks water tight? 3). Does the system have sufficient vertical separation between the bottom of the septic system and restrictive layers (bedrock, standing water, seasonally wet layers, etc) to provide full treatment of effluent?

Based off of these criteria, your septic system is compliant. A certification of compliance is in effect for three years from the date it is issued. To be clear, this should not be construed as a guarantee of future system function – there are too many factors that influence the lifespan of a septic system for an inspector to predict or even guess how long a septic system will last. A copy of this report will be filed with your local unit of government for their records.

Sincerely,



Benjamin Zierke
MPCA Lic 119, Cert 9594

ADDRESS:
28587 Jeffrey Ave
Chisago City, MN 55013

PHONE 651-249-1346
EMAIL benzierke@gmail.com

Compliance inspection report form

Existing Subsurface Sewage Treatment System (SSTS)

Doc Type: Compliance and Enforcement

Instructions: Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance. Instructions for filling out this form are located on the Minnesota Pollution Control Agency (MPCA) website at <https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf>.

Property information

Local tracking number: _____

Parcel ID# or Sec/Twp/Range: 0203021110002 Reason for Inspection Building Permit

Local regulatory authority info: Washington County

Property address: 11691 Lansing Ave N Stillwater, MN 55082

Owner/representative: Nicholas Pearson Owner's phone: _____

Brief system description: (2) 1070 gallon septic tanks, gravity drainfield with chambers

System status

System status on date (mm/dd/yyyy): 11/22/2023

Compliant – Certificate of compliance*

(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists in Local Ordinance.)

***Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.**

Noncompliant – Notice of noncompliance

Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.

An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.

Reason(s) for noncompliance (check all applicable)

- Impact on public health (Compliance component #1) – *Imminent threat to public health and safety*
- Tank integrity (Compliance component #2) – *Failing to protect groundwater*
- Other Compliance Conditions (Compliance component #3) – *Imminent threat to public health and safety*
- Other Compliance Conditions (Compliance component #3) – *Failing to protect groundwater*
- System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) – *Failing to protect groundwater*
- Soil separation (Compliance component #5) – *Failing to protect groundwater*
- Operating permit/monitoring plan requirements (Compliance component #4) – *Noncompliant - local ordinance applies*

Comments or recommendations

Certification

I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.

By typing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Business name: Zierke Soil Testing Certification number: 9594

Inspector signature: Benjamin Zierke License number: 119

(This document has been electronically signed) Phone: 651-249-1346

Necessary or locally required supporting documentation (must be attached)

- Soil observation logs
- System/As-Built
- Locally required forms
- Tank Integrity Assessment
- Operating Permit
- Other information (list): _____

1. Impact on public health – Compliance component #1 of 5

Compliance criteria:

System discharges sewage to the ground surface	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
--	--

System discharges sewage to drain tile or surface waters.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
---	--

System causes sewage backup into dwelling or establishment.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
---	--

Any "yes" answer above indicates the system is an imminent threat to public health and safety.

Describe verification methods and results:

None of the above observed.

Attached supporting documentation:

Other: _____
 Not applicable

2. Tank integrity – Compliance component #2 of 5

Compliance criteria:

System consists of a seepage pit, cesspool, drywell, leaching pit, or other pit?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
--	--

Sewage tank(s) leak below their designed operating depth?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
---	--

If yes, which sewage tank(s) leaks:	
-------------------------------------	--

Any "yes" answer above indicates the system is failing to protect groundwater.

Describe verification methods and results:

See attached tank integrity form.

Attached supporting documentation:

Empty tank(s) viewed by inspector
 Name of maintenance business: _____
 License number of maintenance business: _____
 Date of maintenance: _____

Existing tank integrity assessment (Attach)
 Date of maintenance (mm/dd/yyyy): 8/2/2023
 (must be within three years)

(See form instructions to ensure assessment complies with Minn. R. 7082.0700 subp. 4 B (1))

Tank is Noncompliant (pumping not necessary – explain below)
 Other: _____

3. Other compliance conditions – Compliance component #3 of 5

3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured?

Yes* No Unknown

3b. Other issues (*electrical hazards, etc.*) to immediately and adversely impact public health or safety? Yes* No Unknown

***Yes to 3a or 3b - System is an imminent threat to public health and safety.**

3c. System is non-protective of ground water for other conditions as determined by inspector?

Yes* No

3d. System not abandoned in accordance with Minn. R. 7080.2500?

Yes* No

***Yes to 3c or 3d - System is failing to protect groundwater.**

Describe verification methods and results:

Attached supporting documentation: Not applicable

4. Operating permit and nitrogen BMP* – Compliance component #4 of 5 Not applicable

Is the system operated under an Operating Permit?

Yes No **If “yes”, A below is required**

Is the system required to employ a Nitrogen BMP specified in the system design? Yes No

If “yes”, B below is required

BMP = Best Management Practice(s) specified in the system design

If the answer to both questions is “no”, this section does not need to be completed.

Compliance criteria:

a. Have the operating permit requirements been met?

Yes No

b. Is the required nitrogen BMP in place and properly functioning?

Yes No

Any “no” answer indicates noncompliance.

Describe verification methods and results:

Attached supporting documentation: Operating permit (Attach)

5. Soil separation – Compliance component #5 of 5

Date of installation 8/13/2011 Unknown
(mm/dd/yyyy)

Shoreland/Wellhead protection/Food beverage lodging? Yes No

Compliance criteria (select one):

5a. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment: Yes No*
Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.

5b. Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment: Yes No*
Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*

5c. "Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080.2350 or 7080.2400 (Intermediate Inspector License required ≤ 2,500 gallons per day; Advanced Inspector License required > 2,500 gallons per day) Yes No*
Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.

Attached supporting documentation:

- Soil observation logs completed for the report
- Two previous verifications of required vertical separation
- Not applicable (No soil treatment area)
- _____

Indicate depths or elevations

A. Bottom of distribution media	99.2'
B. Periodically saturated soil/bedrock	95.5'+
C. System separation	3.7'+
D. Required compliance separation*	3.0'

*May be reduced up to 15 percent if allowed by Local Ordinance.

***Any "no" answer above indicates the system is failing to protect groundwater.**

Describe verification methods and results:

See attached boring log and elevations.

Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

**Relative Elevations
in Decimal Feet:**

B1: 100.0
B1 Restriction: 95.5+
Bottom of chamber: 99.2
B1 Separation: 3.7
Benchmark: 104.5
(cover on 2nd septic tank)



11691

(5) 70' chambers

B1

Logs of Soil Borings

Location of Project: 11691 Lansing Ave N Stillwater, MN 55082

Borings Made by Ben Zierke

Date:

9/21/2023

Hand bucket auger used for borings; USDA - SCS Soil Classification used.

Depth, in Inches	Boring Number 1	Depth, in Inches	Boring Number 2
0-----	-----	0-----	-----
0-9"	10YR 3/3 loamy sand, 15% rock		
9-28"	10YR 4/4 loamy sand, 10% rock		
28-54"	7.5YR 5/4 medium sand, 5% rock		
	*no restriction observed		

End of boring at 4.5 feet

Standing water table:

Present at _____ feet of depth _____ Hours after boring

Standing water not present in hole

Mottled Soil:

Observed at _____ feet of depth

Mottled soil not present in bore hole

Comments:

End of boring at _____ feet

Standing water table:

Present at _____ feet of depth _____ Hours after boring

Standing water not present in hole

Mottled Soil:

Observed at _____ feet of depth

Mottled soil not present in bore hole

Comments:

Depth, in Inches	Boring Number 3	Depth, in Inches	Boring Number 4
0-----	-----	0-----	-----

End of boring at _____ feet

Standing water table:

Present at _____ feet of depth _____ Hours after boring

Standing water not present in hole

Mottled Soil:

Observed at _____ feet of depth

Mottled soil not present in bore hole

Comments:

End of boring at _____ feet

Standing water table:

Present at _____ feet of depth _____ Hours after boring

Standing water not present in hole

Mottled Soil:

Observed at _____ feet of depth

Mottled soil not present in bore hole

Comments:



Department of Public Health and Environment
 14949 62nd Street North PO Box 6
 Stillwater MN 55082-0006
 Office: 651-430-6655 TTY: 651-430-6246 Fax: 651-430-6730

Review Fee:	\$285.00
Permit Fee:	\$300.00
Total Fee:	\$585.00
Previous Payment	\$585.00
Balance Due	\$0.00

Scanned 7-16-13

Community: Grant
Permit Number: 2700-13-11
Owner: Paul Farseth
 11691 Lansing AVE N
 Stillwater MN 55082-
Applicant: Paul Farseth

PERMISSION IS HEREBY GRANTED

To execute the work specified in this permit on the following identified property upon express condition that said persons and their agents, and employees shall conform in all respects to the provisions of Ordinance #179, Washington County Development Code, Chapter Four, Subsurface Sewage Treatment System Regulations. This permit may be revoked at any time upon violation of any of the provisions of said ordinance.

Project Address: 11691 Lansing AVE N
Geo Code: 02-030-21-11-0002
Designer: Zierke Soil Testing


Type of System: Drainfield		Pressure Distribution	
		N/A	
Design Criteria	Drainfield Sizing		
Percolation Rate: 2	Square Feet:	1000	
Depth To Restriction: 60	Lineal:	333	Feet
Land Slope: 9.00%	Depth Of Rock Below:	6	Inches
Flow Rate: 600	Maximum Trench Depth:	24	Inches
Number of Bedrooms: 4	Number Of Trenches:	5	
<input type="checkbox"/> Gravelless	Length Of Trenches:	67	Feet
<input type="checkbox"/> Chambered	Spacing Of Trenches:	7.5	Feet
Tank Sizes			
Tank 1: 1250	Tank 2: 1000	Tank 3: 0	Lift Station: 0

2700-13-11

Authorized Work/Special Conditions

Permit Issue Date: 7/16/2013
 Permit Expiration Date: 7/16/2014

Pete Ganzel
 Senior Environmental Specialist

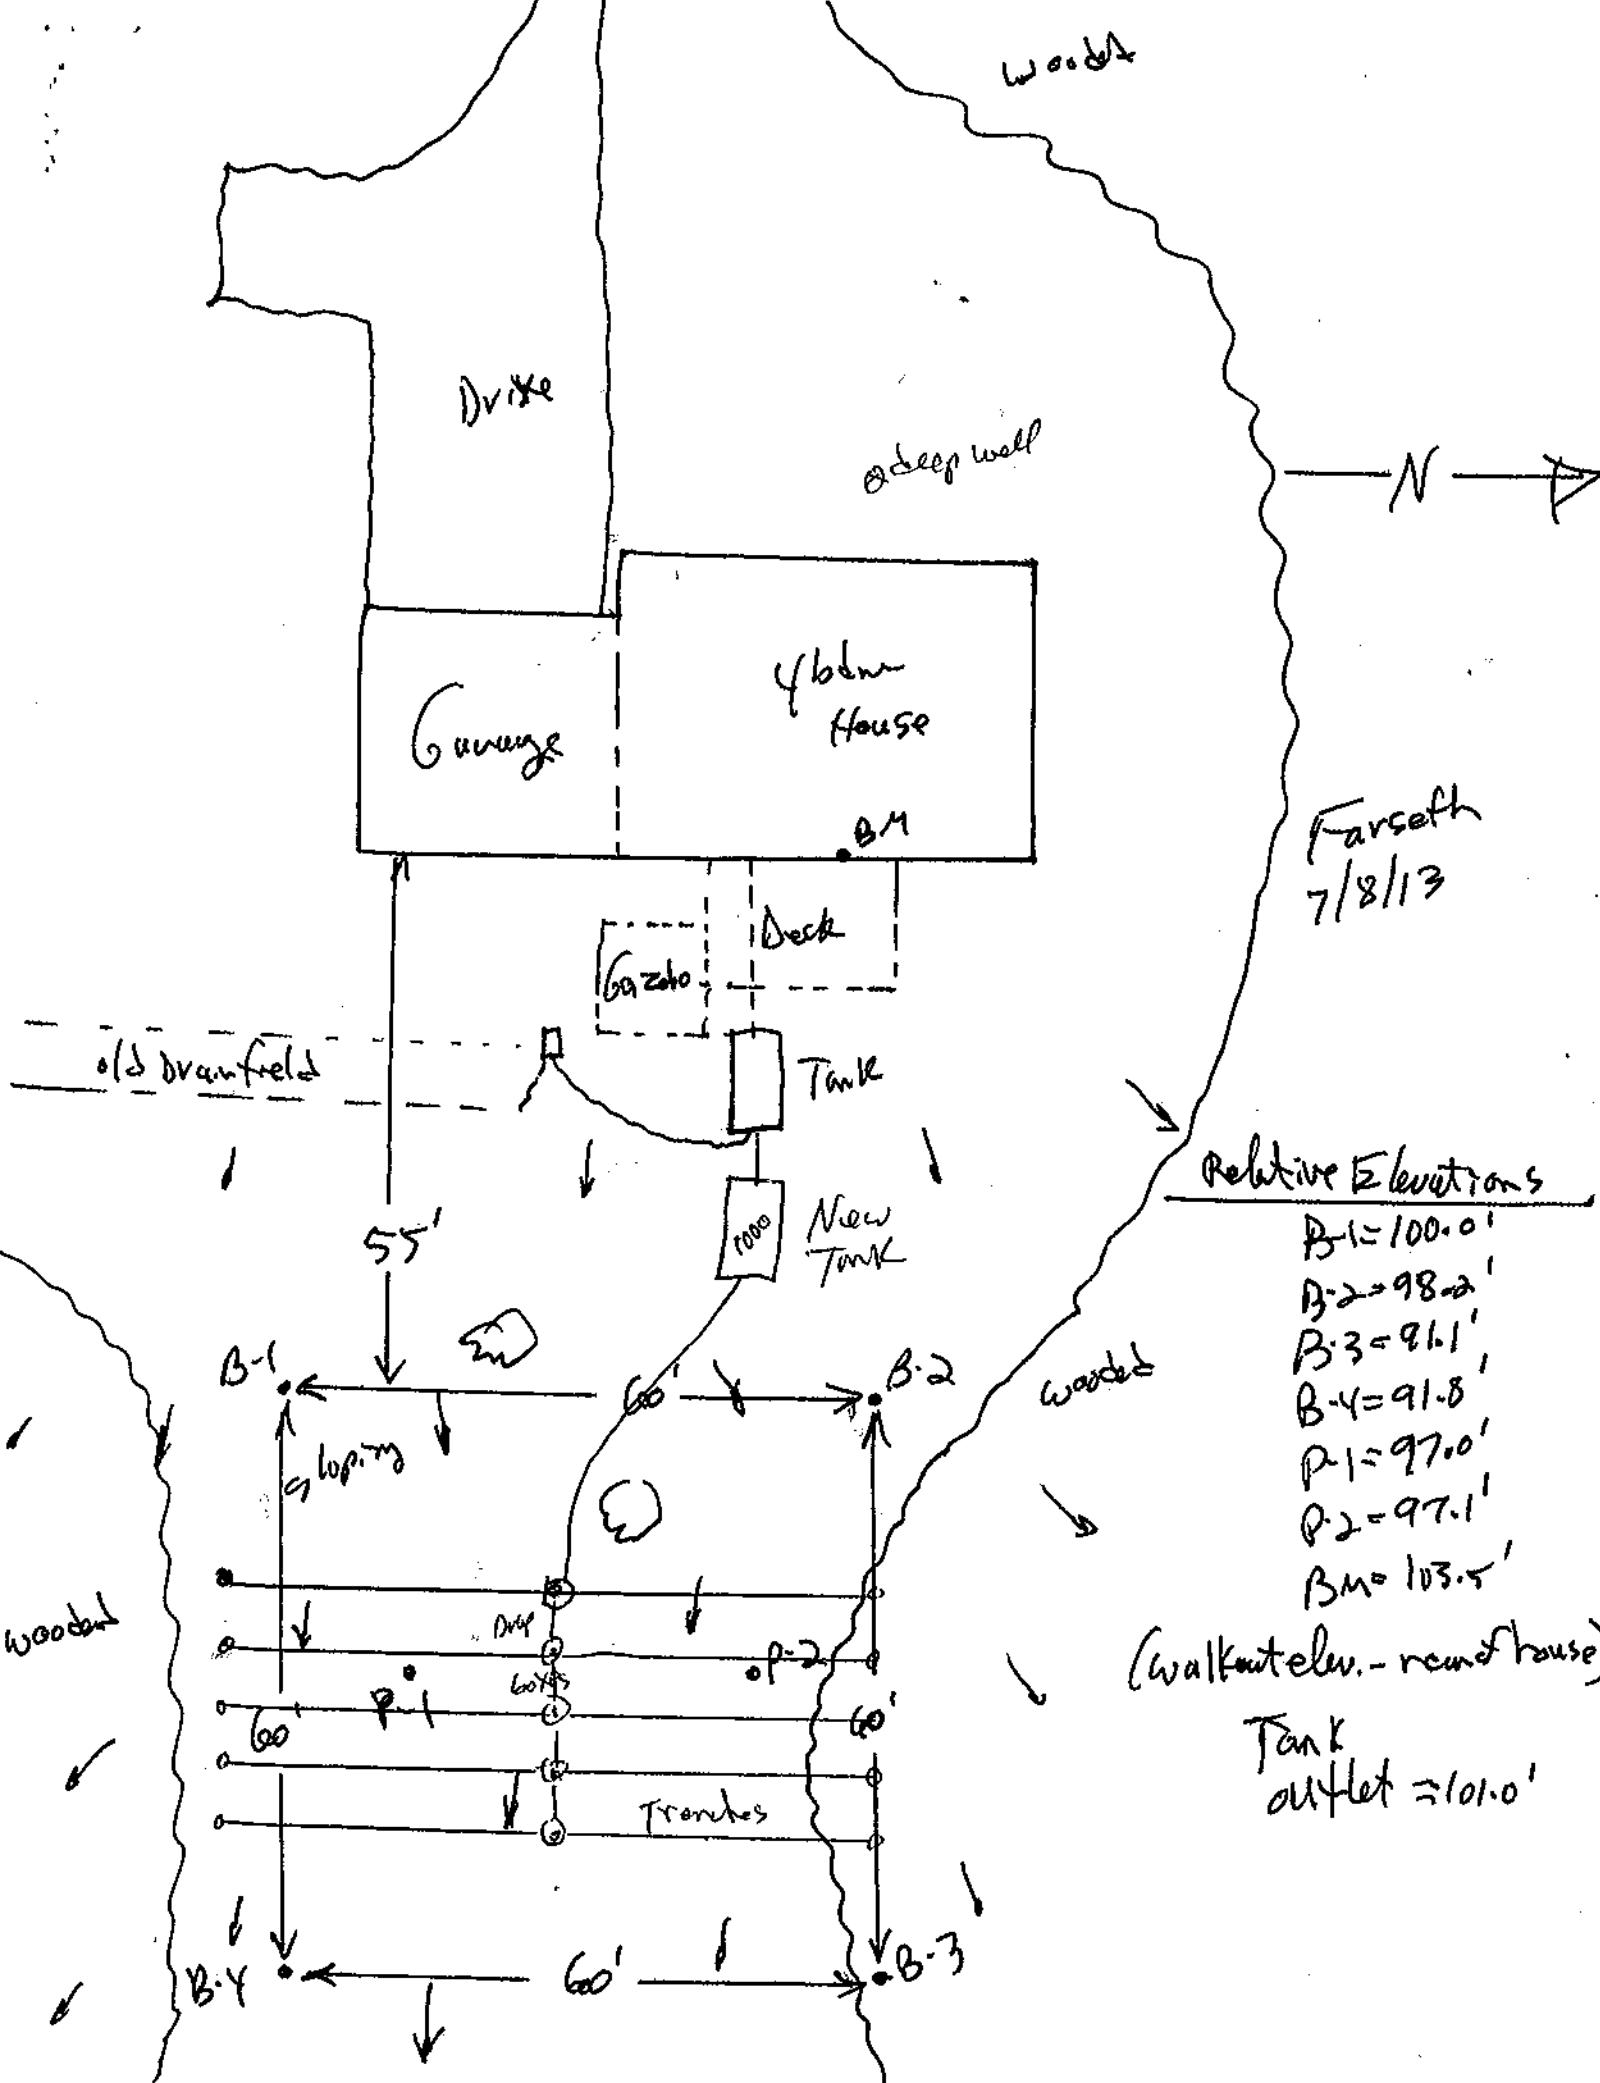



SEPTIC PERMIT APPLICATION

Washington County Department of Public Health & Environment
14949-62nd St N, P.O. Box 6, Stillwater MN 55082-0006
651.430.6655 FAX: 651.430.6730

2013

PERMIT NUMBER
2700-13-11

PROPERTY & APPLICANT INFORMATION

PROPERTY ADDRESS: 11691 Lansing Ave N ^{Grant} GEOCODE: 0203021110002

USE OF BUILDING: SINGLE FAMILY HOME NON-SINGLE FAMILY APPLICATION TYPE: NEW REPLACEMENT

APPLICANT

NAME(S) Paul & Georganne FARSETH ADDRESS CITY 11691 Lansing Ave N ZIP 55082 PHONE NUMBER(S) 651-430-1075
651-491-8128 cell

OWNER (IF DIFFERENT FROM APPLICANT)

NAME(S) ADDRESS CITY ZIP PHONE NUMBER(S)

SYSTEM TYPE

TYPE I SYSTEM (Trenches, Pressure Bed, Mound, At-Grade) ? TYPE II SYSTEM (Floodplain, Holding Tanks, Privy) TYPE III SYSTEM

TYPE IV SYSTEM (System using Registered Products) TYPE V SYSTEM MSTs (>5,000 GPD) LOT SPLIT

DRAINFIELD ? PRESSURE BED MOUND AT-GRADE TANK REPLACEMENT SUBDIVISION REVIEW

FEE SCHEDULE - 2012

INSTALLATION PERMITS

SOIL/SITE REVIEW APPLICATION FEE* \$285
*This fee does not apply to: Reissuance of Expired Permits, Tank Replacement, Lot Split or Subdivision Approval, or System Abandonment Permits APPLICATION FEE: 285.00

PERMIT FEE - PRIVY OR HOLDING TANK \$117

PERMIT FEE - DRAINFIELD OR PRESSURE BED \$300

PERMIT FEE - MOUND OR AT-GRADE \$480

PERMIT FEE - NON SINGLE FAMILY

1-500 GALLONS PER DAY \$730

501-1000 GALLONS PER DAY \$875

1001-5000 GALLONS PER DAY \$1,100

5001-999 GALLONS PER DAY \$1,300

10,000 GALLONS PER DAY OR GREATER MPCA PERMIT REQUIRED

PERMIT FEE - HOLDING TANK REPLACEMENT (NO SOIL TEST/SITE REVIEW) \$117

PERMIT FEE - SYSTEM ABANDONMENT \$117

PERMIT FEE - REISSUANCE OF EXPIRED PERMIT 50% of permit fee (does not include initial soil/site review fee)

Make Checks Payable to WASHINGTON COUNTY TOTAL PERMIT FEE = APPLICATION FEE + PERMIT FEE: \$585.00

SUBDIVISION PERMITS

SUBDIVISION SOIL/SITE REVIEW-APPLICATION FEE \$200 + \$85 PER LOT SUBDIVISION REVIEW BASE FEE: _____

LOT SPLIT APPROVAL \$200 + \$85 PER LOT + _____

LOTS: _____ X \$85 PER LOT _____

Make Checks Payable to WASHINGTON COUNTY TOTAL SUBDIVISION REVIEW OR LOT SPLIT APPROVAL FEE: _____

The following exhibits are required as part of the application and shall be attached hereto: Percolation Test Reports; Soil Boring Logs; Site Plan drawn to scale showing location of buildings, lot lines, percolation test holes, soil boring holes, proposed location of system and location of well(s); one (1) copy of the System Design; and one (1) copy of the Final Building Plan. The house and drainfield areas must be staked. Inaccurate or incomplete information will result in delays in processing.

AGREEMENT: The undersigned hereby makes Application for Permit to Install or Extend the Sewage Treatment System herein specified, agreeing that all work shall be done in strict accordance with ordinances and regulations of the County of Washington, Minnesota. Applicant agrees that the Site Plan, Sketches, and Design submitted herewith, and which are reviewed by Washington County, together with any requirements and/or restrictions made necessary by conditions peculiar to a particular location, shall become part of the permit. Applicant further agrees to provide access, at reasonable times, to Washington County for the purpose of performing inspections required and that no part of the system shall be covered until it has been inspected and accepted. APPLICATION IS FOR AN INSTALLATION AT A SPECIFIC LOCATION; ANY DEVIATION FROM THE APPROVED LOCATION WILL VOID THE PERMIT. It shall be the responsibility of the applicant for the permit to notify the Office of the Washington County Department of Public Health & Environment that the installation is ready for inspection.

PERMITS WILL NOT BE ISSUED ONCE FROZEN GROUND CONDITIONS EXIST due to the inability to conduct soil reviews unless arrangements are made BY THE APPLICANT to provide a backhoe, geo-probe, or any other device that can penetrate the frozen soil to allow Washington County to conduct a soil review. In accordance with Minnesota Statute 15.99, Subdivision 2, Washington County has up to SIXTY (60) DAYS to review and approve or deny the permit application.

I hereby certify the above to be true and correct. I hereby give the Washington County Department of Public Health & Environment permission to enter upon my property during normal business hours for the purpose of determining the suitability of the location, design, and construction, which may include minor excavations or soil borings by the Department.

Paul H. Farseth
Signature of Applicant (Owner or Contractor)

July 12, 2013
Date

U of MN Onsite Sewage Treatment Program Soil Boring Log

Client/ Address: 1169 Leansing Legal Description/GPS: P. Bernd Date: 7/12/13

Soil Parent Material(s): Till Outwash ICE contact
 (circle all that apply)

Landscape Position: Summit Shoulder Back/Side Slope Foot Slope Toe Slope
 (circle one)

Vegetation: grass/forest Slope (%): _____ Slope Shape: _____

Weather conditions/Time of Day: _____

Depth (in)	Texture	Matrix Color(s)	Mottle Color(s)	Redox Kind(s)	Saturated Soil Indicator(s) (see back)	I-----I		
						Shape	Grade	Consistence
0-8	Loamy Sand	10 3/3	N	Concentrations Depletions Gleyed		Granular Platy Blocky Prismatic Single Grain Massive	Weak Moderate Strong Loose	Loose Friable Firm Extremely Firm Rigid
9-27	Loamy sand + rocks 30-50%	10 5/4	N	Concentrations Depletions Gleyed	-PAIN A at 60"	Granular Platy Blocky Prismatic Single Grain Massive	Weak Moderate Strong Loose	Loose Friable Firm Extremely Firm Rigid
28-60	Loamy sand mscl podsol	10 5/6	N	Concentrations Depletions Gleyed		Granular Platy Blocky Prismatic Single Grain Massive	Weak Moderate Strong Loose	Loose Friable Firm Extremely Firm Rigid
				Concentrations Depletions Gleyed		Granular Platy Blocky Prismatic Single Grain Massive	Weak Moderate Strong Loose	Loose Friable Firm Extremely Firm Rigid
				Concentrations Depletions Gleyed		Granular Platy Blocky Prismatic Single Grain Massive	Weak Moderate Strong Loose	Loose Friable Firm Extremely Firm Rigid
				Concentrations Depletions Gleyed		Granular Platy Blocky Prismatic Single Grain Massive	Weak Moderate Strong Loose	Loose Friable Firm Extremely Firm Rigid

Comments: Extended P-1
Deb 60"

LOGS OF SOIL BORINGS

Location of Project Paul Farseth, 5 acres, Sec. 2, City of Grant, Washington Co.

Borings Made by Chris Zjerke

Date: 7/8/13

Hand bucket auger used for borings; USDA – SCS Soil Classification used.

Depth, In Feet	Boring Number 1
0-----	
0-8"	Dark-brown loamy sand(10YR-3/3)
8-24"	Yellowish-brown loamy sand(10YR-5/4 pebbles common
	obstruction

End of boring at 2 feet.

Standing water table:

Present at feet of depth, hours after boring.

Standing water not present in hole .

Mottled Soil:

Observed at feet of depth.

Mottled soil not present in bore hole .

Comments:

Depth, In Feet	Boring Number 2
0-----	
0-6"	Dark-brown loamy sand(3/3)
6-18"	Dark yellowish-brown loamy sand(10Y R-4/4), pebbles common
	obstruction

End of boring at 1.5 feet.

Standing water table:

Present at feet of depth, hours after boring.

Standing water not present in hole .

Mottled Soil:

Observed at feet of depth.

Mottled soil not present in bore hole .

Comments:

Depth, In Feet	Boring Number 3
0-----	
0-6"	Dark-brown loamy sand(3/3)
6-18"	Dark y-brown loamy sand(4/4), pebbles common
	obstruction

End of boring at 1.5 feet.

Standing water table:

Present at feet of depth, hours after boring.

Standing water not present in hole .

Mottled Soil:

Observed at feet of depth.

Mottled soil not present in bore hole .

Comments:

Depth, In Feet	Boring Number 4
0-----	
0-6"	Dark-brown loamy sand(3/3)
6-18"	Dark y-brown loamy sand(4/4), pebbles common
18-54"	Strong-brown loamy sand(7.5YR-4/6), pebbles common
	obstruction

End of boring at 4.5 feet.

Standing water table:

Present at feet of depth, hours after boring.

Standing water not present in hole .

Mottled Soil:

Observed at feet of depth.

Mottled soil not present in bore hole .

Comments:

C&B EXCAVATING/SEWER, INC.


16115 Quality Trail North Scandia, MN 55073

(651) 433-3986 FAX (651) 433-4481

COMPLETE SEPTIC SYSTEM SERVICES

Installation • Tank Pumping • Line Cleaning • Pump Repairs • Compliance Inspections
 Frozen Sewerlines Thawed • Ground Thawing • Basement/Driveway Excavation • Hauling
 MPCA CERTIFIED LICENSE #484 BONDED • INSURED

11691 Lansing Ave 100.

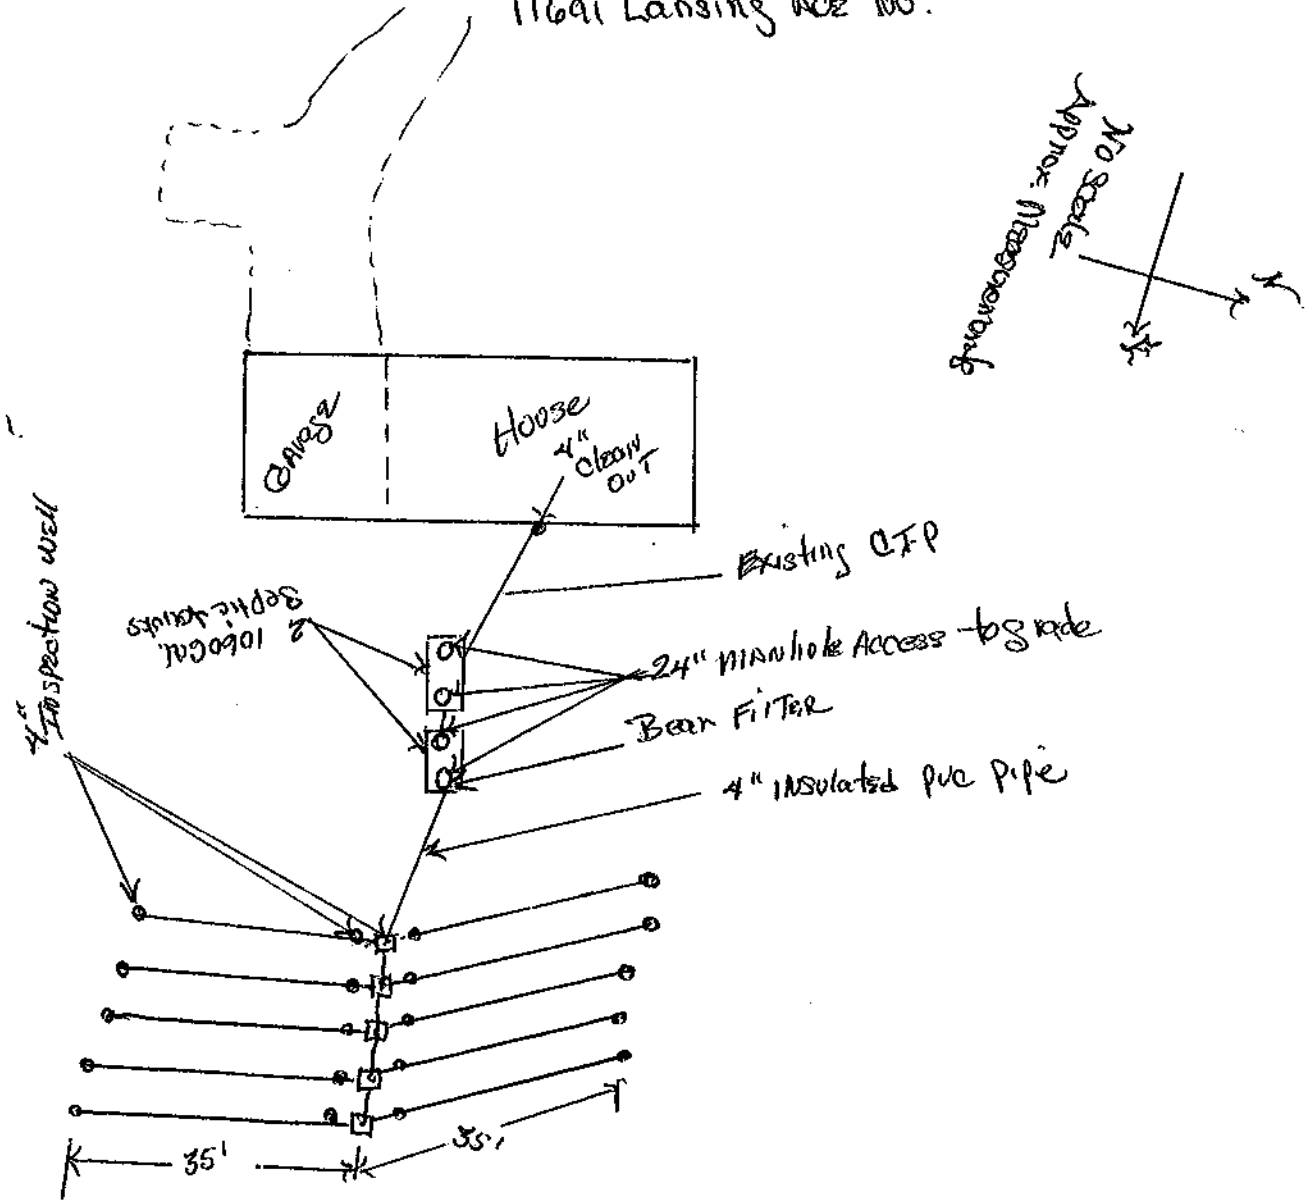

Installed 8-13-11

C&B Excavating & Sewer Pro

two 1060 gal. Septic tanks in series

1. Bear Filter in outlet of 2nd tank

30' Insulated PVC

Chambers (Hi-cap) drop boxes/inspection wells

Property address: 11691 Lansing Ave No
City: Stillwater State: MN

Parcel ID: _____
Zip code: 55082

Optional section: Sewage Tank Compliance Certification (Tank integrity assessment)

This form does not represent a complete system inspection report and only certifies sewage tank compliance status. i.e., this form, completed, may serve as a tank integrity assessment.

Instructions: This section of the form may be completed and signed by a Designated Certified Individual (DCI) of a licensed SSTS Maintenance Business who personally conducts the necessary procedures to assess the compliance status of each sewage tank in the system.

When this section of the form is signed by a qualified certified professional, it becomes *necessary supporting documentation* to an Existing System Compliance Inspection Report: Compliance inspection form - Existing system (wq-wwists4-31b). This form can be found on the MPCA website at <https://www.pca.state.mn.us/water/service-and-maintenance>.

The information and certified statement on this form is **required** when existing septic tank compliance status is determined by an individual other than the SSTS Inspector that submits an inspection report. This form represents a third party assessment of SSTS component compliance and is allowable under Minn. R. 7082.0700, subp. 4 Item (B) subitem (1). This form is valid for a period of three years beyond the signature date on this form unless a new evaluation is requested by the owner or owner's agent or is required according to local regulations. Additional Administrative Rule references for this activity can be found at Minn. R. 7082.0700, subp. 4 Items B, C, and D; 7083.0730 Item C.

Certificate of sewage tank compliance

Affirm all three statements:

- The SSTS does not contain a seepage pit, cesspool, drywell, leaching pit, or other pit.
- It does not contain a sewage tank that was designed to be watertight, but subsequently leaks below the designed operating depth.
- It does not represent an imminent safety threat by reason of unsecured, damaged, or weak maintenance hole cover(s) or other unsafe condition.

Notice of sewage tank non-compliance

Select all that apply:

- The SSTS has a seepage pit, cesspool, drywell, leaching pit, or other pit – **"Failure to Protect Groundwater."**
- It has a sewage tank that was designed to be watertight, but subsequently leaks below the designed operating depth – **"Failure to Protect Groundwater."**
- It presents a threat to public safety by reason of unsecured, damaged, or weak maintenance hole cover(s) or other unsafe condition – **"Imminent Threat to Public Health or Safety."**

Company information

Company name: Pinkys Sewer Service
Business license number: 4251

Designated Certified Individual (DCI) information

Print name: Neil Chymer
Certification number: C2814

I personally conducted the work described above as a Designated Certified Individual of a Minnesota-licensed SSTS Maintenance Business. I personally conducted the necessary procedures to assess the compliance status of each sewage tank in this SSTS.

By typing/signing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Designated Certified Individual's signature: Neil Chymer Date (mm/dd/yyyy): 8/2/23