### **Inspect Minnesota & Midwest Soil Testing**

P.O. Box 383 Hugo, MN 55038

Brian Humpal

651-492-7550/Brian@midwestsoiltesting.com

MPCA Licensed Advanced Inspector

### SUBSURFACE SEWAGE TREATMENT SYSTEM (SSTS) COMPLIANCE REPORT

**Inspection Address:** 150 Talahi Dr, Mahtomedi, MN 55115

### REPORT SUMMARY

I have performed an "MPCA Compliance Inspection" on this system, have reviewed the history of the system with the owner, Mark Pietig, and have reviewed the original design/permit records, along with a previous compliance inspection from 2014, which were on file at Washington County. This system consists of two pre-cast septic tanks and a rock trench drainfield.

Predicated on my inspection of the system, my review of the history of the system with the owner, and my review of the records, it is my opinion that this system <u>presently meets</u> MPCA minimum compliance inspection requirements.

Inspect Minnesota and Midwest Soil Testing have been hired to perform a compliance inspection of this SSTS for compliance with local ordinances pursuant to Minn. Stat. § 115.55 (2013). This compliance inspection covers only the criteria required by Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011). A compliance inspection is an indication of the current compliance status of the system and does not guarantee the performance or longevity of this system beyond the date of inspection, as it is impossible to determine the future performance of any system. Inspect Minnesota and Midwest Soil Testing disclaim any use of this compliance inspection beyond determining SSTS compliance pursuant to Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011).

Please contact me should you have any questions.

Brian Humpal



### **Compliance Inspection Form**

### Existing Subsurface Sewage Treatment Systems (SSTS)

Doc Type: Compliance and Enforcement

<b>Instructions:</b> Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached forms – additional local requirements may also apply.	For local tracking purposes:						
Submit completed form to Local Unit of Government (LUG) and system owner within 15 days							
System Status							
System status on date (mm/dd/yyyy):11/21/2016							
<u> </u>	npliant – Notice of Noncompliance rade Requirements on page 3)						
Reason(s) for noncompliance (check all applicable)							
☐ Impact on Public Health (Compliance Component #1) – Imminent threat to public health and safety ☐ Other Compliance Conditions (Compliance Component #3) – Imminent threat to public health and safety ☐ Tank Integrity (Compliance Component #2) – Failing to protect groundwater ☐ Other Compliance Conditions (Compliance Component #3) – Failing to protect groundwater ☐ Soil Separation (Compliance Component #4) – Failing to protect groundwater ☐ Operating permit/monitoring plan requirements (Compliance Component #5) – Noncompliant							
Property Information Parcel ID# or Sec/Twp/Range	ge:						
	or inspection: Requested By City						
Property owner: Mark & Lisa Pietig Owner's  or	phone: 651-434-1041						
	ntative phone:						
	ry authority phone: 651-430-4052						
Brief system description: Two pre-cast septic tanks and a rock trench drainfield.							
Comments or recommendations:							
Certification							
I hereby certify that all the necessary information has been gathered to determine the determination of future system performance has been nor can be made due to unknown possible abuse of the system, inadequate maintenance, or future water usage.							
Inspector name: Brian Humpal Certificat	ion number: <u>L5342</u>						
	nse number: _L2896						
Inspector signature: Brian Humpal Pho	one number: 651-492-7550						
Necessary or Locally Required Attachments							
· · · · ·	local ordinance						
☐ Other information (list): Report Summary, Property Information, Disclaimer, Lic							

1.	Impact on Public Health – Compliance component #1 of 5									
	Compliance criteria:			Verification method(s):						
		stem discharge sewage to the bund surface.	☐ Yes	⊠ No		Searched for surface outlet Searched for seeping in yard/backup in				
		stem discharge sewage to drain tile surface waters.	☐ Yes	⊠ No	<ul> <li>☑ Excessive ponding in soil syste</li> <li>☑ Homeowner testimony (See Cor</li> </ul>					
		stem cause sewage backup into relling or establishment.	☐ Yes	⊠ No		"Black soil" above soil dispersal system System requires "emergency" pumping Performed dye test				
		Any "yes" answer above indicates the system is an Imminent Threat to Public Health and Safety.				<ul> <li>☐ Unable to verify (See Comments/Explanation)</li> <li>☐ Other methods not listed (See Comments/Explanation)</li> </ul>				
		mments/Explanation: one of the above found.								
2.	Ta	nk Integrity – Compliance con	nponent	#2 of 5						
	Co	Compliance criteria:			Ve	erification method(s):				
		stem consists of a seepage pit,	☐ Yes	⊠ No		Probed tank(s) bottom				
		sspool, drywell, or leaching pit.  epage pits meeting 7080.2550 may be								
		mpliant if allowed in local ordinance.				Examined Tank Integrity Form (Attach)  Observed liquid level below operating d	epth			
		wage tank(s) leak below their signed operating depth.	☐ Yes	⊠ No		Examined empty (pumped) tanks(s)	<b>-</b>			
		res, which sewage tank(s) leaks:				Probed outside tank(s) for "black soil"				
	A	Any "yes" answer above indicates the system is Failing to Protect Groundwater.				<ul> <li>☐ Unable to verify (See Comments/Explanation)</li> <li>☑ Other methods not listed (See Comments/Explanation)</li> </ul>				
Comments/Explanation:										
	Lo	wered underwater camera into tanks -	baffles a	nd tank wa	alls OK.					
3.	01	her Compliance Conditions	– Comp	oliance co	mponent #3	3 of 5				
	a.	•					Unknown			
							Unknown			
Explain:										
	c. System is non-protective of ground water for other conditions as determined by inspector ☐ Yes* ☒ No *System is failing to protect groundwater									
	Explain:									

Property address: 150 Talahi Dr, Mahtomedi, MN 55115

Inspector initials/Date: \_\_11/21/2016

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • 30 of MTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12

4.	Soil Separation — Compliance compor	nent #4 o	f 5				
	Date of installation: 1995	Unkn	iown	Verification method(s):			
	Shoreland/Wellhead protection/Food Beverage Lodging?	⊠ Yes □ No		Soil observation does not expire. Previous soil			
	Compliance criteria:		s	observations by two independent pa unless site conditions have been alt			
	For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment:	Yes		requirements differ.  ☐ Conducted soil observation(s) (Attach boring logs) ☐ Two previous verifications (Attach boring logs) ☐ Not applicable (Holding tank(s), no drainfield)			
	Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.			☐ Unable to verify (See Comments/Explanation) ☐ Other (See Comments/Explanation)			
	Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment:	⊠ Yes	s □ No	Comments/Explanation:			
				Reviewed previous compliance insp	ection from 2014.		
				Reviewed design and permit records	S.		
	Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*						
	"Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules (7080. 2350 or 7080.2400 (Advanced Inspector License required)  Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.	☐ Yes	□No	Indicate depths of elevations			
				A. Bottom of distribution media	See Attached Boring Log(s)		
				B. Periodically saturated soil/bedrock C. System separation			
	Saturated Soll of Dedrock.			D. Required compliance separation*			
	Any "no" answer above indicates the system is Failing to Protect Groundwater.			*May be reduced up to 15 percent if allowed by Local Ordinance.			
5.	Operating Permit and Nitrogen B	<b>MP*</b> – C	ompliance	component #5 of 5 Not appl	icable		
	Is the system operated under an Operating Per	mit?	☐ Yes 🛭	No If "yes", A below is required			
	Is the system required to employ a Nitrogen BMP?						
	BMP=Best Management Practice(s) specified in the system design						
If the answer to both questions is "no", this section does not need to be completed.  Compliance criteria							
	b. Is the required nitrogen BMP in place and	☐ Yes ☐ No					
	Any "no" answer indicates Noncompliance.						

Upgrade Requirements (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

wq-wwists4-31 • 1/24/12 Page 3 of 3

800-657-3864

www.pca.state.mn.us •

Property address: 150 Talahi Dr, Mahtomedi, MN 55115

Inspector initials/Date: 11/21/2016

### **Inspect Minnesota & Midwest Soil Testing**


### Subsurface Sewage Treatment System Owner/Property Information

This information will be used for the purpose of conducting an MPCA Compliance Inspection.

Date of Inspection: November 21, 2016	Time: 10:00 AM					
Property Address: 150 Talahi Dr, Mahtomedi, MN	Zip: 55115					
Property Owner: Mark & Lisa Pietig	Phone: 651-434-1041					
Tank(s)       Tank(s)Material       Soil Tree            □ Septic 2       □ Fiberglass       □ Rock         □ Aerobic       □ Plastic       □ Grav         □ Lift       □ Metal       □ Char	Alternative system elless trench					
	<u> </u>					
Year house built: 1995 Year septic installed	9 /					
	Number of residents in home? 4					
	rs drained by gravity? Lower Pumped //hirlpool bath? Y					
More than one system (laundry, etc.)? N	miipooi vaui: 1					
Does this property have any footing drain tiles connected to the septic system? N						
Are any buildings on this property such as garages or out-buildings connected to this system? N						
Are there any additional systems on this property serving other buildings? N						
Location of septic system on lot? East Side						
Location of water well on lot? City Water	Is the well a deep well? N/A					
Have you ever experienced any problems with the system such as: tree roots, sewage back-ups, surfacing of sewage onto the ground, septic tank overflowing, etc.; or have any repairs been made to the system? N If yes, explain:						
When was the system last pumped? 2015	Name of pumper: Pinky's Sewer Service					
How often pumped in previous years? Every 2						
Have you received notices from any government agency concerning this system? N						
Is your property located in a shoreland management area? N						
Do you have any additional information that should be given to the new owner? N						

I hereby certify that the above information is correct to the best of my knowledge. I also understand that if the system is considered "non-compliant/failing" per MPCA rules, that the inspector must by law submit a copy of this report to the local government unit within 15 days of the date of inspection completion. I also agree that unless otherwise noted in this report, that I/we are ultimately responsible for payment of all fees for all work performed relative to this inspection by Inspect Minnesota and Midwest Soil Testing.

Owner/Occupant: Mark Pietig's Signature On File Date: 11/21/2016

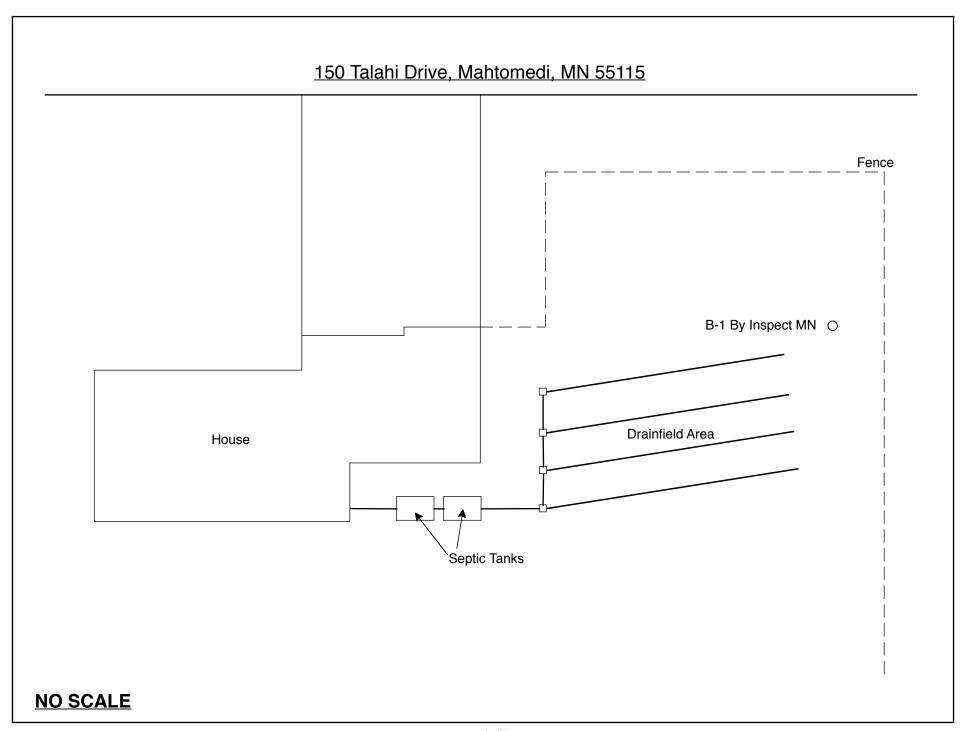

### **Log Of Soil Borings**

Location of Project: 150 Talahi Dr, Mahtomedi, MN 55115					
	orings Made By:	Inspect Minnesota		Date:	11/21/16
Auger Used: Hand/Bucket			Class	ification System:	USDA
Boring Number: 1				Boring Number:	
Surface Same groun		und surface as last nfield trench	Surface Elevation Boring		
Depth In Inches	Soils E	ncountered	Depth In Inches	Soils Er	<u>icountered</u>
0-12 12-31 31-45 45-57 57-68 68-75	Inches         Solls Encountered           0-12         10YR 2/2 Medium Sand           12-31         10YR 4/3 Fine Sand           31-45         10YR 5/4 Fine Sand           45-57         10YR 4/4 Medium Sand With           Trace Of Gravel           57-68         10YR 5/4 Fine Sand With           7.5YR 4/4 Lamellae Banding				
68" Depth To End Of Boring Or Redox		Depth To End Of Boring Or Redox		oring Or Redox	
Same Elevation Of Boring Relative To System			Elevation Of Boring	Relative To System	
-33" Depth To Bottom Of Distribution Media =35" Of Separation			Depth To Bottom C Of Separation	f Distribution Media	
E	End Of Boring At:	75"		End Of Boring At:	
Redox Present At: 68"				Redox Present At:	
Standing V	Water Present At:	None	Standing	Water Present At:	

Bottom Of Distribution Medium At: 33 Inches

### **DISCLAIMER**

### Brian L. Humpal, Inc. dba. Inspect Minnesota, Midwest Soil Testing Relative to Subsurface Sewage Treatment System (SSTS) Compliance Inspections

- 1. This inspection/report is being performed for only the seller/owner of the property on which the SSTS is located. In such case that another party is paying for the inspection, the contract is between only said party and Brian L. Humpal, Inc.; there is no contract between Brian L. Humpal, Inc. and any other party unless otherwise noted.
- 3. Brian L. Humpal, Inc. has not been retained to warranty, guarantee, or certify the proper functioning of the SSTS for any period of time beyond the date of inspection or into the future. Because of the numerous factors (usage, maintenance, soil characteristics, previous failures, etc.) which may affect the proper operation of an SSTS, as well as the inability of Brian L. Humpal, Inc. to supervise or monitor the use or maintenance of the SSTS, the report shall not be construed as a warranty by Brian L. Humpal, Inc. that the SSTS will function properly for any particular party for any period of time.
- 4. Brian L. Humpal, Inc. is unable to verify the frequency and/or, quality of prior or future maintenance of the SSTS. Maintenance of the tank(s) must be performed through the tanks maintenance hole. The removal of solids from any location other than the maintenance hole is not a compliant method of maintenance. It is strongly recommended that maintenance covers be made accessible to the ground surface to facilitate proper maintenance.
- 5. Minimum Compliance Inspection requirements relative to this inspection and this report include <u>only</u> verification that the SSTS has tank(s) (septic tanks, lift tanks, dosing tanks, stilling tanks, etc.) which are watertight below the designed operating depth, the required separation between the bottom of the subsurface soil distribution medium and seasonally saturated soils, no back-ups of sewage into the dwelling, no discharge of sewage/effluent to the ground surface or surface waters, and no imminent safety hazards. Brian L. Humpal, Inc. does not inspect plumbing or pumps prior to the first SSTS component as these are plumbing components. The performance of exterior pumps and associated components are not inspected as they are considered to be maintenance items. Additionally, no indications relative to compliance with electrical code requirements have been made. It is recommended that any other applicable plumbing, electrical, housing, etc. inspections be performed by a qualified inspection business. Sewage back-up verification is limited to observing the floor drain area and/or the information supplied by the last occupants of the building prior to inspection. Brian L. Humpal, Inc. cannot guarantee that the information given to them by the last occupants of the building prior to inspection relative to back-ups is accurate.
- 4. Certification of this SSTS does not warranty future use beyond the date of the inspection. Any SSTS, old or new, can become hydraulically overloaded or discharge sewage/effluent to the ground surface as a result of more people moving into the house than were previously occupying the house, improper maintenance, heavy usage, leaking plumbing fixtures, groundwater infiltration, tree roots, freezing conditions, surface drainage problems, poor initial design, poor construction practices, or unsuitable materials used in constructing the system; the system can also simply stop working because of its age. An SSTS that has been properly designed and installed, properly maintained, and used in the manner for which the system was designed can be expected to provide service for twenty to twenty-five years on average. Some parts of the SSTS such as alarms, switches, pumps, filters, etc. will most likely have to be repaired or replaced over the lifetime of the system.
- 5. A Compliance Inspection is not meant to be a test or inspection for longevity of the system; a Compliance Inspection is strictly for the purpose of determining if the SSTS is protective of public health and safety, as well as the groundwater at the date and time the inspection was performed. This inspection is not intended to determine if the SSTS was originally designed or installed to past or present MPCA or other Local Government Unit code requirements. This inspection is not intended to determine if the SSTS was designed and/or installed to support the anticipated flow from the building as the use of the building may have changed since the design and construction of the SSTS due to the addition of bedrooms, occupants, etc. In addition, this inspection is not intended to determine the quality of the original SSTS design, the quality of the construction practices used while installing the SSTS, or the quality of the materials used in constructing the SSTS.
- 6. Brian L. Humpal, Inc. cannot guarantee the performance of SSTS products/components such as: gravelless pipe, chamber trenches, effluent filters, tanks, sewage pre-treatment components, piping, etc. Products such as gravelless pipe are no longer approved for installation in the State of Minnesota and may have a significantly reduced performance and/or life expectancy.
- 7. WINTER WORK: By accepting this report, it is understood that inspections conducted during winter months (approximately November 1<sup>st</sup> through April 1<sup>st</sup>) are more difficult to perform because of possible snow cover and/or ground frost. SSTS components such as tanks, maintenance covers, tank inspection pipes, subsurface distribution medium inspection pipes, and soil treatment areas are more difficult or impossible to locate due to snow cover and/or ground frost. In addition, soil borings are more difficult to perform due to snow cover and/or ground frost. Brian L. Humpal, Inc. will attempt to use the same level of standards when performing work during winter periods as when performing work during non-winter periods. However, the recipient of this report understands that because of the aforementioned considerations, the same level of standards may not be possible.
- 8. By accepting this report, the client understands that Brian L. Humpal, Inc. will not be responsible for any monetary damages exceeding the fee for the services provided.

# Sulbsurface Sewage Treatment Systems

Non-transferable



License # L2896

Maintainer License Expires:

Adv Inspector License Expires:

Oct 28, 2015 Dec 22, 2016 Dec 22, 2016 Dec 22, 2016 Dec 22, 2016

Adv Designer License Expires:

Date of Issuance:

Installer License Expires:

### Certification

Inspect Minnesota, Midwest Soil Testing

Expires

10/15/2017 10/15/2017

Advanced Designer (Certified) Advanced Inspector (Certified)

Maintainer (Certified)

Certification Type

**Designated Certified** 

Individual (DCI) Brian L. Humpal Brian L. Humpal Brian L. Humpal Brian L. Humpal Brian L. Humpal

10/15/2017

10/15/2017

10/15/2017

Service Provider (Certified)

Installer (Certified)

Designer (Certified) Inspector (Certified)

Christopher R. Uebe Christopher R. Uebe

03/04/2018

03/04/2018

Steven Giddings Manager Environmental Business Assistance Section



## Minnesota Pollution Control Agency

520 Lafayette Road North St. Paul, Minnesota 55155-4194