

## SSTS MAINTENANCE REPORT

### System Location

Address <u>13895 236th St N</u>		Telephone Number <u>651 235 1247</u>	
City <u>Scandia</u>	State <u>MN</u> ZIP <u>55073</u>	Property ID No./GEO Code	
Owner <u>Jim Semlak</u>		Pumping Date <u>6/3/16</u>	
<b>Contractor</b>			
Maintainer <u>DT Septic Services</u>	MPCA License No. <u>#3663</u>	Telephone Number <u>(763) 286-1815</u>	

### What was done to the system?

Tank(s) Pumped  
 Sludge and scum measured.  
 Do tanks need to be pumped?  
 Yes  No (If no provide measurements below)

### Report Liquid Capacity in Gallons

Tank 1: 1000  Pumped Tank 2: 300+  Pumped  
 Tank 3: \_\_\_\_\_  Pumped Tank 4: \_\_\_\_\_  Pumped  
 Total Gallons Pumped: 1300+

Visual Inspection (note any problems with the system):


NOTE: This does not serve as a compliance inspection.

### \*Tank Measurements-Use Only If Tank(s) Were NOT Pumped

Liquid Level of Tank (Distance from invert of outlet pipe to bottom of tank) \_\_\_\_\_ in.

Sludge Level \_\_\_\_\_ in. + Scum Level \_\_\_\_\_ in. = Total Sludge and Scum Level \_\_\_\_\_

Total Sludge and Scum Level \_\_\_\_\_ / Liquid Level \_\_\_\_\_ = Percent Sludge and Scum in Tank \_\_\_\_\_ %

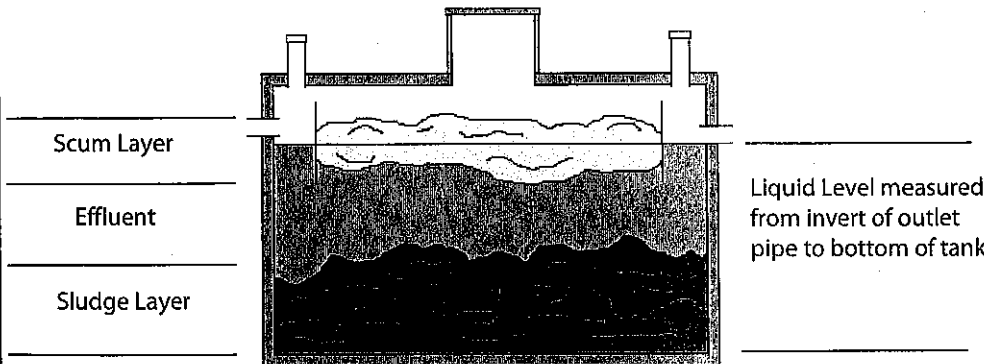

\*Tanks must be pumped if either of the following conditions exist:  
 1. The top of the sludge layer is less than 12 inches from the bottom of the outlet baffle; or  
 2. Total sludge and scum volume is greater than 25 percent of the tank's liquid capacity.

Signature [Handwritten Signature]

Date \_\_\_\_\_

Reset Form