Inspect Minnesota & Midwest Soil Testing

P.O. Box 10853 White Bear Lake, MN 55110 651-492-7550/Brian@Midwestsoiltesting.com

Brian Humpal

MPCA Licensed Advanced Inspector

SUBSURFACE SEWAGE TREATMENT SYSTEM (SSTS) COMPLIANCE REPORT

Date: June 15, 2017 **Time:** 1:15 PM **Owner:** Mike Gallagher

Inspection Address: 8627 Stillwater Blvd N, Lake Elmo, MN 55042

REPORT SUMMARY

I have performed an "MPCA Compliance Inspection" on this system and have reviewed the history of the system with the owner, Mike Gallagher, and have reviewed the original design/permit records, along with a previous compliance inspection from 2005, which were on file at the City of Lake Elmo. This very old system (installed in 1991) consists of a pre-cast septic tank, a pre-cast lift tank, and a rock trench drainfield.

Predicated on my inspection of the system, my review of the history of the system with the owner, and my review of the original design/permit records, it is my opinion that this system presently meets MPCA minimum compliance inspection requirements.

Inspect Minnesota and Midwest Soil Testing have been hired to perform a compliance inspection of this SSTS for compliance with local ordinances pursuant to Minn. Stat. § 115.55 (2013). This compliance inspection covers only the criteria required by Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011). A compliance inspection is an indication of the current compliance status of the system and does not guarantee the performance or longevity of this system beyond the date of inspection, as it is impossible to determine the future performance of any system. Inspect Minnesota and Midwest Soil Testing disclaim any use of this compliance inspection beyond determining SSTS compliance pursuant to Minn. Stat. § 115.55 Subd. 5a (2013) and Minn. R. 7080.1500 (2011).

Please contact me should you have any questions.

Brian Humpal



Compliance Inspection Form

Existing Subsurface Sewage Treatment Systems (SSTS)

	Doc Type: Compliance and Enforcement
Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached forms – additional local requirements may also apply.	For local tracking purposes:
Submit completed form to Local Unit of Government (LUG) and system owner within 15 days	
System Status	
System status on date (mm/dd/yyyy): 6/15/2017	
·	npliant – Notice of Noncompliance rade Requirements on page 3)
Reason(s) for noncompliance (check all applicable)	
☐ Impact on Public Health (Compliance Component #1) – Imminent threat to	public health and safety
Other Compliance Conditions (Compliance Component #3) – Imminent thr	•
☐ Tank Integrity (Compliance Component #2) – Failing to protect groundwate	er
☐ Other Compliance Conditions (Compliance Component #3) – Failing to pro	-
☐ Soil Separation (Compliance Component #4) – Failing to protect groundw	
☐ Operating permit/monitoring plan requirements (Compliance Component ‡	‡5) – Noncompliant
Property Information Parcel ID# or Sec/Twp/Range	
• •	or inspection: Property Transfer
Property owner: Mike Gallagher Owner's p	phone: 651-779-2994
Owner's representative: Represer	stative phone:
Local regulatory authority: Washington County Regulator	y authority phone: 651-430-4052
Brief system description: A pre-cast septic tank, a pre-cast lift tank, and a rock trend	h drainfield
Comments or recommendations:	
Certification	
I hereby certify that all the necessary information has been gathered to determine the of determination of future system performance has been nor can be made due to unknow possible abuse of the system, inadequate maintenance, or future water usage.	,
Inspector name: Brian Humpal Certificati	on number: _L5342
	se number: L2896
Inspector signature: Brian Humpal Pho	ne number: 651-492-7550
Necessary or Locally Required Attachments	
	local ordinance
☐ Other information (list): Report Summary, Property Information, Disclaimer, Lice	

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12 Page 1 of 3 Property address: 8627 Stillwater Blvd N, Lake Elmo, MN 55042

Inspector initials/Date: 06/15/2017

1.	Impact o	on Public Health – Co	mpliance c	omponer	nt #1 of 5				
	Complian	nce criteria:				erification method(s	-		
	System dis ground sur	scharge sewage to the face.	☐ Yes □	⊠ No		1 0	in yard/b	-	
	System dis	charge sewage to drain tile waters.	☐ Yes [⊠ No			y (See Co	mments/E	Explanation)
		use sewage backup into establishment.	☐ Yes 🏻	⊠ No		System requires "eme Performed dye test	-	-	
	Any "yes" answer above indicates the an Imminent Threat to Public Health a					Unable to verify (See		nents/Explanation) See Comments/Explanation)	
	Comments/Explanation: None of the above found.								
2.	Tank Int	cegrity – Compliance cor	mponent #2	2 of 5					
	Compliar	nce criteria:			Ve	erification method(s):		
		nsists of a seepage pit, drywell, or leaching pit.	☐ Yes 🏻	⊠ No		Probed tank(s) bottom Examined constructio		.	
		s meeting 7080.2550 may be allowed in local ordinance.				Examined Tank Integroups Conserved liquid level	rity Form	(Attach)	lenth
		nk(s) leak below their perating depth.	☐ Yes □	⊠ No		Examined empty (pun Probed outside tank(s	nped) tan	ks(s)	opu.
	If yes, which	ch sewage tank(s) leaks:							ion)
		s" answer above indic is Failing to Protect Gr		er.	 ☐ Unable to verify (See Comments/Explanation) ☐ Other methods not listed (See Comments/Explanation) 				
	Comments/Explanation: Lowered underwater camera into tanks - baffles and tank walls				lo OK				
		and alarm were operational at							
		·		·					
3.		ompliance Conditions							П
		nance hole covers are damage				-		_	Unknown
		sues (electrical hazards, etc.) to m is an imminent threat to pu	-			public health or safety.	∐ Yes*	⊠ No	Unknown
	Explain	:							
	-	is non-protective of ground wa m is failing to protect ground		conditions	s as determ	ined by inspector	∕es* ⊠	No	
	Explain	:							

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12 Page 2 of 3

Prop	erty address: _ 8627 Stillwater Blvd N, Lake Eli	mo, MN 550	42	In	spector initials/Date:	06/15/2017 BH		
4.	Soil Separation – Compliance compor	nent #4 of 5	5					
	Date of installation: 1991	Unknov	vn	Verificat	tion method(s):			
	Shoreland/Wellhead protection/Food Beverage Lodging?	☐ Yes ▷		Soil obse	rvation does not expire.			
	Compliance criteria:		u	unless sit	observations by two independent parties are sufficient, unless site conditions have been altered or local			
	For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment:	⊠ Yes □] No	requirements differ. Conducted soil observation(s Two previous verifications (At	ttach boring logs)			
	Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.				le to verify (See Commen (See Comments/Explanat			
	Non-performance systems built April 1,	☐ Yes ☐	□No	Commen	Comments/Explanation:			
	1996, or later or for non-performance systems located in Shoreland or Wellhead			Reviewed	eviewed previous compliance inspection from 200			
	Protection Areas or serving a food, beverage, or lodging establishment:			Reviewed	d design and permit reco	ords.		
	Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*							
-	"Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules (7080. 2350 or 7080.2400 (Advanced Inspector License required)	☐ Yes ☐] No	Indicate	depths of elevation	S		
				A. Bottom	of distribution media	See Attached Boring Log(s)		
	Drainfield meets the designed vertical separation distance from periodically				cally saturated soil/bedrocl	k		
	saturated soil or bedrock.							
	Approfite all approved the sections in				D. Required compliance separation* *May be reduced up to 15 percent if allowed by Local			
	Failing to Protect Groundwater.				Ordinance.			
_	0 41 10 11 1111 1 1	11D# -						
5.	Operating Permit and Nitrogen B		-					
	Is the system operated under an Operating Per		□ Yes ⊠	•	es", A below is require			
	Is the system required to employ a Nitrogen BN			-	es", B below is require	d		
	BMP=Best Management Practice(s) specification	_	_					
	If the answer to both questions is "no",	this section	on does n	ot need to	be completed.			
	Compliance criteria							
	a. Operating Permit number:				☐ Yes ☐ No			
		ve the Operating Permit requirements been met?						
	b. Is the required nitrogen BMP in place and	properly fun	nctioning?	☐ Ye	s 🗌 No			
	Any "no" answer indicates Noncom	pliance.						

Upgrade Requirements (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wq-wwists4-31 • 1/24/12 Page 3 of 3


Inspect Minnesota & Midwest Soil Testing Subsurface Sewage Treatment System Owner/Property Information

This information will be used for the purpose of conducting an MPCA Compliance Inspection.

Date of Inspection: June 15, 2017	Time: 1:15 PM						
Property Address: 8624 Stillwater Blvd N, Lake Elmo, MN	Zip: 55042						
Property Owner: Mike Gallagher	Phone: 651-779-2994						
Tank(s) Tank(s)Material Soil Treatment System	Other Alternative system Experimental system Cesspool system Other system						
Are the tank maintenance covers accessible? Yes No *If no, proper maintenance must be performed through the maintenance holes. Maintenance hole covers should be made accessible to the ground surface to facilitate access and proper maintenance of the system.							
1	Tank size (gals.): 1000						
	sidents in home? 1						
Number of bedrooms? 4 Are all floors drained by g	, i						
Garbage disposal? N Whirlpool bath?	N						
More than one system (laundry, etc.)? N							
Does this property have any footing drain tiles connected to the se	eptic system? N						
Are any buildings on this property such as garages or out-buildings connected to this system? N							
Are there any additional systems on this property serving other buildings? N							
Location of septic system on lot? South side							
J I	e well a deep well? N/A						
Have you ever experienced any problems with the system such as: tree roots, sewage back-ups, surfacing of sewage onto the ground, septic tank overflowing, etc.; or have any repairs been made to the system? Y If yes, explain:Replaced lift pump in approximately 2005.							
When was the system last pumped? 05/12/2017 Name of pumper: Pinky's Sewer Service							
How often pumped in previous years? Every 3 years Is system on a monitoring plan? N							
Have you received notices from any government agency concerning this system? N							
Is your property located in a shoreland management area? N Do you have any additional information that should be given to the new owner? N							
Do you have any additional information that should be given to the new owner? In							

I hereby certify that the above information is correct to the best of my knowledge. I also understand that if the system is considered "non-compliant/failing" per MPCA rules, that the inspector must by law submit a copy of this report to the local government unit within 15 days of the date of inspection completion. I also agree that unless otherwise noted in this report, that I/we are ultimately responsible for payment of all fees for all work performed relative to this inspection by Inspect Minnesota and Midwest Soil Testing.

Owner/Occupant: Mike Gallagher's Signature On File Date: 06/15/2017

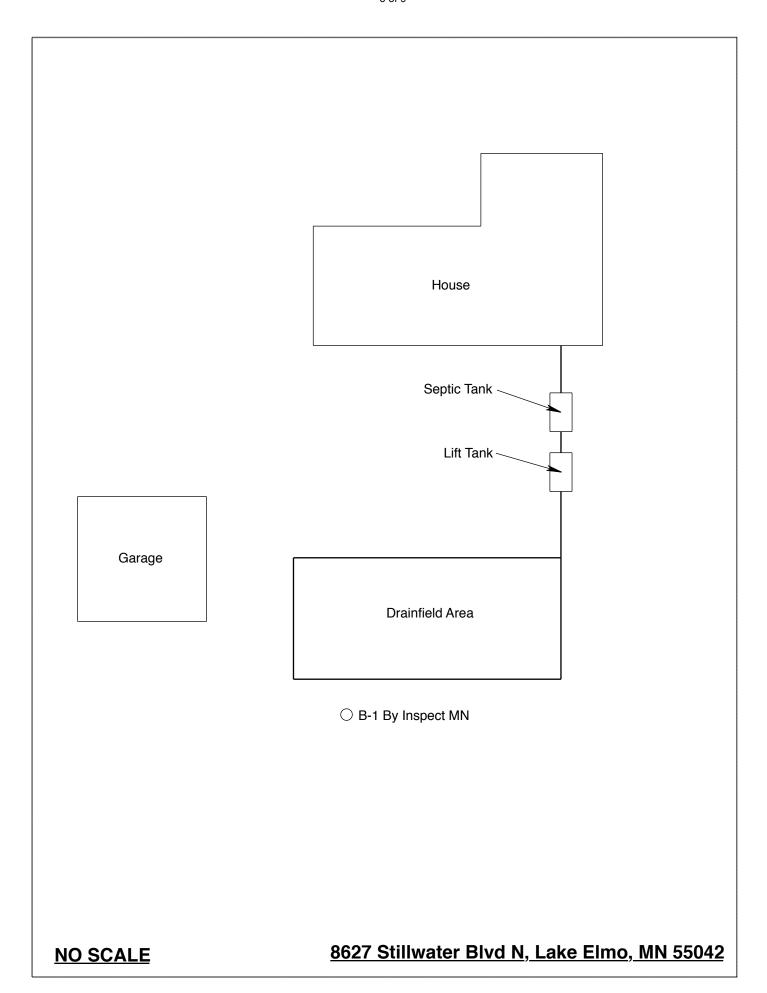

Log Of Soil Borings

Location of Project: 8627 Stillwater Blvd N, Lake Elmo, MN 55042							
Borings Made By: Inspect Minnesota				Date:	6/15/17		
	Auger Used: Hand/Bucket			fication System:	USDA		
В	oring Number:	1		Boring Number:			
Surface Elevation of Boring Same Ground Surface As Last Drainfield Trench		Surface Elevation Boring	of				
Depth In Inches	· Sous Focouniered			Soils Er	Soils Encountered		
· J Solis Focoliniered							
65" De	Depth To End Of Boring Or Redox		[Depth To End Of Boring Or Redox			
Same Ele	Same Elevation Of Boring Relative To System		Elevation Of Boring Relative To System				
-35" Depth To Bottom Of Distribution Media ≥30" Of Separation			Depth To Bottom Of Distribution Media Of Separation				
Er	nd Of Boring At:	65"		End Of Boring At:			
Redox Present At: None			Redox Present At:				
Standing Water Present At: None			Standing	Water Present At:			

Bottom Of Distribution Medium At: 35 inches	

DISCLAIMER

Brian L. Humpal, Inc. dba. Inspect Minnesota, Midwest Soil Testing Relative to Subsurface Sewage Treatment System (SSTS) Compliance Inspections

- 1. This inspection/report is being performed for only the seller/owner of the property on which the SSTS is located. In such case that another party is paying for the inspection, the contract is between only said party and Brian L. Humpal, Inc.; there is no contract between Brian L. Humpal, Inc. and any other party unless otherwise noted.
- 3. Brian L. Humpal, Inc. has not been retained to warranty, guarantee, or certify the proper functioning of the SSTS for any period of time beyond the date of inspection or into the future. Because of the numerous factors (usage, maintenance, soil characteristics, previous failures, etc.) which may affect the proper operation of an SSTS, as well as the inability of Brian L. Humpal, Inc. to supervise or monitor the use or maintenance of the SSTS, the report shall not be construed as a warranty by Brian L. Humpal, Inc. that the SSTS will function properly for any particular party for any period of time.
- 4. Brian L. Humpal, Inc. is unable to verify the frequency and/or, quality of prior or future maintenance of the SSTS. Maintenance of the tank(s) must be performed through the tanks maintenance hole. The removal of solids from any location other than the maintenance hole is not a compliant method of maintenance. It is strongly recommended that maintenance covers be made accessible to the ground surface to facilitate proper maintenance.
- 5. Minimum Compliance Inspection requirements relative to this inspection and this report include <u>only</u> verification that the SSTS has tank(s) (septic tanks, lift tanks, dosing tanks, stilling tanks, etc.) which are watertight below the designed operating depth, the required separation between the bottom of the subsurface soil distribution medium and seasonally saturated soils, no back-ups of sewage into the dwelling, no discharge of sewage/effluent to the ground surface or surface waters, and no imminent safety hazards. Brian L. Humpal, Inc. does not inspect plumbing or pumps prior to the first SSTS component as these are plumbing components. The performance of exterior pumps and associated components are not inspected as they are considered to be maintenance items. Additionally, no indications relative to compliance with electrical code requirements have been made. It is recommended that any other applicable plumbing, electrical, housing, etc. inspections be performed by a qualified inspection business. Sewage back-up verification is limited to observing the floor drain area and/or the information supplied by the last occupants of the building prior to inspection. Brian L. Humpal, Inc. cannot guarantee that the information given to them by the last occupants of the building prior to inspection relative to back-ups is accurate.
- 4. Certification of this SSTS does not warranty future use beyond the date of the inspection. Any SSTS, old or new, can become hydraulically overloaded or discharge sewage/effluent to the ground surface as a result of more people moving into the house than were previously occupying the house, improper maintenance, heavy usage, leaking plumbing fixtures, groundwater infiltration, tree roots, freezing conditions, surface drainage problems, poor initial design, poor construction practices, or unsuitable materials used in constructing the system; the system can also simply stop working because of its age. An SSTS that has been properly designed and installed, properly maintained, and used in the manner for which the system was designed can be expected to provide service for twenty to twenty-five years on average. Some parts of the SSTS such as alarms, switches, pumps, filters, etc. will most likely have to be repaired or replaced over the lifetime of the system.
- 5. A Compliance Inspection is not meant to be a test or inspection for longevity of the system; a Compliance Inspection is strictly for the purpose of determining if the SSTS is protective of public health and safety, as well as the groundwater at the date and time the inspection was performed. This inspection is not intended to determine if the SSTS was originally designed or installed to past or present MPCA or other Local Government Unit code requirements. This inspection is not intended to determine if the SSTS was designed and/or installed to support the anticipated flow from the building as the use of the building may have changed since the design and construction of the SSTS due to the addition of bedrooms, occupants, etc. In addition, this inspection is not intended to determine the quality of the original SSTS design, the quality of the construction practices used while installing the SSTS, or the quality of the materials used in constructing the SSTS.
- 6. Brian L. Humpal, Inc. cannot guarantee the performance of SSTS products/components such as: gravelless pipe, chamber trenches, effluent filters, tanks, sewage pre-treatment components, piping, etc. Products such as gravelless pipe are no longer approved for installation in the State of Minnesota and may have a significantly reduced performance and/or life expectancy.
- 7. WINTER WORK: By accepting this report, it is understood that inspections conducted during winter months (approximately November 1st through April 1st) are more difficult to perform because of possible snow cover and/or ground frost. SSTS components such as tanks, maintenance covers, tank inspection pipes, subsurface distribution medium inspection pipes, and soil treatment areas are more difficult or impossible to locate due to snow cover and/or ground frost. In addition, soil borings are more difficult to perform due to snow cover and/or ground frost. Brian L. Humpal, Inc. will attempt to use the same level of standards when performing work during winter periods as when performing work during non-winter periods. However, the recipient of this report understands that because of the aforementioned considerations, the same level of standards may not be possible.
- 8. By accepting this report, the client understands that Brian L. Humpal, Inc. will not be responsible for any monetary damages exceeding the fee for the services provided.

Subsurface Sewage Treatment Systems

Non-transferable

Business License

Inspect Minnesota, Midwest Soil Testing

License # L2896

License Expires: 12/22/2017

Issued: 11/29/2016

Specialty Area(s):

Installer
Maintainer
Service Provider
Advanced Designer
Advanced Inspector

Designated Certified Individual(s):

Cert #

Name

Certification Expires:

C5342

Brian L Humpal

10/15/2017

Installer, Maintainer, Serv Prov, Adv Designer, Adv Inspector

C9852

Christopher R Uebe

3/4/2018

Designer, Inspector



St. Paul. Minnesota 55155-4194

Steven Giddings, Manager

Prevention and Solid Waste Management Section