

520 Lafayette Road North St. Paul, MN 55155-4194

Compliance Inspection Form

Existing Subsurface Sewage Treatment Systems (SSTS)

Doc Type: Compliance and Enforcement

Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached forms – additional local requirements may also apply.	For local tracking purposes:						
Submit completed form to Local Unit of Government (LUG) and system owner within 15 days							
System Status							
System status on date (mm/dd/yyyy): 6/10/2017							
 ✓ Compliant – Certificate of Compliance (Valid for 3 years from report date, unless shorter time frame outlined in Local Ordinance.) ✓ Noncompliant – Notice of Noncompliance (See Upgrade Requirements on page 3.) 							
Reason(s) for noncompliance (check all applicable)	Reason(s) for noncompliance (check all applicable)						
☐ Impact on Public Health (Compliance Component #1) – Imminent threat to public he							
Other Compliance Conditions (Compliance Component #3) – Imminent thr							
☐ Tank Integrity (Compliance Component #2) – Failing to protect groundwate							
 ☐ Other Compliance Conditions (Compliance Component #3) – Failing to protect groundwes ☐ Soil Separation (Compliance Component #4) – Failing to protect groundwes 							
☐ Operating permit/monitoring plan requirements (Compliance Component #							
Property Information Parcel ID# or Sec/Twp/Range	ge: 20.029.20.32.0014						
Property address: 13206 24 th St Ct N Stillwater, MN 55082 Reason for	or inspection:property sale						
Property owner: James L Hamalainen Owner's	phone:						
Or	stative phone: 651 242 6036						
	ntative phone: _651-242-6036 ry authority phone: _651-430-6673						
Local regulatory authority: Washington County Regulator Brief system description: 1500 gallon & 1000 gallon septic tanks, 1000 gallon pump							
Comments or recommendations:	tank a 1000 or pressure sea arannere.						
Comments of recommendations.							
Certification							
I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.							
Inspector name: Tom Trooien Certificat	ion number: 323						
Business name: All State Septic Services LLC Licer	nse number: 1568						
Inspector signature: Pho	one number:612-594-4496						
Nococcary or Locally Poquired Attachments							
Necessary or Locally Required Attachments	local ordinance						
☑ Soil boring logs☑ System/As-built drawing☐ Other information (list):	iocai ordinance						
I I Outer Intolliation (180).							

	lungs et an Dublic Haalth	Compliance comme	(mm/dd/yyyy)			
1.	. Impact on Public Health – Compliance compon					
	Compliance criteria: System discharges sewage to th	e ☐ Yes ☒ No	Verification method(s): ⊠ Searched for surface outlet			
	ground surface.	le les Milo	☑ Searched for seeping in yard/backup in home			
	System discharges sewage to dr tile or surface waters.	rain Yes No	 ☑ Excessive ponding in soil system/D-boxes ☐ Homeowner testimony (See Comments/Explanation) 			
	System causes sewage backup dwelling or establishment.	into Yes No	☐ "Black soil" above soil dispersal system ☐ System requires "emergency" pumping			
	Any "yes" answer above indicates the system is an imminent threat to public health and safety.		☐ Performed dye test ☐ Unable to verify (See Comments/Explanation) ☐ Other methods not listed (See Comments/Explanation)			
2.	Comments/Explanation: Tank Integrity — Complia	ance component #2 of !	5			
	Compliance criteria:		Verification method(s):			
	System consists of a seepage pi cesspool, drywell, or leaching pit		 ☑ Probed tank(s) bottom ☑ Examined construction records 			
	Seepage pits meeting 7080.2550 ma compliant if allowed in local ordinand		 ☐ Examined Tank Integrity Form (Attach) ☐ Observed liquid level below operating depth 			
	Sewage tank(s) leak below their designed operating depth. If yes, which sewage tank(s) leal	0	☐ Examined empty (pumped) tanks(s) ☐ Probed outside tank(s) for "black soil"			
	Any "yes" answer above indicates the system is failing to protect groundwater.		 ☐ Unable to verify (See Comments/Explanation) ☐ Other methods not listed (See Comments/Explanation) 			
3.	Comments/Explanation: Other Compliance Cond	litions – Compliance cor	mponent #3 of 5			
			red, or appear to be structurally unsound. Yes* No Unknown			
	b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety. ☐ Yes* ☒ No ☐ Unknow *System is an imminent threat to public health and safety.					
	Explain:					
	c. System is non-protective of ground water for other conditions as determined by inspector . ☐ Yes* ☒ No *System is failing to protect groundwater.					
	Explain:					

Property address: 13206 24th St Ct N Stillwater, MN 55082


Inspector initials/Date: TT | 6/10/2017

www.pca.state.mn.us • 651-296-6300 • 800-657-3864 • TTY 651-282-5332 or 800-657-3864 • Available in alternative formats wa-wwists4-31b • 6/4/14

Property address: 13206 24th St Ct N Stillwate	er, MN 55082	Inspector initials/Date: _1					
			(mm/dd/yyyy)				
4. Soil Separation Compliance co	omnonent #4 of 5						
Date of installation: 8/12/2014 (mm/dd/yyyy)	Unknown	Verification method(s):					
Shoreland/Wellhead protection/Food beverage lodging?	☐ Yes No	Soil observation does not expire. Pre observations by two independent par unless site conditions have been alte	rties are sufficient,				
Compliance criteria:		requirements differ.					
For systems built prior to April 1, 1996, and	☐ Yes ☐ No	□ Conducted soil observation(s) (Attention)	tach boring logs)				
not located in Shoreland or Wellhead		☐ Two previous verifications (Attach boring logs)					
Protection Area or not serving a food, beverage or lodging establishment:		☐ Not applicable (Holding tank(s), no drainfield)					
Drainfield has at least a two-foot vertical		☐ Unable to verify (See Comments/Explanation)					
separation distance from periodically		Other (See Comments/Explanation)					
saturated soil or bedrock.							
Non-performance systems built April 1,	⊠ Yes □ No	□ No Comments/Explanation:					
1996, or later or for non-performance systems located in Shoreland or Wellhead		B-1 0-11 topsoil10 YR 3/3					
Protection Areas or serving a food,		11-32 loamy sand10 \					
beverage, or lodging establishment:		32-64 med sand	7.5 YR 4/6				
Drainfield has a three-foot vertical separation distance from periodically							
saturated soil or bedrock.*							
"Experimental", "Other", or "Performance"	☐ Yes ☐ No	Indicate depths or elevations					
systems built under pre-2008 Rules; Type IV			24				
or V systems built under 2008 Rules (7080. 2350 or 7080.2400 (Advanced Inspector		A. Bottom of distribution media	24				
License required)		B. Periodically saturated soil/bedrock					
Drainfield meets the designed vertical		C. System separation	40				
separation distance from periodically saturated soil or bedrock.							
		D. Required compliance separation*	36				
Any "no" answer above indicates the system is *May be reduced up to 15 percent if allowed by Local Ordinance.							
failing to protect groundwater.							
Operating Permit and Nitroger	n BMP* – Complian	ce component #5 of 5 🛛 🛛 N	lot applicable				
Is the system operated under an Operating	Permit?	No If "yes", A below is require	ed				
Is the system required to employ a Nitroge	n BMP? ☐ Yes	⊠ No If "yes", B below is requir	ed				
BMP = Best Management Practice(s)	specified in the system	design					
If the answer to both questions is "no", this section does not need to be completed.							
If the answer to both questions is the , this section does not need to be completed.							
Compliance criteria							
Operating Permit number: n/a Have the Operating Permit requirements been met?		☐ Yes ☐ No					
b. Is the required nitrogen BMP in place	and properly functioning	g?					
Any "no" answer indicates Noncompliance.							
Unavada Daguiramento (14) Stat S 445 51	Ungrade Peguirements (Minn. Stat. & 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use						

Upgrade Requirements (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is falling to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

TTY 651-282-5332 or 800-657-3864 • Available in alternative formats 651-296-6300 800-657-3864 www.pca.state.mn.us • Page 3 of 3

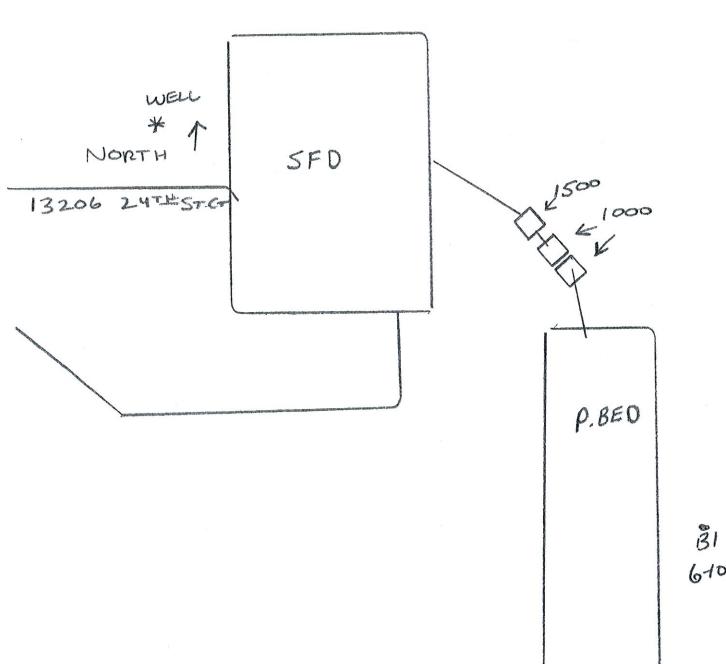

6-10-17